


Water and Sewer Board

Regular Meeting

City Council Chambers – City Center South

1001 11th Avenue – Greeley, Colorado

May 17, 2023 at 2:00 p.m.



Regular meetings of the Water and Sewer Board are held **in person** on the 3rd Wednesday of each month in the City Council Chambers, 1001 11th Avenue, Greeley, Colorado.



Members of the public may attend and provide comment during public hearings.



Written comments may be submitted by US mail or dropped off at the Water and Sewer office located at 1001 11th Avenue, 2nd Floor, Greeley, CO 80631 or emailed to wsadmin@greeleygov.com. All written



comments must be received by 10:00 a.m. on the date of the meeting.

Meeting agendas and minutes are available on the City's meeting portal at [Greeley-co.municodemeetings.com/](https://greeley-co.municodemeetings.com/)

IMPORTANT – PLEASE NOTE

This meeting is scheduled as an **in-person session only**. If COVID, weather, or other conditions beyond the control of the City dictate, the meeting will be conducted virtually and notice will be posted on the City's MuniCode meeting portal by 10:00 a.m. on the date of the meeting (<https://greeley-co.municodemeetings.com/>).

In the event it becomes necessary for a meeting to be held virtually, use the link below to join the meeting. Virtual meetings are also livestreamed on YouTube at <https://www.youtube.com/CityofGreeley>.

For more information about this meeting or to request reasonable accommodations, contact the administrative team at 970-350-9801 or by email at wsadmin@greeleygov.com





Water & Sewer Board

May 17, 2023 at 2:00 PM
1001 11th Avenue, City Center South, Greeley, CO 80631

Agenda

1. Roll Call: _____ Chairman Harold Evans _____ Vice Chairman Mick Todd
 _____ Ms. Cheri Witt-Brown _____ Mr. Fred Otis
 _____ Mr. Joe Murphy _____ Mr. Tony Miller
 _____ Mr. Manuel Sisneros _____ Mayor John Gates
 _____ Mr. Raymond Lee _____ Mr. John Karner
2. Approval of Minutes
3. Approval of the Agenda
4. Welcome New Employees and Promotions
5. IWRP Final Review and Approval of 2023 Master Plan
6. Lead and Copper Rule Revisions - Lead Service Line Inventory and Replacement Project Update
7. Wastewater Treatment Nitrification Project Update
8. 2024 Budget Overview and CIP Priorities
9. Water Court Update
10. Legal Report
11. Director's Report
12. Executive Session
 - a. Market Update
13. Such Other Business That May Be Brought Before the Board Added to This Agenda by Motion of the Board.
14. Adjournment



If, to effectively and fully participate in this meeting, you require an auxiliary aid or other assistance related to a disability, please contact the Water and Sewer Department administrative staff at 970-350-9801 or wsadmin@greeleygov.com

**City of Greeley
Water and Sewer Board
Minutes of April 19, 2023
Regular Board Meeting**

Chairman Harold Evans called the Water and Sewer Board meeting to order at 2:00 p.m. on Wednesday, April 19, 2023.

1. Roll Call

The Clerk called the roll and those present included:

Board Members:

Chairman Harold Evans, Vice Chairman Mick Todd, Fred Otis, Tony Miller, Joseph Murphy, Manuel Sisneros, Cheri Witt-Brown, Mayor John Gates, Deputy City Manager Donald Tripp on behalf of City Manager Raymond Lee, Finance Director John Karner

Water and Sewer Department staff:

Director Sean Chambers, Deputy Director Water Resources Ty Bereskie, Deputy Director of Utility Finance and Customer Service Erik Dial, Chief Engineer Adam Prior, Office Manager Gigi Allen, Administrative Assistant III Crystal Sanchez, Water Resource Planning Manager Kelen Dowdy, Water Conservation Manager Dena Egenhoff, Rates and Budget Analyst Virgil Pierce, Civil Engineer IV Jim Paulson, Communication Specialist II Cory Channell, Water Resource Administrator III Matt Sparacino, Water Resource Administrator III Sam Harshbarger, Water Resource Administrator II Alex Tennant, Water Resource Administrator I Megan Kramer, Water Resource Operations Manager Leah Hubbard (joined Virtually)

Legal Counsel:

Senior Environmental and Water Resources Attorney Jerrae Swanson, Environmental and Water Resources Attorney II Dan Biwer, Environmental and Water Resources Attorney I Arthur Sayre, Counsel to Water & Sewer Board Attorney Carolyn Burr

Guests:

Emeritus Robert Ruyle, Neil Stewart with Stantec, Council Member Deb Deboutez (joined virtually), James Sutherland from Wingfoot, PC Specialist Ben Soliday

2. Approval of Minutes

Ms. Witt-Brown made a motion, seconded by Mr. Otis to approve the March 15, 2023 Water and Sewer Board meeting minutes. The motion carried 7-0.

3. Approval of Agenda

There were no changes to the agenda.

4. Welcome New Employees and Promotions

Director, Sean Chambers provided an introduction of new Water and Sewer Department employees starting this month.

Agenda number 5 and 6 were switched, IWRP was presented then Fourth Quarter 2022 CIP Update.

Assistant City Manager Juliana Kitten joined the meeting at 2:26 pm.

5. Integrated Water Resource Plan Update (IWRP)

Water Resources Planning Manager, Kelen Dowdy and Neil Stewart from Stantec presented to the Board the draft final IWRP report.

During the presentation the Board asked if there are plans to change agricultural water rights to municipal use any time soon or is there a set amount each year that will be looked at? City staff responded it would change water based on economic and strategic considerations as well as the water rights purchased in the future.

Annual updates will be given to the Board once the final IWRP is adopted.

The Board has been given the opportunity to email comments about the IWRP presentation by May 1, 2023 to Kelen Dowdy.

Neil Stewart and Ben Soliday left the meeting at 2:45 pm.

6. Fourth Quarter 2022 CIP Update

Adam Prior provided an update on CIP projects.

When discussing the Lead Service Line Inventory and Replacement project the Board asked when completion was anticipated. Mr. Prior stated it will be dependent on budget and manpower to get the work done. The next phase will be to pothole 500 to 1,000 sites and then plan for replacements from there. There is \$6,000,000 budgeted for this work in 2023. The system inventory for this project is due in October 2024 and that is the completion date the City is working towards.

The Board asked if there have been any improvements in the supply chain pricing and timing of deliveries. Mr. Prior responded it would typically see about 7 to 8% increase in supply costs but the past couple of years that increase has been around 30%. The City is also experiencing delays in equipment being delivered, depending on the equipment/materials needed with some lead times of up to a year. Adjustments have been made to planning of projects to get equipment/supplies ordered up to two years in advance before work is to commence.

7. April Water Supply Update and Approve Determination of Water sufficiency

Staff reported on Greeley's water supply status. Based on projected storage, staff recommends that the Board declare an "Adequate Water Year," with normal watering restrictions and that the Board authorize staff to rent out available excess water supply, so long as the target storage volume of 21,300 acre-feet is maintained.

Mr. Miller moved that the Water and Sewer Board declare an adequate year and make supplies available for rental. Vice Chairman Todd seconded the motion. The motion carried 7-0.

Assistant City Manager Juliana Kitten left at 3:07 pm

8. Legal Report

Staff and Carolyn Burr of Welborn, Sullivan, Meck and Tooley do not recommend authorizing filing any statements of opposition to matters contained in the February 2023 Water Division 1 resume.

9. Director's Report

Director, Sean Chambers provided a summary of the following items of interest.

1. City of Greeley and Water Industry Events
 - a. 2023 Boards and Commission's volunteer appreciation event – 4/27 at 5:30 pm
 - b. CWCB Drought Summit - 5/31 & 6/1
 - c. Summer Board & Council Tour – July 28, 2023
 - i. Tentative: WWTRF, Poudre Ponds, Terry Ranch pipeline, Chimney Hollow
 - d. Colorado Water Congress Conference – August 2023 dates TBD
2. 2024 Budget Process Update
3. PFAS Info Sheet
4. Colorado River Shortage Update

- a.* Bureau of Reclamation has released the draft Supplemental Environmental Impact Statement (SEIS) for Near-term Colorado River Operations. The supplement is to the December 2007 Record of Decision associated with the Colorado River Interim Guidelines for Lower Basin Shortages and Coordinated Operations for Lake Powell and Lake Mead, referred to as the 2007 Interim Guidelines.

<https://www.usbr.gov/ColoradoRiverBasin/SEIS.html>

- 5. Wastewater Treatment & Reclamation Facility Nutrient Remove CIP update report – April

11. Such Other Business That May Be Brought Before the Board Added to This Agenda by Motion of the Board.

There were no additional items brought before the Board and added to the agenda.

12. Adjournment

Chairman Evans adjourned the meeting at 3:37 p.m.

Harold Evans, Chairman

Raymond Lee, Board Secretary



Water & Sewer Agenda Summary

Date: May 17, 2023

Key Staff Contact: Water and Sewer Director, Sean Chambers

Title: Welcome New Employees and Promotions

Summary:

New Hires: Logan Reinsmith – Transmissions and Distribution Laborer
Ana Vega – Customer Service Representative
Aron Balderrama – Customer Service Representative
Annamaria Ramirez – Customer Service Representative
Savannah Casares – Customer Service Representative
Reanna Gonzales – Customer Service Representative

Promotions: Nick Drury – Bellvue Plant Operator B to Bellvue Plant Operator A

Recommended Action:

Attachments:



Water & Sewer Agenda Summary

Date: May 17, 2023

Key Staff Contact: Kelen Dowdy, Water Resource Planning Manager

Title: Integrated Water Resource Plan Update: Final Report

Summary:

This presentation will outline the remaining steps to approval of the Integrated Water Resource Master Plan. The attached documents are the final version of the IWRP report and executive summary. Once adopted, printed copies will be available for board members.

Recommended Action: Formal adoption of the Integrated Water Resource Master Plan

Attachments: IWRP_Report_Final.pdf & IWRP_Report_Final_ExecutiveSummary.pdf



Integrated Water Resource Plan

Water and Sewer Board Update

May 17, 2023





IWRP Vision Statement

“An actionable and adaptive master plan for Greeley’s water resources that uses modern, defensible methods to develop a roadmap ensuring a reliable water supply for our community through an uncertain future.”




IWRP Timeline






Remaining Deliverables

- “WADT” Water Acquisition Database Tool
- Online Story Map
- Final Public Presentation

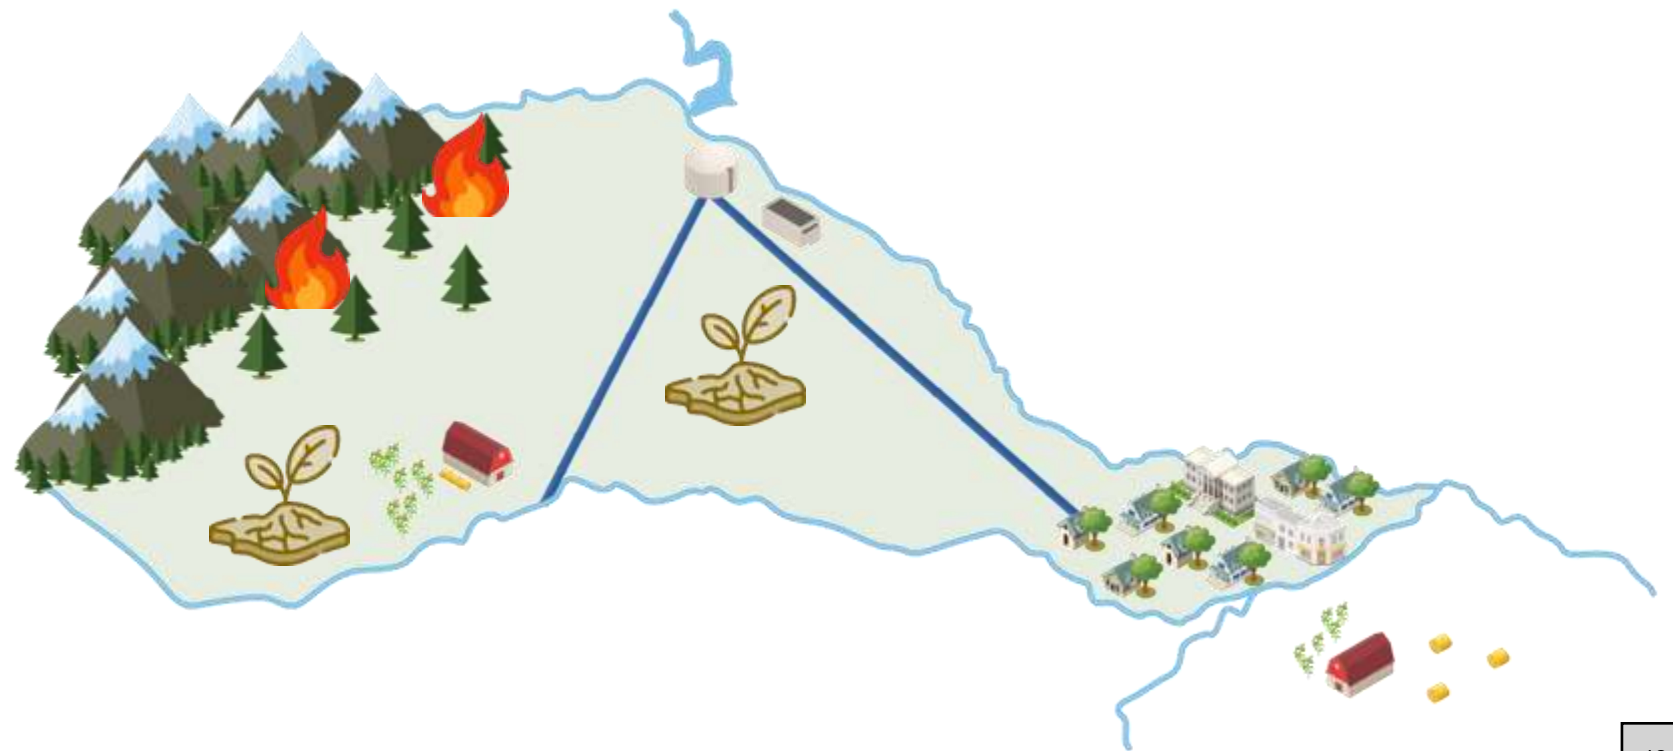

Next Steps

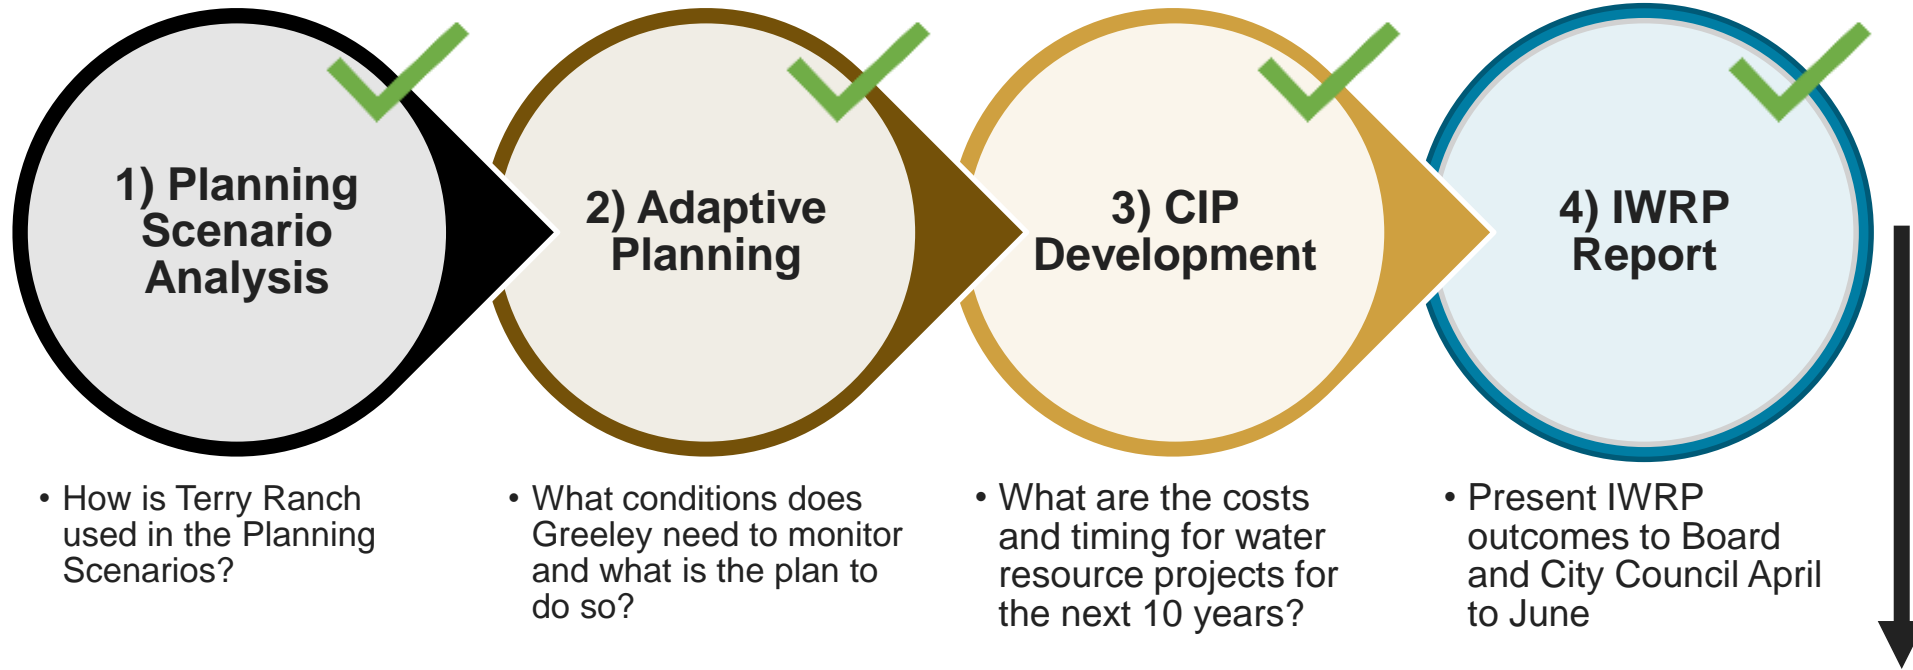

- How is Terry Ranch used in the Planning Scenarios?

- What conditions does Greeley need to monitor and what is the plan to do so?

- What are the costs and timing for water resource projects for the next 10 years?

- Present IWRP outcomes to Board and City Council April to June

- City Council Work Session: 4/25 ✓
- Planning Commission: 5/9 ✓
- W&S Board Recommendation: 5/17
- City Council Recommendation: 6/6
- IWRP Complete: June



Questions?



EXECUTIVE SUMMARY

The Integrated Water Resources Plan (IWRP) for the City of Greeley Water and Sewer Department (Greeley) is a long-term strategic water resources master plan that ensures sustainable and affordable water supplies for their customers now and into the future. This comprehensive plan integrates Greeley’s water supply system and projected demands with possible future conditions around hydrology, climate change, and risks to Greeley’s water supply system. The IWRP establishes a plan for triggering the Terry Ranch Project (a new aquifer storage and recovery project), a process for evaluating and strategically acquiring water rights, a 10-year Capital Improvement Plan (CIP), and an Adaptive Plan for Greeley to follow.

INTRODUCTION AND PROCESS

Historically, many water resource planning efforts focused on developing a firm yield based on a single set of historical conditions. Projects were selected and prioritized based solely on their ability to improve firm yield under this one set of conditions. Recent events have shown that future conditions are highly uncertain and planning for a single future increases the risk of water supply failure. Greeley, building off a history of effective and prudent planning efforts, elected to complete an integrated planning process for this IWRP to better plan for an increasingly uncertain future.

In implementing an integrated planning process, the IWRP developed “Planning Scenarios” that capture a range of possible future conditions for Greeley’s water supply system. These were applied at key points in time (e.g., “Planning Horizons”) for Greeley’s water supply system. **Figure ES-1** shows the three IWRP Planning Horizons – the first defined what water resources projects are required in the next 10 years, the second identifies when to integrate the Terry Ranch Project, and the third established how to best use the Terry Ranch Project once fully integrated and if that use is sustainable.

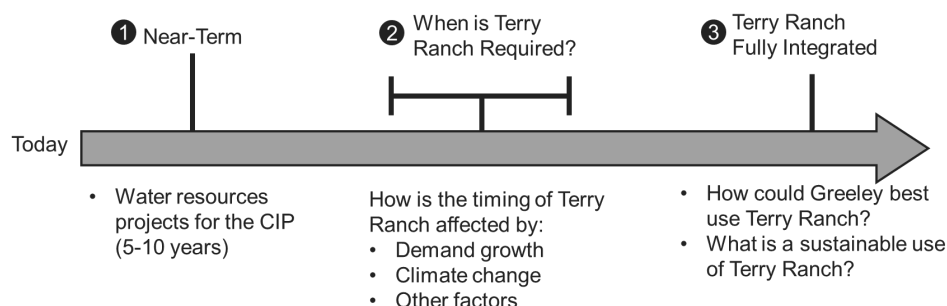


Figure ES-1. Planning Horizons Used in the IWRP

Due to the significant uncertainty around what the future could look like, the IWRP did not predict what future condition is most likely to occur. Instead, a Planning Scenario methodology was applied that captures a range of possible future conditions for Greeley’s water supply system. The Planning Scenarios and their associated conditions are shown graphically in **Figure ES-2**. The *Unbearable* Planning Scenario





was the reasonable high-bookend for Greeley’s water supply system and combines the hottest climate, the highest demand projections, and significant risk impacts. The *Stressed* Planning Scenario assumes the hottest climate, a lower demand projection, and moderate risk impacts. The *Continued Trends* Planning Scenario assumes a warmer climate, continued decreases in per capita water use, and moderate risk impacts. The *Optimistic* scenario assumes a warmer climate, the lowest demand projections, and least risk impacts. Finally, the *No Climate Change* planning scenario includes no climate change, a higher demand projection than *Optimistic* as the lack of climate change would likely encourage higher Greeley growth, and low risk impacts.

Figure ES-2. Planning Scenarios used in the IWRP

Planning Scenario Name	Climate Warming	CO River Basin Risk Impacts	Water Supply System Yields	Demands
Unbearable		High		
Stressed		Moderate		
Continued Trends		Moderate		
Optimistic		Low		
No Climate Change		Low		

An important element in the IWRP was defining when future water supply system performance was acceptable, which the IWRP set using ‘planning performance criteria’. **Figure ES-3** presents the planning performance criteria and their acceptability definitions.

Figure ES-3. Planning Performance Criteria Used in the IWRP

Performance Criteria	Acceptable Performance
Are Greeley customers being significantly impacted?	Drought Restrictions used at any level no more than 20% of years and no more than 10% of years in Level 3
Greeley maintains sufficient emergency reserve.	April 1 storage volume has at least 6 months of indoor demands in 100% of years
Greeley meets critical water needs for public health.	Indoor demands are met 100% of the time.





FUTURE CONDITIONS ASSESSMENT

The IWRP completed a risk assessment that identified, prioritized, and evaluated a comprehensive list of events that could impact Greeley’s water supply system. This assessment identified four risk “drivers”, defined as major events or conditions that are outside Greeley’s control that could impact their ability to provide sustainable water supply to their customers. The drivers identified for the IWRP were:

- The **Climate Change Impacts on Hydrology** driver captures risks that could change what Greeley’s existing water rights yield and the timing of that yield compared to what has been experienced historically. This is due to a combination of droughts of increased intensity, duration, and/or frequency compared to the historical record, runoff impacts, and the overall hydrograph from a warmer climate.
- The **Future Demand Uncertainty** driver captures risks that affect how much water demand Greeley’s system would need to meet in the future and how water is used compared to historical usage. This includes population growth, outdoor water use variability, and climate change impacts to demands.
- The **Water Rights Administration Complexity and Uncertainty** driver captures risks that affect Greeley’s ability to change currently owned water rights, acquire new water rights, and yields from existing and future water rights. This includes increased competition for new water rights, the legal complexity of changing water rights, and uncertainty related to how water rights administration may change under a different hydrograph than historical.
- The **Colorado River Basin Issues** driver captures risks to Greeley’s yields from the Colorado River Basin which could result in a variety of short- and long-term supply reductions or curtailments.

The *Climate Change Impacts on Hydrology* driver was further evaluated by developing new climate change hydrology that captures the potential impacts of long-term climate change and droughts of increasing intensity, duration, and frequency. An advanced modeling process was completed that quantified the impacts of long-term changes in temperature and precipitation to Greeley’s entitlements (e.g., water legally and physically available to Greeley). **Figure ES-4** summarizes the conclusions from this analysis and the confidence of those conclusions.

Figure ES-4. Conclusions from the Climate Change Hydrology Analysis

Conclusion Statement	Confidence	Comment
Droughts of greater duration, frequency, and severity than observed droughts are possible under current climate.	High	<i>Results show these conclusions are consistent with other studies and make logical sense.</i>
Climates with less precipitation and or warmer climates will decrease Greeley’s water supply system yields.	High	
Yields from Greeley’s junior water rights and certain water supply systems could be vulnerable to changing agricultural demands.	Moderate	<i>It is likely that agricultural demand changes will impact Greeley’s entitlements. It is unknown how agricultural demands will change.</i>
Climates with increased precipitation could increase Greeley’s water supply system yields.	Low	<i>Impacts from hydrograph changes cannot be confidently modeled with existing tools.</i>





The *Future Demand Uncertainty* driver was further evaluated by developing new total demand projections (potable and non-potable) for Greeley at 2030, 2050, and 2070 under four demand scenarios. These four scenarios varied population growth, the extent to which irrigation increases in response to hotter and drier future climate conditions, the extent of future conservation, and the proportion of new housing units that are multifamily apartments and condominiums. **Figure ES-5** shows the new demand projections.

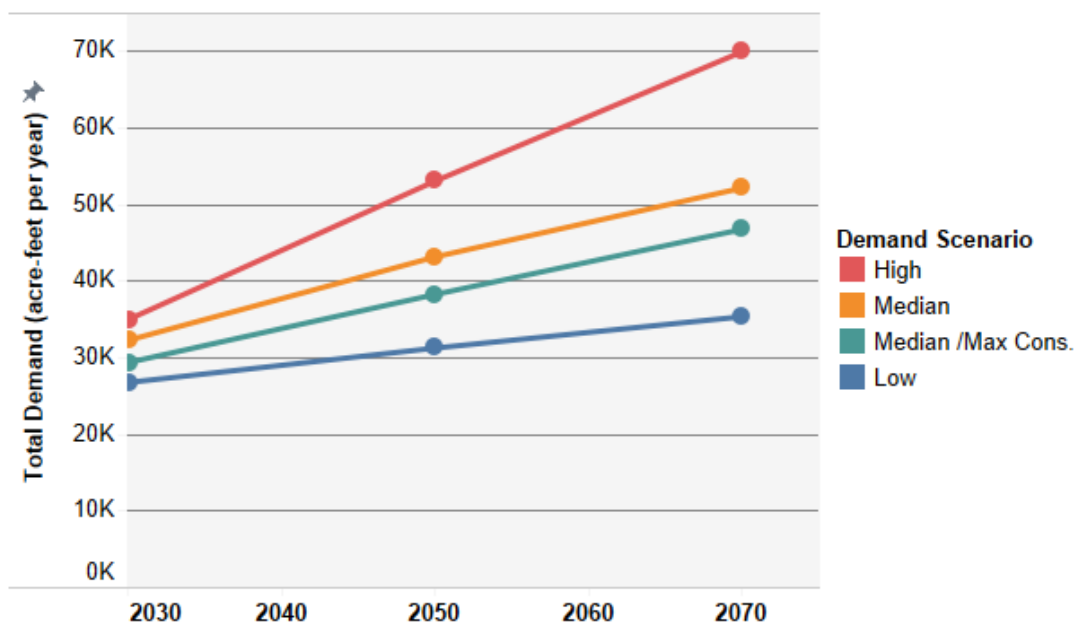


Figure ES-5. Greeley’s Projected Future Water Demands

These demand projections are highly variable between the scenarios, with the difference between the high and low scenario increasing from 8,200 acre-feet per year at 2030 (33% of current demands) to 34,600 acre-feet per year at 2070 (137% of current demands). These demand projections assumed demand growth occurs immediately. However, Greeley’s total demands have not grown significantly over the last 10 years.





TERRY RANCH TIMING AND INTEGRATION EVALUATION

The *Terry Ranch Timing* analysis determined that Greeley’s water supply system without Terry Ranch can meet near-term Planning Scenario conditions. For example, in the *Continued Trends* Planning Scenario, Greeley’s system without the Terry Ranch Project can accommodate an additional 10,000 acre-feet per year of demand growth – approximately 40% more demand than current. The IWRP could not confidently time the Terry Ranch Project implementation due to the lack of recent demand growth and the significant variability of future demand projections. In-lieu of assigning a timetable to Terry Ranch Project implementation, Greeley will monitor demands and water supplies as part of the Adaptive Plan.

The *Terry Ranch Integration* analysis determined if Terry Ranch operations would be sustainable long-term under the different Planning Scenarios. The IWRP defined Terry Ranch operations as sustainable if it can deliver sufficient supplies during drought to minimize drought restrictions while maintaining at least 80% of the 1.2 million acre-foot initial aquifer storage volume long-term. **Figure ES-7** shows the results of the Terry Ranch Integration Analysis by Planning Scenario. This table indicates what (if any) additional water resources were included, the percent of years Greeley drought response actions were used, the average annual Terry Ranch “Delta” (average injection minus average extraction), and the percent of the native aquifer remaining at the end of an 86-year simulation period.

Results from the *Terry Ranch Integration* analysis show that the Terry Ranch Project can be operated sustainably in the *Continued Trends*, *Optimistic*, and *No Climate Change* Planning Scenarios. Sustainable operation in these Planning Scenarios will require some additional water supplies and retiming storage. Results from the *Unbearable* and *Stressed* Planning Scenarios show that under the hottest climate change projections and significant demand growth conditions, Terry Ranch Operations are not sustainable. Greeley can monitor climate and demand growth conditions as part of the Adaptive Plan and, if the most impactful future conditions emerge, can adjust the long-term water supply strategy.

Figure ES-6. Tabular Summary of Terry Ranch Integration Results

Planning Scenario	Additional Water Resources	% Years with Drought Response	Annual Terry Ranch Delta (acre-feet per year)	Ending Aquifer Volume (% of 1.2 million acre-foot Volume)
Unbearable	Retiming Storage + Moderate Water Acquisitions	100%	-10,700	23%
Stressed	Retiming Storage + Moderate Water Acquisitions	64%	-6,500	53%
Continued Trends	Retiming Storage + Moderate Water Rights	35%	-1,200	91%
Optimistic	None	12%	+1,900	113%
No Climate Change	Retiming Storage + Low Water Acquisitions	36%	-1,900	86%

Color Key Indicates Terry Ranch Sustainability Criteria: **Blue** has sufficient remaining aquifer storage percentage, **Orange** has insufficient remaining aquifer storage percentage





IWRP OUTCOMES AND RECOMMENDATIONS

The IWRP showed that Greeley is well-positioned to provide sustainable and affordable water supplies through an uncertain future. The IWRP’s important outcomes and conclusions regarding Greeley’s current, near-term, and long-term water supply system are summarized below. **Figure ES-8** shows the recommendations for Greeley to take upon IWRP completion.

- Greeley’s current water supply system is resilient against the most likely near-term conditions, but additional water supplies are required to meet projected demands and to mitigate impacts from warmer climate conditions under current Terry Ranch sustainability criteria.
- With the Terry Ranch Project fully integrated, Greeley’s water supply system is likely resilient against many possible future conditions including warmer climates, higher demands, and reduced yields. Greeley can sustainably utilize the Terry Ranch Project as a water supply source during droughts long-term when the Terry Ranch Project is coupled with some additional water resources.
- Balance implementation of the Terry Ranch Project with other water resources and non-water resources CIP needs to minimize financial risk and maintain affordable water supplies.
- If impacts from climate change are severe and tracking with the hottest projections, Greeley may need to consider additional long-term solutions (i.e., in addition to Terry Ranch).
- The most impactful drivers to Greeley’s water supply system – demand growth and climate change impacts – will have long lead times that Greeley can monitor and adapt to.
- Terry Ranch cannot be confidently timed until Greeley sees sustained, significant demand growth.

Figure ES-7. Summary of IWRP Recommendations Used to Develop 10-year CIP and Adaptive Plan

Recommendation	Action
Change Water Rights	Greeley should continue changing existing water rights to municipal use as these will improve the reliability of the existing water supply system before the Terry Ranch Project is integrated.
Continue Strategic Acquisitions	Greeley should acquire water supplies that can be integrated into the current system and the Terry Ranch Project. These water supplies are required to meet projected demands, mitigate climate, and risk impacts to the current water supply system, and improve Terry Ranch operations.
Develop Priority Terry Ranch Infrastructure	The Terry Ranch Project needs to be efficiently integrated into Greeley’s water supply system once it is required. Greeley should continue incrementally implementing project components (pipelines, right of way, water rights) to ensure this project is readily available to Greeley.
Study Potential Conceptual Retiming Storage Options	The IWRP identified a retiming storage project as a potentially beneficial project to improve the sustainability of Terry Ranch operations. As the IWRP only included a conceptual definition of the project, Greeley should further define this project and align the concept with real facilities.
Implement Adaptive Planning to Monitor Drivers and Trigger Terry Ranch	While the IWRP showed Greeley’s water supply system is resilient against warmer futures and increased demands, it is still vulnerable to significantly stressful future conditions. Additionally, the IWRP could not confidently define when Terry Ranch is required due to uncertainty in demand growth. Greeley should implement an Adaptive Planning process that regularly updates IWRP outcomes and re-evaluates the Terry Ranch timing.





Integrated Water Resource Plan

Final

May 10, 2023

Prepared for:

City of Greeley Water and Sewer
Department

Prepared by:

Stantec Consulting Services, with LRE
Water and Martin and Wood Water
Consultants, Inc.



EXECUTIVE SUMMARY 1

ABBREVIATIONS VII

GLOSSARY VIII

1.0 INTRODUCTION AND SUMMARY OF FINDINGS 1

1.1 OBJECTIVES 1

1.2 SUMMARY OF FINDINGS 2

2.0 PLANNING PROCESS2.1

2.1 INTEGRATED PLANNING OVERVIEW2.1

2.2 PLANNING SCENARIOS AND HORIZONS2.1

2.3 GREELEY SYSTEM MODEL OVERVIEW2.5

2.4 WATER SUPPLY SYSTEM PERFORMANCE METRICS2.6

2.5 INTERNAL AND EXTERNAL COORDINATION2.8

3.0 EXISTING WATER SUPPLY SYSTEM 1

4.0 CURRENT AND PROJECTED WATER DEMANDS4.1

4.1 CURRENT SERVICE AREA4.1

4.2 IWRP PROJECTED DEMANDS4.3

4.2.1 Population Projections4.3

4.2.2 Demand Projections4.5

5.0 RISK IDENTIFICATION AND ASSESSMENT5.1

5.1 METHODOLOGY5.1

5.2 IDENTIFIED WATER SUPPLY SYSTEM RISKS5.2

5.3 WATER SUPPLY SYSTEM RISK ANALYSIS5.11

5.3.1 Comparative Analysis of Risks and Uncertainties5.11

5.3.2 Prioritized Risks for IWRP Inclusion5.14

5.4 RISK INCLUSION IN IWRP5.16

6.0 FUTURE HYDROLOGY ANALYSIS6.1

6.1 METHODOLOGY6.1

6.2 DROUGHT CONDITIONS VARIABILITY RESULTS6.4

6.3 LONG-TERM CLIMATE CHANGE RESULTS6.8

6.3.1 Poudre River System Results6.10

6.3.2 Colorado-Big Thompson Project System Results6.14

6.3.3 Big Thompson River System Results6.15

6.4 CONCLUSION6.17

7.0 TERRY RANCH PROJECT EVALUATION7.1

7.1 OVERVIEW OF TERRY RANCH PROJECT7.1





7.2 SIMULATION IN GSM7.3

7.3 SUSTAINABLE USE7.4

7.4 ADDITIONAL WATER RESOURCES OPPORTUNITIES INCLUDED7.5

8.0 NEAR-TERM 10-YEAR ANALYSIS RESULTS.....8.1

9.0 TERRY RANCH TIMING AND INTEGRATION RESULTS.....9.1

9.1 METHODOLOGY9.1

9.2 TERRY RANCH TIMING RESULTS9.2

9.3 TERRY RANCH INTEGRATION RESULTS9.4

9.4 CONCLUSIONS9.9

10.0 WATER RIGHTS EVALUATION.....10.1

10.1 WATER ACQUISITION DECISION TOOL.....10.1

10.2 WATER ACQUISITION STRATEGY10.3

10.3 WATER ACQUISITION SUMMARY10.5

11.0 10-YEAR CAPITAL IMPROVEMENT PLAN.....11.1

12.0 RECOMENDATIONS AND ADAPTIVE PLAN.....12.1

12.1 IWRP OUTCOMES AND RECOMMENDATIONS12.1

12.2 ADAPTIVE PLAN12.3

 12.2.1 Purpose and Implementation.....12.3

 12.2.2 Adaptive Plan Actions12.3

13.0 REFERENCES AND SUPPORTING DOCUMENTATION.....13.1

13.1 SUPPORTING DOCUMENTATION13.1

13.2 REFERENCES.....13.1

LIST OF TABLES

Table 2-1. Planning Scenarios Defined for the IWRP2.2

Table 2-2. Drivers Used to Define Planning Scenario Conditions2.3

Table 2-3. Planning Scenarios and Conditions Used in the IWRP for Simulations2.4

Table 2-4. Graphical Representation of IWRP Planning Scenarios2.4

Table 2-5. Planning Performance Criteria Used in the IWRP2.7

Table 4-1. Buildout Population and Timing Projections4.4

Table 4-2. IWRP Demand Scenario Settings4.5

Table 4-3. Non-Potable Demand Forecast Assumptions.....4.5

Table 4-4. Greeley’s Demand Projects at 2030, 2050, and 20704.6

Table 5-1. Impact and Likelihood Scores and Definitions Used by Scoring Participants.....5.1

Table 5-2. Identified Climate Change and Hydrology Risks with Corresponding Impact and Likelihood Scores5.3

Table 5-3. Identified Colorado River Basin Issues Risks with Corresponding Impact and Likelihood Scores5.4

Table 5-4. Identified Demand Risks with Corresponding Impact and Likelihood Scores.....5.5





Table 5-5. Identified Infrastructure and Operational Risks with Corresponding Impact and Likelihood Scores5.7

Table 5-6. Identified Water Rights Risks with Corresponding Impact and Likelihood Scores5.9

Table 5-7. List of Prioritized Water Supply Risks for IWRP.....5.15

Table 5-8. Risk Driver Settings for Planning Scenarios5.16

Table 5-9. Methodology for Implementing Prioritized Risks in the IWRP5.17

Table 6-1. Drought Timeseries Selected for the IWRP6.5

Table 6-2. Conclusion Statements of Total System Climate Change Impacts6.9

Table 6-3. Conclusion Statements of Upper Poudre System Climate Change Impacts6.13

Table 6-4. Conclusion Statements of Colorado-Big Thompson System Climate Change Impacts.....6.14

Table 6-5. Conclusion Statements of Big Thompson System Climate Change Impacts6.16

Table 7-1. Summary of Terry Ranch Facility Assumptions used in the GSM.....7.3

Table 8-1. Near-Term Planning Scenario Conditions8.1

Table 8-2. Near-Term Analysis Performance Results.....8.2

Table 9-1. Planning Scenario Settings for Terry Ranch Timing Analysis9.1

Table 9-2. Planning Scenario Settings for Terry Ranch Integration Analysis9.2

Table 9-3. Maximum Demand the Baseline System Meets while Maintaining Planning Performance Criteria for each Planning Scenario9.3

Table 9-4. Tabular Summary of Terry Ranch Integration Results.....9.5

Table 7-1. Water Right Classification Strategies and Criteria in Water Acquisition Decision Tool.....10.2

Table 7-2. Evaluation Criteria and Categories in Water Acquisition Decision Tool10.3

Table 11-1. List of Water Resources CIP Project Costs and Details.....11.4

Table 12-1. Summary of IWRP Recommendations Used to Develop 10-year CIP and Adaptive Plan12.2

Table 12-2. Examples of Qualitative and Quantitative Indicators to Establish System Health12.7

LIST OF FIGURES

Figure 1-1. IWRP Objectives aligned with Greeley’s City Council Priorities..... 1

Figure 2-1. Planning Horizons Used in the IWRP2.2

Figure 2-2. Configuration of Greeley’s IWRP Modeling System.....2.6

Figure 2-3. Implementation of Greeley’s Drought Response Policy in the GSM2.7

Figure 3-1. Map of Greeley’s Current Water Supply System 3

Figure 4-1. The City of Greeley’s City Limits and Long-Range Expected Growth Area.....4.2

Figure 4-2. Observed Greeley Potable and Non-Potable Demands with Historical Population. The left axis corresponds to the bars and the right axis to the line.4.3

Figure 4-3. Greeley’s 2020 and Projected Populations at 2050 and 20704.4

Figure 4-4. Greeley’s Demand Projects at 2030, 2050, and 20704.6

Figure 4-5. Comparison of Greeley’s Demand Growth Between 2030 and 2070.....4.7

Figure 5-1. Overall Likelihood and Impact Criteria used to Prioritize Risks.....5.11

Figure 5-2. Average Impact and Likelihood Scores for Water Supply Risks5.12

Figure 5-3. Variability in individual impact and likelihood scores for Climate Change Hydrology, Colorado River Basin Issues, and Demand Risks5.13





Figure 5-4. Variability in individual impact and likelihood scores for Infrastructure and Operations and Water Rights Risks5.14

Figure 6-1. Summary of Climate Change Hydrology Dataset Development6.2

Figure 6-2. Projected Changes in Temperature and Precipitation Means in the Upper Poudre Watershed between 2050 and 20746.3

Figure 6-3. Conceptual Visual of Why Agricultural Demands Were Shifted for the IWRP6.4

Figure 6-4. Annual Entitlements Timeseries of Historical and Synthetic Sequence 636.5

Figure 6-5. Distribution of Annual Entitlements for Historical and Synthetic Hydrology6.6

Figure 6-6. Distribution of 5-year and 10-year Mean Annual Entitlements for Historical and Synthetic Hydrology6.7

Figure 6-7. Example of Temperature and Precipitation Offset Results Presentation Grid6.8

Figure 6-8. Average Annual Total Water System Entitlements Incorporating Climate Change Impacts6.9

Figure 6-9. Distribution of Greeley's Typical Entitlements by Major System6.10

Figure 6-10. Average Annual Upper Poudre System Entitlements Incorporating Climate Change Impacts6.11

Figure 6-11. Average Annual Upper Poudre Subsystems' Entitlements Incorporating Climate Change Impacts.....6.11

Figure 6-12. Average Annual Upper Poudre Subsystems' Entitlements Incorporating Climate Change Impacts (Continued)6.12

Figure 6-13. Average Annual Lower Poudre System Entitlements Incorporating Climate Change Impacts6.13

Figure 6-14. Average Annual Colorado-Big Thompson System Entitlements Incorporating Climate Change Impacts6.14

Figure 6-15. Average Annual Big Thompson System Entitlements Incorporating Climate Change Impacts6.15

Figure 6-16. Average Annual Big Thompson Subsystems' Entitlements Incorporating Climate Change Impacts.....6.16

Figure 7-1. Terry Ranch Project Map. North is oriented on the right side of the map.....7.2

Figure 8-1. April 1 Storage Under No Climate Change Planning Scenario with Current Water Rights.....8.2

Figure 8-2. April 1 Total System Storage Under Continued Trends Planning Scenario Comparing Current and Baseline Water Rights8.3

Figure 9-1. Conceptual example of timing the Terry Ranch Project showing how demands (green shaded area/dashed line) could grow while the water the supply system provides could decrease (grey and yellow line)9.4

Figure 9-2. Met Demand Source Under Continued Trends Planning Scenario for Timeseries 63. Dashed line is annual demand under Level 2 watering restrictions.9.7

Figure 9-3. Terry Ranch Injection/Extraction Timeseries Under Continued Trends Planning Scenario for Timeseries 63. Left axis corresponds to bar chart and right axis corresponds to line plot.....9.7

Figure 9-4. Use of Native Terry Ranch Aquifer by Retiming Storage and Additional Water Rights Combinations Under Continued Trends Planning Scenario for Timeseries 639.8

Figure 11-1. Water Resources 10-Year CIP Costs by Project Category11.3





Figure 12-1. Conceptual example of timing the Terry Ranch Project showing how demands (green shaded area/dashed line) could grow while the water the supply system provides could decrease (grey and yellow line)12.5

Figure 12-2. Historical Annual Total Demands and Year-to-Year Change.....12.6

Figure 12-3. Example of how the Health of Greeley’s Water Supply Systems will be Described12.7

Figure 12-4. Example of 5-year Terry Ranch Implementation Plan12.8

Figure 12-5. Example of How Greeley’s Current Water Rights Portfolio is Characterized.....12.9

LIST OF APPENDICES

APPENDIX A WATER RESOURCES 10-YEAR CAPITAL IMPROVEMENT PLAN A.1

APPENDIX B DEMAND FORECAST TECHNICAL MEMORANDUM..... B.1

APPENDIX C IWRP GREELEY SYSTEM MODEL DOCUMENTATION TECHNICAL MEMORANDUM..... C.1





EXECUTIVE SUMMARY

The Integrated Water Resources Plan (IWRP) for the City of Greeley Water and Sewer Department (Greeley) is a long-term strategic water resources master plan that ensures sustainable and affordable water supplies for their customers now and into the future. This comprehensive plan integrates Greeley’s water supply system and projected demands with possible future conditions around hydrology, climate change, and risks to Greeley’s water supply system. The IWRP establishes a plan for triggering the Terry Ranch Project (a new aquifer storage and recovery project), a process for evaluating and strategically acquiring water rights, a 10-year Capital Improvement Plan (CIP), and an Adaptive Plan for Greeley to follow.

INTRODUCTION AND PROCESS

Historically, many water resource planning efforts focused on developing a firm yield based on a single set of historical conditions. Projects were selected and prioritized based solely on their ability to improve firm yield under this one set of conditions. Recent events have shown that future conditions are highly uncertain and planning for a single future increases the risk of water supply failure. Greeley, building off a history of effective and prudent planning efforts, elected to complete an integrated planning process for this IWRP to better plan for an increasingly uncertain future.

In implementing an integrated planning process, the IWRP developed “Planning Scenarios” that capture a range of possible future conditions for Greeley’s water supply system. These were applied at key points in time (e.g., “Planning Horizons”) for Greeley’s water supply system. **Figure ES-1** shows the three IWRP Planning Horizons – the first defined what water resources projects are required in the next 10 years, the second identifies when to integrate the Terry Ranch Project, and the third established how to best use the Terry Ranch Project once fully integrated and if that use is sustainable.

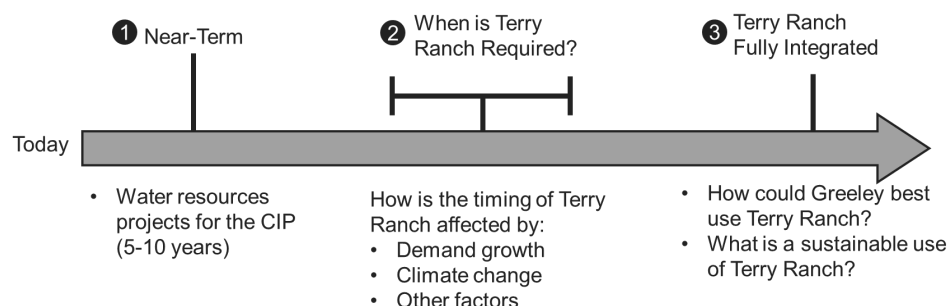


Figure ES-1. Planning Horizons Used in the IWRP

Due to the significant uncertainty around what the future could look like, the IWRP did not predict what future condition is most likely to occur. Instead, a Planning Scenario methodology was applied that captures a range of possible future conditions for Greeley’s water supply system. The Planning Scenarios and their associated conditions are shown graphically in **Figure ES-2**. The *Unbearable* Planning Scenario





was the reasonable high-bookend for Greeley’s water supply system and combines the hottest climate, the highest demand projections, and significant risk impacts. The *Stressed* Planning Scenario assumes the hottest climate, a lower demand projection, and moderate risk impacts. The *Continued Trends* Planning Scenario assumes a warmer climate, continued decreases in per capita water use, and moderate risk impacts. The *Optimistic* scenario assumes a warmer climate, the lowest demand projections, and least risk impacts. Finally, the *No Climate Change* planning scenario includes no climate change, a higher demand projection than *Optimistic* as the lack of climate change would likely encourage higher Greeley growth, and low risk impacts.

Figure ES-2. Planning Scenarios used in the IWRP

Planning Scenario Name	Climate Warming	CO River Basin Risk Impacts	Water Supply System Yields	Demands
Unbearable		High		
Stressed		Moderate		
Continued Trends		Moderate		
Optimistic		Low		
No Climate Change		Low		

An important element in the IWRP was defining when future water supply system performance was acceptable, which the IWRP set using ‘planning performance criteria’. **Figure ES-3** presents the planning performance criteria and their acceptability definitions.

Figure ES-3. Planning Performance Criteria Used in the IWRP

Performance Criteria	Acceptable Performance
Are Greeley customers being significantly impacted?	Drought Restrictions used at any level no more than 20% of years and no more than 10% of years in Level 3
Greeley maintains sufficient emergency reserve.	April 1 storage volume has at least 6 months of indoor demands in 100% of years
Greeley meets critical water needs for public health.	Indoor demands are met 100% of the time.





FUTURE CONDITIONS ASSESSMENT

The IWRP completed a risk assessment that identified, prioritized, and evaluated a comprehensive list of events that could impact Greeley’s water supply system. This assessment identified four risk “drivers”, defined as major events or conditions that are outside Greeley’s control that could impact their ability to provide sustainable water supply to their customers. The drivers identified for the IWRP were:

- The **Climate Change Impacts on Hydrology** driver captures risks that could change what Greeley’s existing water rights yield and the timing of that yield compared to what has been experienced historically. This is due to a combination of droughts of increased intensity, duration, and/or frequency compared to the historical record, runoff impacts, and the overall hydrograph from a warmer climate.
- The **Future Demand Uncertainty** driver captures risks that affect how much water demand Greeley’s system would need to meet in the future and how water is used compared to historical usage. This includes population growth, outdoor water use variability, and climate change impacts to demands.
- The **Water Rights Administration Complexity and Uncertainty** driver captures risks that affect Greeley’s ability to change currently owned water rights, acquire new water rights, and yields from existing and future water rights. This includes increased competition for new water rights, the legal complexity of changing water rights, and uncertainty related to how water rights administration may change under a different hydrograph than historical.
- The **Colorado River Basin Issues** driver captures risks to Greeley’s yields from the Colorado River Basin which could result in a variety of short- and long-term supply reductions or curtailments.

The *Climate Change Impacts on Hydrology* driver was further evaluated by developing new climate change hydrology that captures the potential impacts of long-term climate change and droughts of increasing intensity, duration, and frequency. An advanced modeling process was completed that quantified the impacts of long-term changes in temperature and precipitation to Greeley’s entitlements (e.g., water legally and physically available to Greeley). **Figure ES-4** summarizes the conclusions from this analysis and the confidence of those conclusions.

Figure ES-4. Conclusions from the Climate Change Hydrology Analysis

Conclusion Statement	Confidence	Comment
Droughts of greater duration, frequency, and severity than observed droughts are possible under current climate.	High	<i>Results show these conclusions are consistent with other studies and make logical sense.</i>
Climates with less precipitation and or warmer climates will decrease Greeley’s water supply system yields.	High	
Yields from Greeley’s junior water rights and certain water supply systems could be vulnerable to changing agricultural demands.	Moderate	<i>It is likely that agricultural demand changes will impact Greeley’s entitlements. It is unknown how agricultural demands will change.</i>
Climates with increased precipitation could increase Greeley’s water supply system yields.	Low	<i>Impacts from hydrograph changes cannot be confidently modeled with existing tools.</i>





The *Future Demand Uncertainty* driver was further evaluated by developing new total demand projections (potable and non-potable) for Greeley at 2030, 2050, and 2070 under four demand scenarios. These four scenarios varied population growth, the extent to which irrigation increases in response to hotter and drier future climate conditions, the extent of future conservation, and the proportion of new housing units that are multifamily apartments and condominiums. **Figure ES-5** shows the new demand projections.

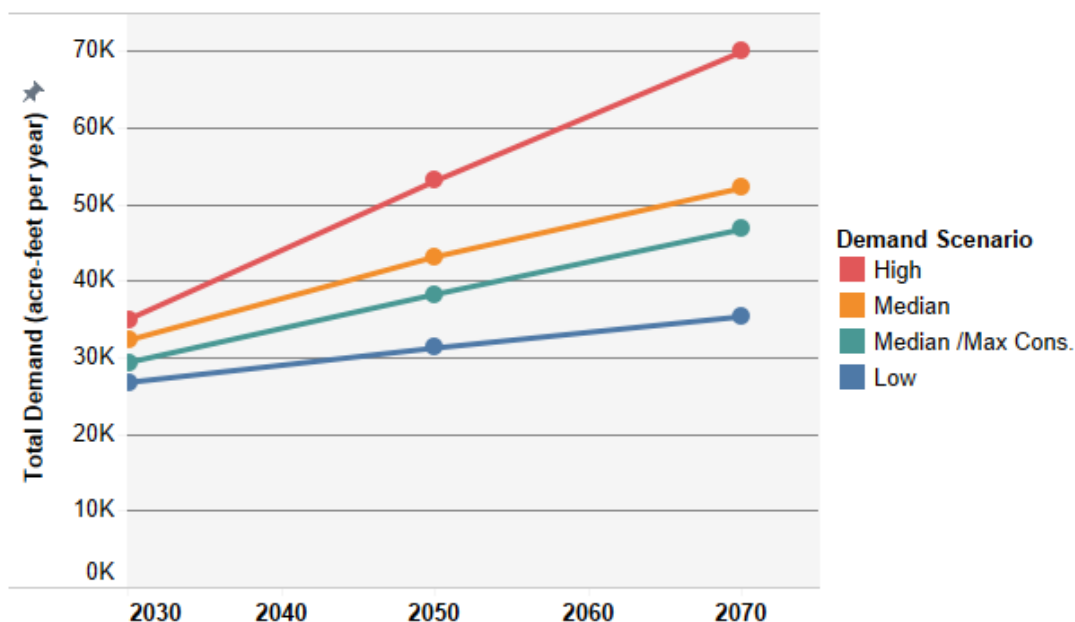


Figure ES-5. Greeley’s Projected Future Water Demands

These demand projections are highly variable between the scenarios, with the difference between the high and low scenario increasing from 8,200 acre-feet per year at 2030 (33% of current demands) to 34,600 acre-feet per year at 2070 (137% of current demands). These demand projections assumed demand growth occurs immediately. However, Greeley’s total demands have not grown significantly over the last 10 years.





TERRY RANCH TIMING AND INTEGRATION EVALUATION

The *Terry Ranch Timing* analysis determined that Greeley’s water supply system without Terry Ranch can meet near-term Planning Scenario conditions. For example, in the *Continued Trends* Planning Scenario, Greeley’s system without the Terry Ranch Project can accommodate an additional 10,000 acre-feet per year of demand growth – approximately 40% more demand than current. The IWRP could not confidently time the Terry Ranch Project implementation due to the lack of recent demand growth and the significant variability of future demand projections. In-lieu of assigning a timetable to Terry Ranch Project implementation, Greeley will monitor demands and water supplies as part of the Adaptive Plan.

The *Terry Ranch Integration* analysis determined if Terry Ranch operations would be sustainable long-term under the different Planning Scenarios. The IWRP defined Terry Ranch operations as sustainable if it can deliver sufficient supplies during drought to minimize drought restrictions while maintaining at least 80% of the 1.2 million acre-foot initial aquifer storage volume long-term. **Figure ES-7** shows the results of the Terry Ranch Integration Analysis by Planning Scenario. This table indicates what (if any) additional water resources were included, the percent of years Greeley drought response actions were used, the average annual Terry Ranch “Delta” (average injection minus average extraction), and the percent of the native aquifer remaining at the end of an 86-year simulation period.

Results from the *Terry Ranch Integration* analysis show that the Terry Ranch Project can be operated sustainably in the *Continued Trends*, *Optimistic*, and *No Climate Change* Planning Scenarios. Sustainable operation in these Planning Scenarios will require some additional water supplies and retiming storage. Results from the *Unbearable* and *Stressed* Planning Scenarios show that under the hottest climate change projections and significant demand growth conditions, Terry Ranch Operations are not sustainable. Greeley can monitor climate and demand growth conditions as part of the Adaptive Plan and, if the most impactful future conditions emerge, can adjust the long-term water supply strategy.

Figure ES-6. Tabular Summary of Terry Ranch Integration Results

Planning Scenario	Additional Water Resources	% Years with Drought Response	Annual Terry Ranch Delta (acre-feet per year)	Ending Aquifer Volume (% of 1.2 million acre-foot Volume)
Unbearable	Retiming Storage + Moderate Water Acquisitions	100%	-10,700	23%
Stressed	Retiming Storage + Moderate Water Acquisitions	64%	-6,500	53%
Continued Trends	Retiming Storage + Moderate Water Rights	35%	-1,200	91%
Optimistic	None	12%	+1,900	113%
No Climate Change	Retiming Storage + Low Water Acquisitions	36%	-1,900	86%

Color Key Indicates Terry Ranch Sustainability Criteria: **Blue** has sufficient remaining aquifer storage percentage, **Orange** has insufficient remaining aquifer storage percentage





IWRP OUTCOMES AND RECOMMENDATIONS

The IWRP showed that Greeley is well-positioned to provide sustainable and affordable water supplies through an uncertain future. The IWRP’s important outcomes and conclusions regarding Greeley’s current, near-term, and long-term water supply system are summarized below. **Figure ES-8** shows the recommendations for Greeley to take upon IWRP completion.

- Greeley’s current water supply system is resilient against the most likely near-term conditions, but additional water supplies are required to meet projected demands and to mitigate impacts from warmer climate conditions under current Terry Ranch sustainability criteria.
- With the Terry Ranch Project fully integrated, Greeley’s water supply system is likely resilient against many possible future conditions including warmer climates, higher demands, and reduced yields. Greeley can sustainably utilize the Terry Ranch Project as a water supply source during droughts long-term when the Terry Ranch Project is coupled with some additional water resources.
- Balance implementation of the Terry Ranch Project with other water resources and non-water resources CIP needs to minimize financial risk and maintain affordable water supplies.
- If impacts from climate change are severe and tracking with the hottest projections, Greeley may need to consider additional long-term solutions (i.e., in addition to Terry Ranch).
- The most impactful drivers to Greeley’s water supply system – demand growth and climate change impacts – will have long lead times that Greeley can monitor and adapt to.
- Terry Ranch cannot be confidently timed until Greeley sees sustained, significant demand growth.

Figure ES-7. Summary of IWRP Recommendations Used to Develop 10-year CIP and Adaptive Plan

Recommendation	Action
Change Water Rights	Greeley should continue changing existing water rights to municipal use as these will improve the reliability of the existing water supply system before the Terry Ranch Project is integrated.
Continue Strategic Acquisitions	Greeley should acquire water supplies that can be integrated into the current system and the Terry Ranch Project. These water supplies are required to meet projected demands, mitigate climate, and risk impacts to the current water supply system, and improve Terry Ranch operations.
Develop Priority Terry Ranch Infrastructure	The Terry Ranch Project needs to be efficiently integrated into Greeley’s water supply system once it is required. Greeley should continue incrementally implementing project components (pipelines, right of way, water rights) to ensure this project is readily available to Greeley.
Study Potential Conceptual Retiming Storage Options	The IWRP identified a retiming storage project as a potentially beneficial project to improve the sustainability of Terry Ranch operations. As the IWRP only included a conceptual definition of the project, Greeley should further define this project and align the concept with real facilities.
Implement Adaptive Planning to Monitor Drivers and Trigger Terry Ranch	While the IWRP showed Greeley’s water supply system is resilient against warmer futures and increased demands, it is still vulnerable to significantly stressful future conditions. Additionally, the IWRP could not confidently define when Terry Ranch is required due to uncertainty in demand growth. Greeley should implement an Adaptive Planning process that regularly updates IWRP outcomes and re-evaluates the Terry Ranch timing.





ABBREVIATIONS

Bellvue WTP	Bellvue Water Treatment Plant
Boyd WTP	Boyd Lake Water Treatment Plant
BTBN	Big Thompson Basin Network
CBT	Colorado-Big Thompson Project
CIP	Capital Improvement Plan
City	City of Greeley
DMS	Data Management System
Ft. Collins	City of Fort Collins Utilities
GCMs	Global Climate Models
GLIC	Greeley-Loveland Irrigation Company
Greeley	City of Greeley Water and Sewer Department
GSM	Greeley System Model
HMRs	High Mountain Reservoirs
IWRP	Integrated Water Resources Plan
Loveland	City of Loveland
LREGA	Long Range Expected Growth Area
NA	Not Applicable
Northern Water	Northern Water Conservancy District
PBN	Poudre Basin Network
Poudre	Cache la Poudre
PVP	Pleasant Valley Pipeline
SMEs	Subject Matter Experts
T&P	Temperature and Precipitation
TBD	To be determined
Terry Ranch	Terry Ranch Aquifer and Storage Recovery Project
TM	Technical Memorandum
W&S Board	Greeley’s Water and Sewer Board
WADT	Water Acquisition Decision Tool
WSSC	Water Supply & Storage Company
WSVS	Water Supply Vulnerability Study
YOD	Years of Demand



GLOSSARY

Baseline	Greeley’s water supply conditions that are expected to exist in the near-term regardless of IWRP outcome
Box plot distribution	A standardized way of displaying the distribution of data where the solid line is the median value with the boxes extending to the 25 th and 75 th percentiles and the whiskers extending to the 5 th and 95 th percentile
Direct flow rights	A water right that diverts water directly from a surface stream for direct application to beneficial use
Entitlements	Water legally and physically available to Greeley
Interruptible Supply Use	A water right that can be used for its original decreed purpose and then can be intermittently used for a changed purpose
Native storage	The volume of water in the Terry Ranch Aquifer prior to injection or extraction
Non-potable water	Water that is not of a quality suitable for drinking, but can be used for other purposes such as irrigation
Planning Horizon	Represents key points in time for Greeley’s water supply system
Planning Performance Criteria	Define when future water supply system performance was acceptable
Planning Scenario	Captures a range of possible future conditions for Greeley’s water supply system summarized into a single narrative future
Potable water	Water that is of a quality suitable for drinking
Risk	Event or condition that could negatively effect Greeley’s water supply system
Single-use water	A water right that can only be diverted and used for beneficial purposes once. The water cannot be re-diverted or re-used after the initial use
Spill	Water entitled to Greeley that cannot be captured or put to use in the surface water system
Storage shortage	If Greeley’s surface water storage on April 1 st of the next year would be less than the acceptable threshold
T&P Offset/Change	Change in long-term temperature and precipitation mean in a future climate compared to the historical climate.
Wholly consumable transbasin rights	A water right that is diverted in one river basin and used in another river basin for beneficial use. Transbasin water rights are 100% consumptive and can be re-used to extinction



1.0 INTRODUCTION AND SUMMARY OF FINDINGS

The Integrated Water Resources Plan (IWRP) for the City of Greeley Water and Sewer Department (Greeley) is a long-term strategic water resources master plan for Greeley that ensures sustainable and affordable water supplies for their customers. This comprehensive plan integrates Greeley’s water supply system and projected demands with possible future conditions around hydrology, climate change, and risks to Greeley’s water supply system. The IWRP establishes a plan for triggering the Terry Ranch Aquifer and Storage Recovery Project (Terry Ranch Project or Terry Ranch), a process for evaluating and strategically acquiring water rights, a 10-year Capital Improvement Plan (CIP), and an Adaptive Plan for Greeley to follow.

This Report documents the process, assumptions, outcomes and recommendations of Greeley’s IWRP.

1.1 OBJECTIVES

The IWRP objectives were developed to align with priorities established by Greeley’s City Council, shown in **Figure 1-1**. The IWRP is an actionable and adaptive master plan for Greeley’s water resources that uses modern, defensible methods to develop a roadmap ensuring a sustainable water supply for the community through an uncertain future.

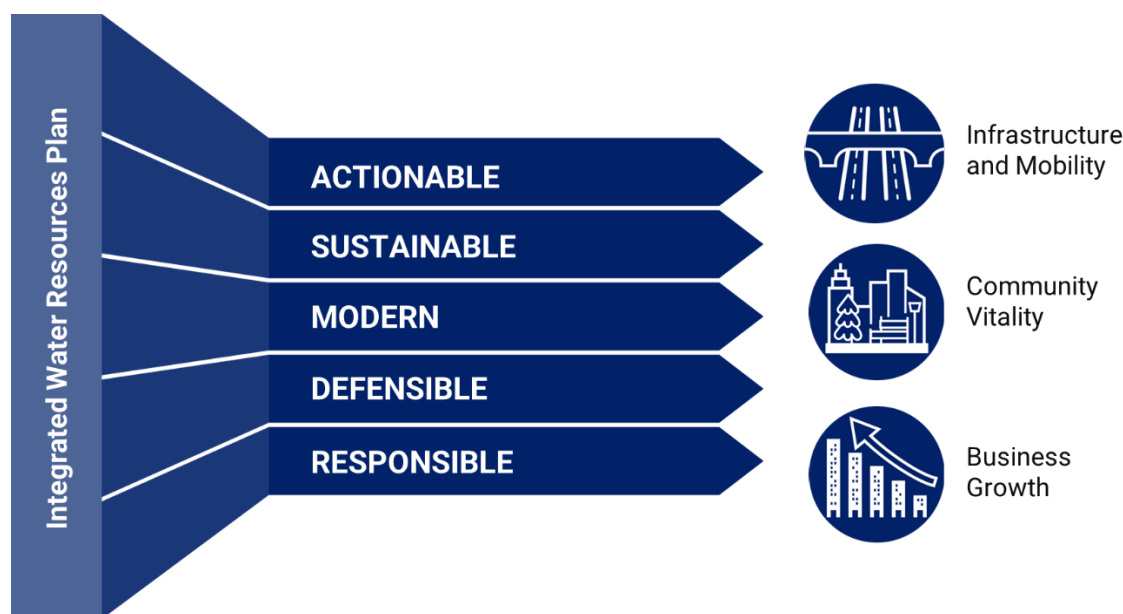


Figure 1-1. IWRP Objectives aligned with Greeley’s City Council Priorities





In addition to the overall future water resources strategy, the IWRP was tasked with developing the following new tools and plans for Greeley to utilize in future planning efforts:

- Updated Demand Projections
- Climate Change-Influenced Hydrology Dataset
- Risk Assessment
- Water Acquisition Decision Tool
- Water Acquisition Strategy
- 10-year Capital Improvement Plan
- Adaptive Plan
- Updated Greeley System Model with new Terry Ranch Project operations and Planning Scenarios

1.2 SUMMARY OF FINDINGS

At the outset of the IWRP, the following key questions were presented. The resulting analysis documented in this Report supports the answer for each question.

Can Greeley’s current water supply system reliably deliver water supplies to customers?

- The near-term, 10-year, analysis presented in Section 8 shows that Greeley’s water supply system can meet current water demands across a range of projected warmer climates and even when considering current Colorado River Basin risks. The robustness of Greeley’s water supply system is further improved as water rights that Greeley already owns are changed for municipal use.

What is Greeley’s future water rights strategy?

- The Terry Ranch Timing results presented in Section 9.2 show that Greeley needs additional water rights to meet projected demands and mitigate impacts to the current water supply system. The Terry Ranch Integration results presented in Section 9.3 show that additional water rights that can be integrated into the Terry Ranch Project will improve the sustainability of that project in warmer climates with higher demands. Greeley will prioritize water rights that provide immediate water supply to the city and can be integrated into the Terry Ranch Project in the future. Due to the increasing cost and competition of water acquisitions, Greeley will continue to actively acquire new water rights as part of the 10-year CIP.

Will the Terry Ranch Project be a sustainable water supply source in the future?

- The Terry Ranch Integration results presented in Section 9.3 show that the Terry Ranch Project can provide a sustainable drought-resistant supply source for Greeley. This includes future conditions with warmer climates, higher demands, and impacts from water supply system risks.

When is Terry Ranch Required?

- The Terry Ranch Timing results presented in Section 9.2 show that the Terry Ranch Project is not imminently required due to the robust nature of Greeley’s current water supply system and the effectiveness of conservation strategies. As time progresses, Greeley will closely monitor demand



INTEGRATED WATER RESOURCE PLAN

Introduction and Summary of Findings



and supply conditions to ensure the Terry Ranch Project is online before it is required. However Greeley will complete high-priority Terry Ranch Project infrastructure as part of the 10-year CIP to make use of funding and land availability.

How can Greeley ensure their water supply system continues to provide sustainable and affordable water to their customers?

- The IWRP developed a variety of tools and plans for Greeley to use in future planning efforts. A key one is the Adaptive Plan presented in Section 12.2, which defines five actions Greeley will take each year to re-evaluate IWRP outcomes and recommendations and adjust accordingly.



2.0 PLANNING PROCESS

2.1 INTEGRATED PLANNING OVERVIEW

Historically, many water resource planning efforts focused on developing a firm yield based on a single set of historical conditions. Projects were selected and prioritized based solely on their ability to improve firm yield under this one set of conditions. This process was effective for many years, due to the relative stationarity of climate and limitations in computing and data processing. Recent history and availability of new climate modeling data has shown that future conditions are highly uncertain and planning for a single future increases the risk of water supply failure. During this time, new approaches were developed that utilized improved computing to integrate many possible future conditions into water supply planning. This new approach creates a long-term plan that is more robust and adaptive against future uncertainty and helps to ensure that communities have sustainable and affordable water supplies.

Greeley has a history of effective and prudent planning efforts, resulting in a water supply system that has been more resilient during droughts than most other communities in Colorado. Greeley has invested in tools, such as the Greeley System Model (GSM), and projects, such as the Terry Ranch Project, that built a solid foundation for future planning efforts. Leveraging those decisions, Greeley elected to complete an integrated planning process for this IWRP. This integrated plan used modern, data-driven methods to develop a robust roadmap to help guide Greeley through an uncertain future.

2.2 PLANNING SCENARIOS AND HORIZONS

To implement an integrated planning process while focusing the IWRP analysis around its objectives, a set of 'Planning Horizons' were defined that represent key points in time for Greeley's water supply system. In combination with these Planning Horizons, a set of 'Planning Scenarios' were developed to capture a range of possible future conditions for Greeley's water supply system.

Figure 2-1 shows the three IWRP Planning Horizons. The first planning horizon represents near-term conditions and established what water resources projects are required in the next 10 years. The second planning horizon represents conditions just before the Terry Ranch Project would be required and informed what those conditions would be. The third and final planning horizon is when the Terry Ranch Project is fully integrated with Greeley's water supply system and established how the project could be used and if that use is sustainable. Section 8 presents the results of the near-term planning horizon and Section 9 presents the results of the Terry Ranch timing and integration planning horizons.



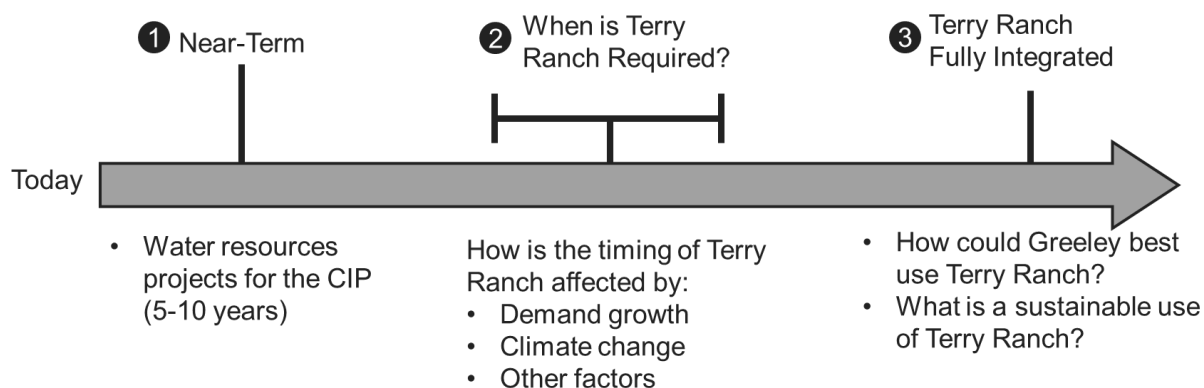


Figure 2-1. Planning Horizons Used in the IWRP

Due to the significant uncertainty around what the future could look like, the IWRP did not predict what future condition is likely to occur. Instead, a Planning Scenario methodology was applied that captures a range of possible future conditions for Greeley’s water supply system. The GSM is simulated under these various possible future conditions, and results are holistically evaluated to inform the IWRP outcomes and recommendations. **Table 2-1** presents the five Planning Scenarios defined for the IWRP. A *No Climate Change* Planning Scenario was included to both serve as a low bookend of stressful future conditions and to establish the impact of climate change to Greeley by defining what could be required if climate change impacts are properly mitigated in the future.

Table 2-1. Planning Scenarios Defined for the IWRP

Planning Scenario	Description
Unbearable	Greeley’s future demands have tracked with the most impactful future conditions: population has grown according to the highest forecast, climate has warmed rapidly, and impacts to Greeley’s East Slope water rights and Colorado River supplies are the most severe.
Stressed	A rapidly warming climate and faster-than-expected population growth within established water providers such as Greeley exacerbates water availability issues. Greeley’s water supply system must meet this increased demand amongst significant yield impacts.
Continued Trends	Recent trends in per capita water use, climate change, Colorado River basin issues, and competition for water rights continue.
Optimistic	Greeley’s water supply system is less stressed than anticipated due to a combination of improved water conservation savings, diminished climate change impacts, and advantageous water rights yields.
No Climate Change	Without climate change, Greeley’s water supply system would be less stressed and require less additional water resources.





The narrative Planning Scenarios were translated to future conditions Greeley’s water supply system could experience for simulation in the GSM. These future conditions were the key drivers of future uncertainty identified during the Risk Identification and Assessment process described in Section 5. Each driver had specific possible future conditions that could then be varied in each Planning Scenario. **Table 2-2** presents the drivers and associated conditions available for the Planning Scenarios.

Table 2-2. Drivers Used to Define Planning Scenario Conditions

Driver	Description	Planning Scenario Settings
Future Climate Change	Captures the impacts to hydrology from the assumed future climate change.	<ul style="list-style-type: none"> Hot (+8°F or +5°F) Warm (+5°F or +2°F) No Change
Colorado River Basin Risk Impacts	Combination of short- and long-term Colorado River Basin yield reductions and curtailments due to Colorado River Basin administration and Compact compliance.	<p><u>High Impacts to Yields</u></p> <ul style="list-style-type: none"> 5-year 25% Reduction in CBT/Windy Gap 1-year 100% Curtailment of CBT/Windy Gap Chronic 10% Reduction in CBT/Windy Gap <p><u>Moderate Impacts to Yields</u></p> <ul style="list-style-type: none"> 5-year 25% Reduction in CBT/Windy Gap 1-year 100% Curtailment of CBT/Windy Gap <p><u>Low Impacts to Yields</u></p> <ul style="list-style-type: none"> 2-year 25% Reduction in CBT/Windy Gap
Water Rights Administration Uncertainty and Increased Competition	Reductions in modeled water rights yield due to combination of inability to change water rights as assumed, ability to acquire new water rights, and/or reductions in yield due to administration changes.	<ul style="list-style-type: none"> 10% Entitlement Reduction No Entitlement Reduction
Water Demands	The future demand projection from Section 4.2.2 is assumed to occur.	<ul style="list-style-type: none"> High Bookend Median Median with Maximum Conservation Low Bookend

CBT is Colorado-Big Thompson Project

The Planning Scenarios with their conditions identified and used in the IWRP are shown in detail in **Table 2-3** and shown graphically in **Table 2-4**. The *Unbearable* Planning Scenario was the reasonable high bookend for Greeley’s water supply system and combines the hottest climate, with the highest demand projections and significant impacts. The *Stressed* Planning Scenario assumes the hottest climate but with a lower demand projection and moderate risk impacts to water supplies. The *Continued Trends* Planning Scenario assumes a warmer climate, continued decreases in per capita water use, and moderate risk impacts to water supplies. The *Optimistic* scenario assumes a warmer climate, the lowest demand projections, and less entitlement impacts. Finally, the *No Climate Change* planning scenario includes a higher demand projection than *Optimistic* as the lack of climate change would likely encourage higher Greeley growth.





Table 2-3. Planning Scenarios and Conditions Used in the IWRP for Simulations

Planning Scenario Name	Climate	CO River Basin Risks	Water Rights Administration Impacts	Demands
Unbearable	Hot	<u>High Impacts:</u> 5-Year 25% Reduction 1-year Outage Chronic 10% Reduction	10% Reduced Entitlements	High Bookend
Stressed	Hot	<u>Moderate Impacts:</u> 5-Year 25% Reduction 1-year Outage	10% Reduced Entitlements	Median
Continued Trends	Warm	<u>Moderate Impacts:</u> 5-Year 25% Reduction 1-year Outage	10% Reduced Entitlements	Median w/ Decreased Per Capita Use
Optimistic	Warm	<u>Low Impacts:</u> 2-year 25% Reduction	Expected Entitlements	Low Bookend
No Climate Change	No Change	<u>Low Impacts:</u> 2-year 25% Reduction	Expected Entitlements	Median w/ Decreased Per Capita Use

Table 2-4. Graphical Representation of IWRP Planning Scenarios

Planning Scenario Name	Climate Warming	CO River Basin Risk Impacts	Water Supply System Yields	Demands
Unbearable		High		
Stressed		Moderate		
Continued Trends		Moderate		
Optimistic		Low		
No Climate Change		Low		



2.3 GREELEY SYSTEM MODEL OVERVIEW

An important objective to the IWRP and a key component of an integrated planning process is using data-driven methods that transparently and clearly connect to outcomes and recommendations. For the IWRP, Greeley utilized their existing GSM to complete numerical water supply system simulations. This section summarizes the GSM and its application for the IWRP, which is described in detail in the IWRP Greeley System Model Technical Memorandum (TM), included as Appendix C.

The GSM is a MODSIM-based mass-balance model originally developed in 1992 that has been continuously upgraded and updated (Greeley, 2021). The MODSIM simulation software platform has been applied to water supply planning efforts by water providers in Colorado (e.g., Colorado Springs Utilities, City of Fort Collins Utilities). The GSM has served as Greeley's water supply planning simulation model since its inception and, as such, its development and current configuration includes extensive institutional knowledge and expertise. The model was most recently upgraded to the newest version of MODSIM and paired with a Data Management System (DMS) in 2020, prior to the IWRP in 2020, further increasing its value to the IWRP.

The GSM simulates Greeley's water supply system on a monthly timestep for a period of 86 years. The scope of the GSM includes "inflows" of Greeley's legally and physically available water supplies (referred to as "entitlements"), raw water conveyance facilities (in-river, ditches, pipelines), raw water storage facilities (wholly owned reservoirs, storage accounts, gravel pits), raw water treatment plants (physical capacities), and "demands" (potable, non-potable demands, and large industrial). The GSM simulates transit losses, evaporation losses, and treatment process losses. The GSM does not simulate the conveyance of water supplies owned by other entities.

To develop Greeley's entitlements, the GSM utilizes outputs from the Poudre Basin Network (PBN) Model and the Big Thompson Basin Network (BTBN) Model. The PBN and BTBN Models were collaboratively developed by Greeley, the City of Fort Collins Utilities (Ft. Collins), and the Northern Water Conservancy District (Northern Water). The BTBN and PBN are MODSIM-based models that translate natural watershed runoff in the Big Thompson River and Cache la Poudre (Poudre) River Watersheds into entitlements for all water users in the basin. Greeley utilizes an intermediate tool to apply water rights ownership and conditions of ownership to develop "inflow" timeseries for the GSM. Greeley also receives water from Northern Water's Colorado-Big Thompson (CBT) Project, which is developed using Northern Water's CBT Quota model.

As part of the of the model upgrade, a DMS was developed to enhance Greeley's previously developed GSM. **Figure 2-2** shows how the DMS interacts with the GSM and the flow of data and information between them. The DMS is a .NET-based computer program that takes user inputs and automatically generates and completes desired GSM simulations. A key component of the DMS is a Microsoft SQL Server Database that stores input and output data from the GSM and a log of simulations completed with their corresponding assumptions. Data from the DMS can be extracted for analysis and visualization. The IWRP utilized the DMS to complete GSM simulations and IWRP results with their corresponding logs and settings are stored in the SQL Server Database.



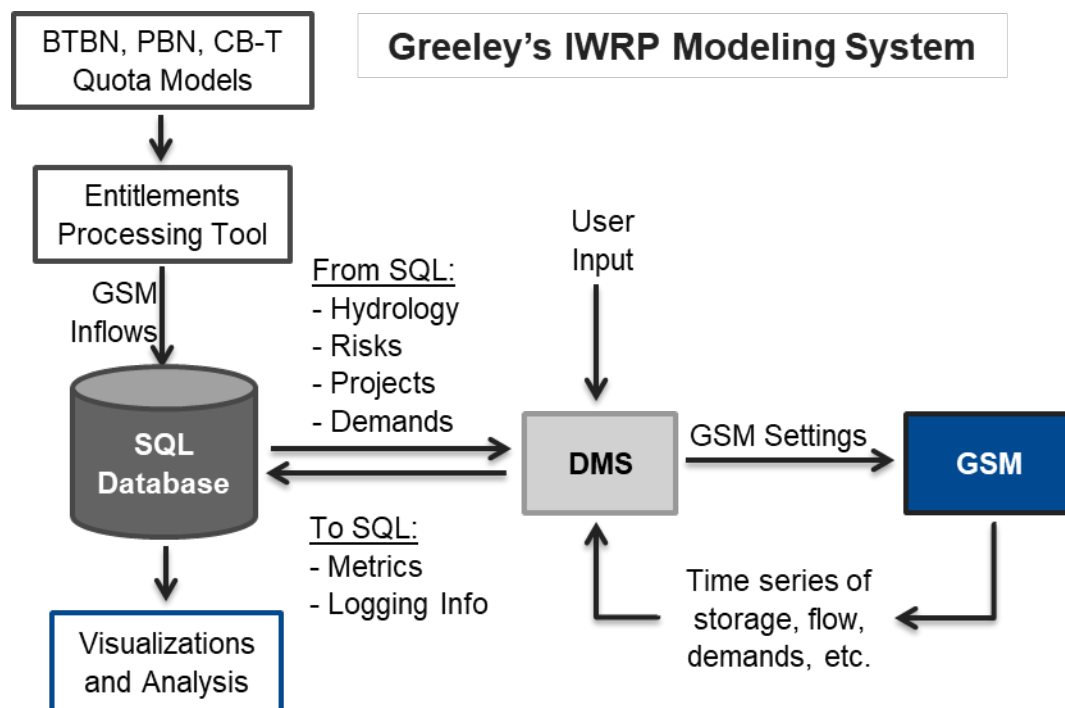


Figure 2-2. Configuration of Greeley's IWRP Modeling System

The IWRP baseline conditions reflect the water supply system that are expected to exist in the near-term regardless of IWRP outcomes. This baseline is different from the current water supply system condition that existed at the time of the IWRP. The baseline condition serves as a common point of comparison as future conditions are changed and evaluated.

Projects assumed to be in the baseline condition included Greeley’s 8,000 acre-foot account in Chimney Hollow, the Equalizer Pipeline, and a winterized Boyd WTP. Of the High Mountain Reservoirs, Barnes and Peterson were assumed online for municipal use and Comanche/Hourglass and Twin were assumed to remain in agriculture. The baseline water rights portfolio assumed that all currently owned water rights are changed for municipal use by Greeley and that nearly all leases are returned for Greeley use. This baseline water rights portfolio assumes that all future changes will yield the same for Greeley as established outcomes.

2.4 WATER SUPPLY SYSTEM PERFORMANCE METRICS

To establish acceptable water supply system performance from results of the GSM simulations, the IWRP developed a set of ‘planning performance criteria’. **Table 2-5** presents the planning performance criteria, the associated GSM metric, and the acceptability threshold used in the IWRP to establish when performance of a GSM simulation was acceptable. The criteria were selected to reflect Greeley’s existing Level of Service. The developed performance criteria and GSM metric are not being proposed in the IWRP as new or updated Level of Service.





Table 2-5. Planning Performance Criteria Used in the IWRP

Performance Criteria	GSM Metric	Planning Acceptability Threshold
Are Greeley customers being significantly impacted?	How often Drought Restrictions levels are used (presented in Figure 2-3).	20% (2 in 10 years) at Any Level 10% (1 in 10 years) at Level 3
Greeley maintains sufficient emergency reserve.	April 1 storage volume always has at least 6 months of indoor demands	100%
Greeley meets critical water needs for public health.	Always meet indoor demands	100%

The use of drought restrictions was included in the planning performance criteria to minimize how often Greeley’s customers are impacted by watering restrictions. Greeley’s current Drought Emergency Plan, updated in 2021, was implemented in the GSM according to the assumptions shown in **Figure 2-1**. On April 1st, the GSM ‘predicts’ the storage on April 1st of the following year by adding total entitlements to the current storage levels and subtracting out demands. For example, if the predicted storage is between 85% and 75% of annual demands, Level 2 restrictions are used. Acceptable performance is 20% of years in any restriction level or 10% of years in Level 3. Restrictions used in greater frequency may not be accepted by the Greeley community (increased bills, dead landscapes) and could lead to permanent changes to landscaping.

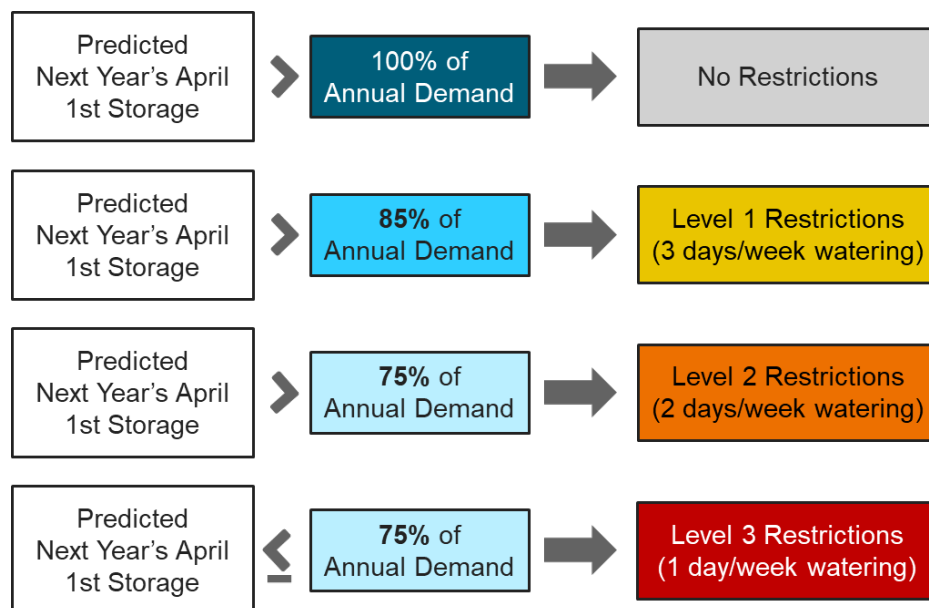


Figure 2-3. Implementation of Greeley’s Drought Response Policy in the GSM

The emergency reserve planning performance metric was included to ensure Greeley has sufficient water supplies in storage in the event of an unplanned outage or natural disaster that severely disrupts the water supply system. Six months of indoor demands were selected as these types of emergency





disruptions could typically be addressed within that time horizon. Note that in calculating the storage volume for this metric, storage locations that cannot physically deliver water to Greeley’s water system were not included.

The final component of the planning performance criteria was that Greeley’s water supply system can always meet indoor demands. This is the critical performance criteria as any impacts to indoor water use could impact public health. As Greeley’s water demands grow, the indoor components of those demands will grow as well.

2.5 INTERNAL AND EXTERNAL COORDINATION

In completing the IWRP, Greeley utilized a cross-disciplinary team of Greeley staff and consultants with close communication with Greeley’s Water and Sewer Board (W&S Board). The IWRP included a Core Team that developed content and guided the overall IWRP process. The Technical Team, consisting of Subject Matter Experts (SMEs) in water rights administration, raw water operations, demand conservation, utility finance, groundwater, and legal reviewed IWRP progress and provided additional guidance and feedback for the IWRP. Finally, the Management Team consisting of Greeley leadership provided final review of IWRP outcomes and recommendations.

An important component of the IWRP was close communication with Greeley’s W&S Board. W&S Board Members are council-appointed to five-year terms with no term limit in providing oversight of the Greeley Water and Sewer Department and making recommendations to Greeley’s City Council for formal approval and adoption. The W&S Board was appointed with the duty, by the 1958 City Charter to “acquire, develop, convey, lease, and protect water and sewer assets, supplies, and facilities.” Because of this unique role, W&S Board members have extensive knowledge of Greeley’s water supply system and history. To leverage this knowledge, progress updates were given to the W&S Board throughout the IWRP process, with monthly updates provided as outcomes and recommendations were developed. Feedback from the W&S board was regularly incorporated into the IWRP development.

The IWRP also developed a new set of materials for communication with Greeley’s customers and the larger public. A public-facing summary of the IWRP was developed and is housed on Greeley’s website.





3.0 EXISTING WATER SUPPLY SYSTEM

Greeley's existing water supply system, shown in **Figure 3-1**, is geographically diverse, obtaining water from four river basins (North Platte, Poudre, the Colorado, and Big Thompson). The system is also flexible and efficient, with multiple locations to store water, utilize existing canals, ditches, and pipelines to deliver water to two treatment plants. Greeley is also in stages of developing infrastructure to utilize the Terry Ranch Project.

Greeley owns two water treatment plants, the Bellvue Water Treatment Plant (Bellvue WTP) and the Boyd Lake Water Treatment Plant (Boyd WTP). The Bellvue WTP is located near the mouth of the Cache La Poudre Canyon and the Boyd WTP is located south of Boyd Lake within the corporate limits of the City of Loveland (Loveland). The Bellvue WTP receives water from Greeley's diversion from the Greeley Filters Pipeline on the mainstem of the Poudre as well as from Horsetooth Reservoir through the Hansen Supply Canal during the summer and the Pleasant Valley Pipeline (PVP) during the winter. The Greeley Filters Pipeline is located approximately one mile upstream from the Bellvue WTP. Greeley also owns units in the CBT Project and Windy Gap Project, taking water deliveries from those projects' water through facilities described above. Therefore, water entering the Bellvue WTP consists of any combination of the water from the Colorado, Poudre, or North Platte River Basins. The Boyd WTP receives water from the CBT Project, Windy Gap Project, or from the Greeley-Loveland Companies. These sources are diverted from the Big Thompson River through open irrigation canals into either Lake Loveland and then to Boyd Lake via the Big Barnes Ditch, or directly to Boyd Lake via the Greeley-Loveland Canal. The Boyd WTP is not currently winterized and is only operated as a peaking plant during the irrigation season (April through October).

North Platte River basin water consists of wholly consumable transbasin rights that are delivered to the Poudre River in one of two ways: through Bob Creek Ditch to the Roaring Fork drainage, or through the Laramie-Poudre Tunnel to the Poudre River eight miles downriver of Chambers Reservoir. These supplies are diverted from the mainstem at the Greeley Filters Pipeline and delivered to the Bellvue WTP.

The Poudre Basin water consists of direct flow rights and native storage and is the foundation of Greeley's water supply. Greeley owns senior direct flow and storage rights on the upper mainstem including direct flow priorities and changed and unchanged agricultural water rights that are diverted from the river through the same diversion and pipelines described above and delivered to the Bellvue WTP. In addition, Greeley owns shares in Greeley Irrigation Company's Greeley Canal No. 3 and New Cache la Poudre Irrigating Ditch Company that divert from the lower mainstem near Greeley and is used for non-potable irrigation and other non-potable uses in Greeley.

Colorado River Basin water consists of single-use and wholly consumable transbasin water and is primarily accessed through the CBT and Windy Gap Projects. Greeley can deliver CBT Project and Windy Gap Project water to the Bellvue WTP from Horsetooth Reservoir through the Hansen Supply Canal during the summer and the PVP during the winter. CBT Project and Windy Gap Project deliveries can also be diverted from the Big Thompson River and delivered to the Boyd WTP through the Greeley-



INTEGRATED WATER RESOURCE PLAN

Existing Water Supply System



Loveland Companies' canals. Greeley is a participant in the Windy Gap firming project. At the time of this IWRP, Chimney Hollow Reservoir is under construction to improve the reliability of the Windy Gap Project.

Greeley's Big Thompson River Basin water consists of transferred agricultural direct flow and storage rights, in addition to CBT Project deliveries that are treated at the Boyd WTP. Water is diverted from the Big Thompson River through either the Barnes Ditch or the Greeley-Loveland Canal, which are components of the Greeley-Loveland Companies system, of which Greeley is a shareholder. The Barnes Ditch conveys water to Lake Loveland. Water from Lake Loveland can be conveyed to Boyd Lake through Horseshoe Reservoir, while the Greeley-Loveland Canal conveys water directly to Boyd Lake. The Boyd WTP draws water directly from Lake Loveland or Boyd Lake or a blend of the two reservoirs. Greeley can also receive water from the Greeley-Loveland Canal via a pump.

Greeley owns multiple reservoirs in the upper and lower Poudre Basin, comprising the majority of its owned water storage. Greeley constructed Milton Seaman Reservoir located on the North Fork of the Poudre in 1943. Five additional reservoirs, the high mountain reservoirs, were purchased by Greeley in 1947 from the Mountains and Plains Irrigation Company. The high mountain reservoirs were constructed in the 1920s, with the exception of Hourglass Reservoir which was constructed in 1898. Two of the high mountain reservoirs were expanded in the 1970s (Barnes Meadow and Peterson Lake Reservoirs). The six high mountain reservoirs combined with Milton Seaman Reservoir currently have a total active storage capacity of approximately 13,000 acre-feet, not including other conditional storage rights owned by Greeley. These reservoirs are entitled to fill once each year and, due to ice conditions, are not suitable for wintertime operations, except for Barnes Meadow and Milton Seaman Reservoirs. Greeley also owns storage reservoirs in the lower Poudre Basin that are used within Greeley's non-potable system. In addition to the Poudre Basin reservoirs, Greeley owns shares in three interrelated agricultural water companies collectively known as the Greeley-Loveland Companies. These companies provide storage and delivery of water from the Big Thompson River to the Boyd WTF.

Greeley utilizes a non-potable system to meet outdoor/irrigation and other non-potable demands using direct flow and storage supplies currently delivered through the Greeley-Loveland Irrigation Company (GLIC) canal and the Greeley Irrigation Company Canal No 3. In the future, Greeley will expand its non-potable system outside of these two delivery canals as it also owns shares in the New Cache la Poudre Irrigating Ditch Company which delivers water through the Greeley Canal No 2.



INTEGRATED WATER RESOURCE PLAN

Existing Water Supply System

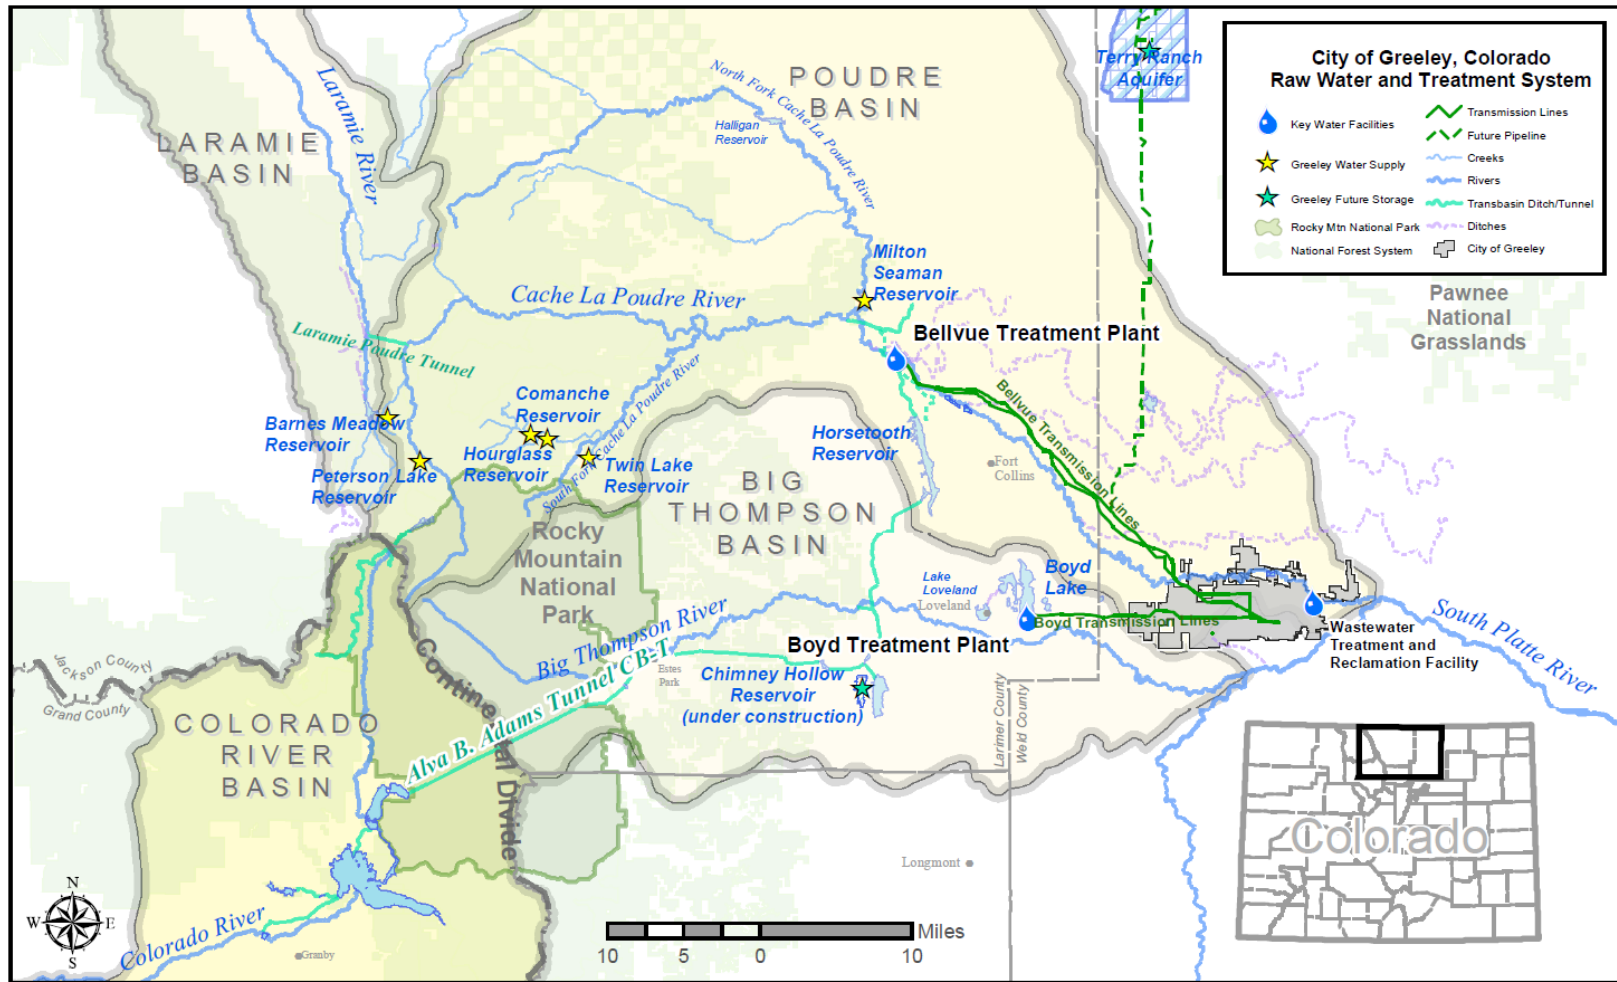


Figure 3-1. Map of Greeley's Current Water Supply System





4.0 CURRENT AND PROJECTED WATER DEMANDS

This section describes Greeley's current water service area and demands and presents the methodology and results of the demand projections.

4.1 CURRENT SERVICE AREA

The City of Greeley (City), Colorado is located in Weld County approximately 60 miles northeast of Denver. The City is the eleventh largest community in Colorado, the second largest community in Northern Colorado and the business center for Weld County. The leading industries in Weld County are agriculture, manufacturing, energy production, health and wellness, and business services. The City hosts two academic institutions, the University of Northern Colorado and Aims Community College and is home to large industrial water users including JBS USA and Leprino Foods.

The City currently provides water services within the Greeley City limits and to a suite of outside service contracts. For planning purposes, the IWRP chose to not include outside services into demands or modeling. IWRP demand projections were developed using The City's Long Range Expected Growth Area (LREGA) is shown in **Figure 4-1**. This is the area outside of the City limits where Greeley plans to provide water and sewer services. Although Greeley's population has grown by approximately 17%, per capita in the last 25 years, demand has decreased by 11% compared to a 2012 peak. **Figure 4-2** shows Greeley's population and total water demands since 2010, highlighting this trend. This system wide per capita demand trend is driven from single family residents. Greeley's water conservation program has created efficiencies and consistencies among policies that have resulted in a 10% per capita decline in residential demand from 2012-2021. Replacements and retrofits of new high efficiency toilets, showerheads, washing machines and dishwashes have led to less use than in previous years. Savings from these existing residential homes has more than offset the increase in demand from new builds and business for almost 20-years. Greeley's Water Conservation team continues to innovate and find identify water savings opportunities through with programs that include a residential Water Budget, a turf replacement program, and most recently, leak detection with advanced metering infrastructure.



Greeley, CO Water Service Area

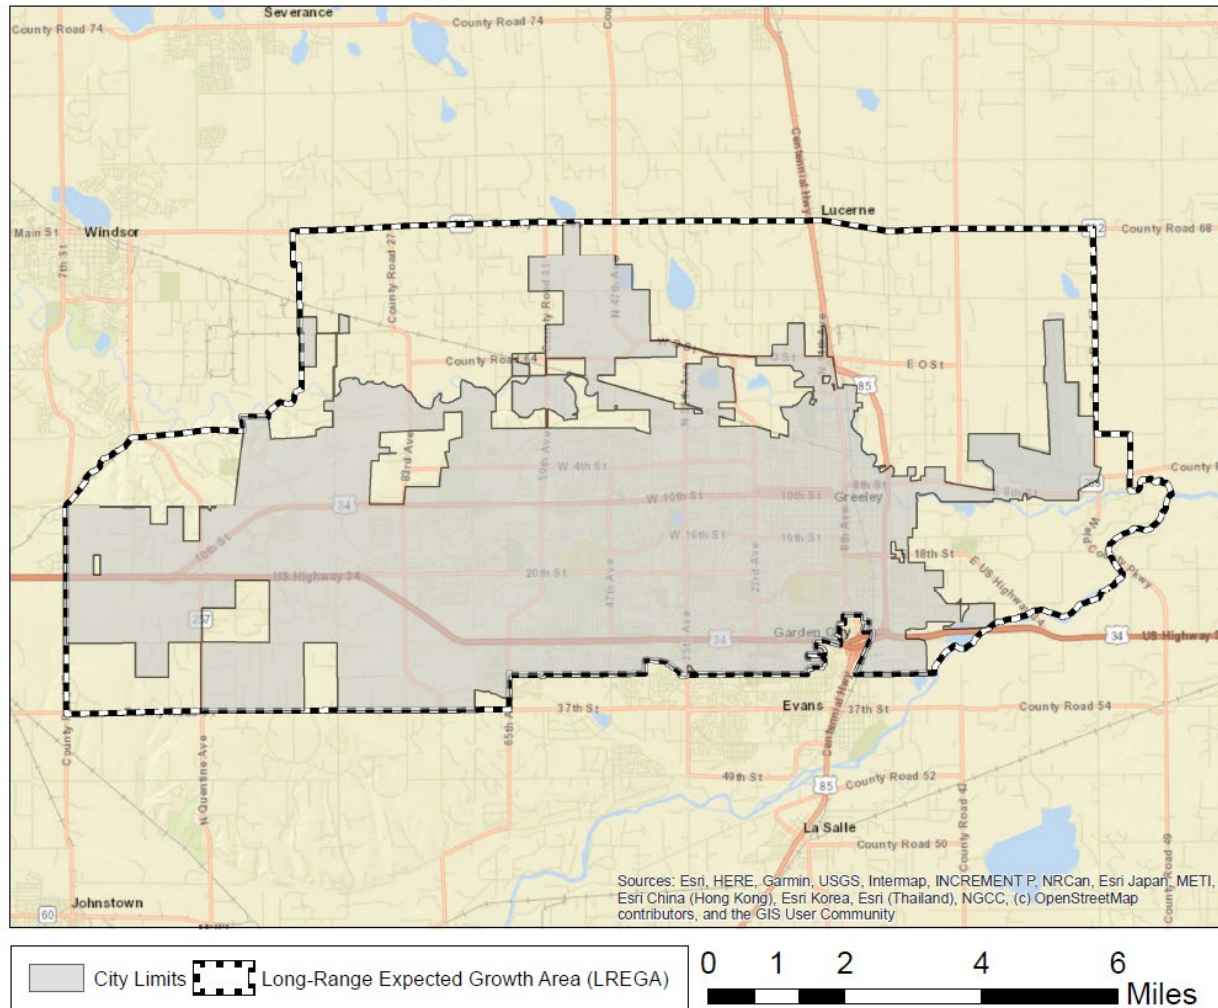


Figure 4-1. The City of Greeley’s City Limits and Long-Range Expected Growth Area



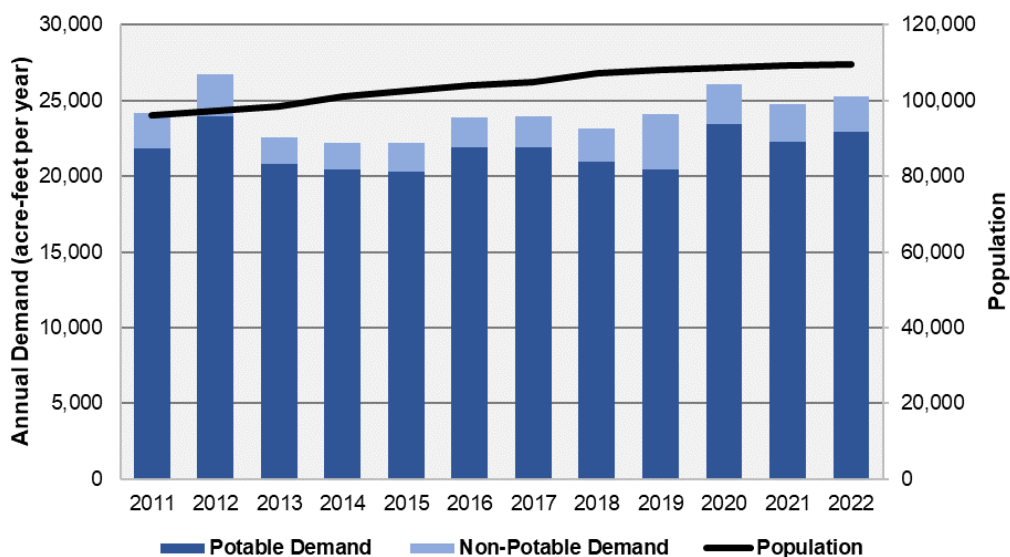


Figure 4-2. Observed Greeley Potable and Non-Potable Demands with Historical Population. The left axis corresponds to the bars and the right axis to the line.

4.2 IWRP PROJECTED DEMANDS

This section summarizes the IWRP demand projections, which are documented in the Demand Forecast TM, included in Appendix B.

The IWRP demand projections used Greeley’s existing water demand model (Demand Model) (BBC Research, 2018). The model produces projections of annual indoor and outdoor water use by customer category (e.g., single family residential, multifamily residential, commercial) through 2070. The model only includes Greeley’s retail customers and does not include water use by Greeley’s wholesale customers who provide their own water resources (e.g., City of Evans, Town of Milliken, Town of Evans).

4.2.1 Population Projections

A significant contributor to future water use in Greeley is population growth. The IWRP developed updated population projections for Greeley that incorporated the new information described below:

- Updated historical population data from the 2020 Census
- New projections from the Colorado State Demographers Office, which lowered Weld County population projections compared to those previously used in the Demand Model
- New features developed for the Technical Update to the Colorado Water Plan that allows different alternative county-level population forecasts to be developed based off the Colorado State Demographers Office projections.





The information above was used to develop population forecasts for three scenarios: Low, Medium, and High at 2050 and 2070. **Figure 4-3** shows the population projections for the three scenarios.

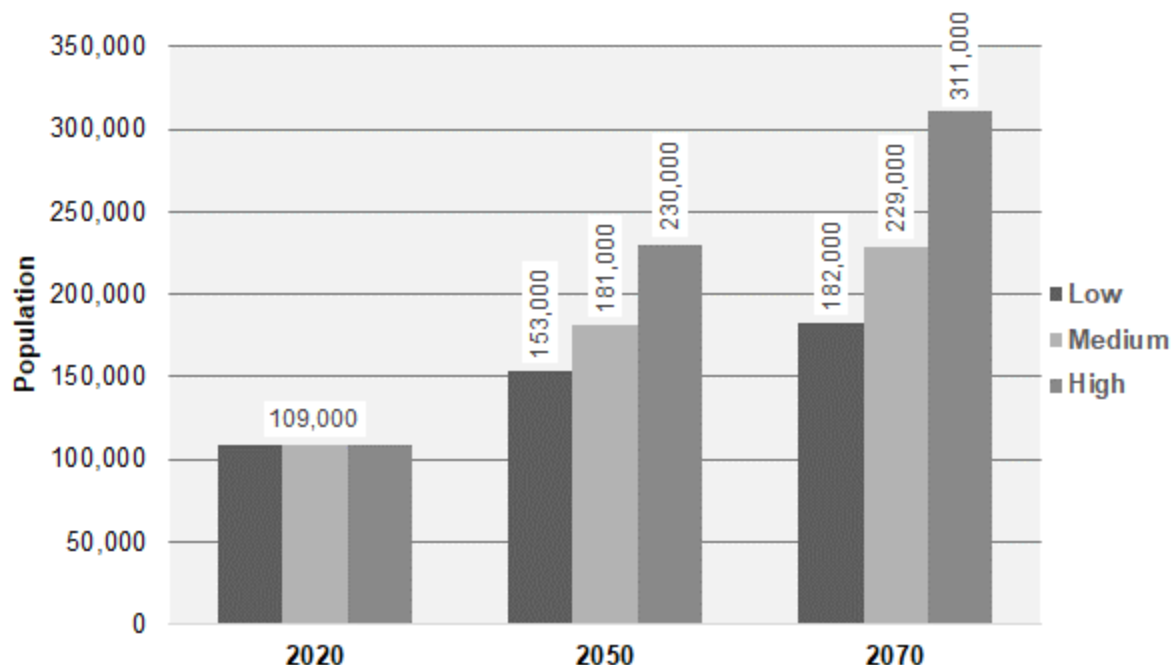


Figure 4-3. Greeley’s 2020 and Projected Populations at 2050 and 2070

The IWRP also evaluated the potential timing of “buildout” in Greeley’s LREGA and the potential city population at buildout. Buildout population and the timing of population will depend on many factors, however the IWRP varied residential unit density (in residential units per acre) and population growth rate (the previously used Low, Medium, and High scenarios) when assessing buildout. **Table 4-1** shows the buildout population for each density scenario.

Table 4-1. Buildout Population and Timing Projections

Density Scenario	Buildout Population
Current Residential Density (7.1 units per acre)	348,000
30% Increase in New Residential Density (9.2 units per acre)	421,000
50% Increase in New Residential Density (10.6 units per acre)	470,000





4.2.2 Demand Projections

Potable and non-potable demands were projected at 2030, 2050, and 2070 using the population projections described above for four demand scenarios. These four scenarios vary important factors that can impact future demands: the population growth scenario, the extent to which irrigation increases in response to hotter and drier future climate conditions, the extent of future conservation, and the proportion of new housing units that are multifamily apartments and condominiums. These factors were selected based off the prioritized demand risks described in Section 5. **Table 4-2** summarizes these four demand scenarios and how these factors were applied in them.

Table 4-2. IWRP Demand Scenario Settings

Demand Scenario	Population Scenario	Increase in Irrigation Rate due to Climate	Conservation (Price Increases)	Multifamily Share of New Housing Units
High Bookend	High Growth	37%	Level 2 (2%/year)	40%
Median Scenario	Medium Growth	25%	Level 1 (1%/year)	40%
Low Bookend	Low Growth	12%	Level 3 (3%/year)	50%
Median with Max Conservation	Medium Growth	25%	Level 3 (3%/year)	40%

The Demand Model develops separate forecasts for the portion of projected outdoor demands that will be met from non-potable sources, otherwise known as non-potable demands. The IWRP updated the non-potable forecast based off the 2021 Non-Potable Master Plan. **Table 4-3** shows the assumed percentages of outdoor demands that are non-potable by customer category that were applied to the demand forecasts. To align with the Non-Potable Master plan, the maximum non-potable demand regardless of scenario was set to a maximum of 7,100 acre-feet per year.

Table 4-3. Non-Potable Demand Forecast Assumptions

Customer Category	Percent of New Outdoor Demands from Non-Potable Supplies
Singly-Family Residential	12%
Multi-Family Residential	12%
Commercial	16%
City of Greeley	80%
Schools	60%
University of Northern Colorado	16%




INTEGRATED WATER RESOURCE PLAN

Current and Projected Water Demands



The demand projections at 2030, 2050, and 2070 are shown by Demand Scenario in **Figure 4-4** and presented numerically in **Table 4-4**. Based on these projections, Greeley’s demands at 2070 could vary between 35,400 and 70,000 acre-feet per year. The most significant contributor to this variability is population. Under these projections, Greeley’s non-potable system will be fully built out by 2070 for all Demand Scenarios except the Low Bookend.

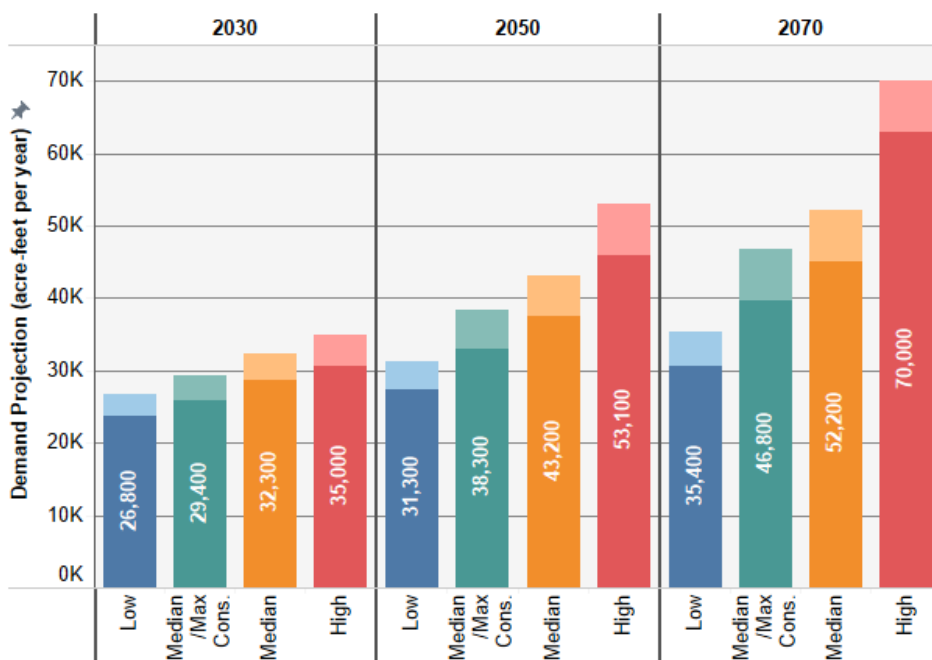

Dark Color is Potable, Light Color is Non-Potable. Value is Total Demand = Potable + Non-Potable

Figure 4-4. Greeley’s Demand Projects at 2030, 2050, and 2070

Table 4-4. Greeley’s Demand Projects at 2030, 2050, and 2070

Year	Demand Type	Demand Scenario			
		Low Bookend	Median w/ Max Conservation	Median Scenario	High Bookend
2030	Non-Potable	3,000	3,500	3,700	4,300
	Potable	23,800	25,900	28,600	30,700
	Total	26,800	29,400	32,300	35,000
2050	Non-Potable	4,000	5,300	5,700	7,100
	Potable	27,300	33,000	37,500	46,000
	Total	31,300	38,300	43,200	53,100
2070	Non-Potable	4,800	7,100	7,100	7,100
	Potable	30,600	39,700	45,100	62,900
	Total	35,400	46,800	52,200	70,000





Figure 4-5 compares growth in total demands between the four Demand Scenarios from 2030 to 2070. The variation in projected total demands (difference between High and Low Demand Scenario projections) increases from 8,200 acre-feet per year at 2030 to 34,600 acre-feet per year at 2070. This further emphasizes the significant variation and uncertainty in Greeley’s potential future demands. These demand projections assumed demand growth occurs immediately. However, Greeley’s total demands have not grown significantly over the last 10 years and are lower than the early-2000s peak – further contributing to uncertainty. Developing a process to manage and track demand growth uncertainty will be a key component of the Adaptive Plan.

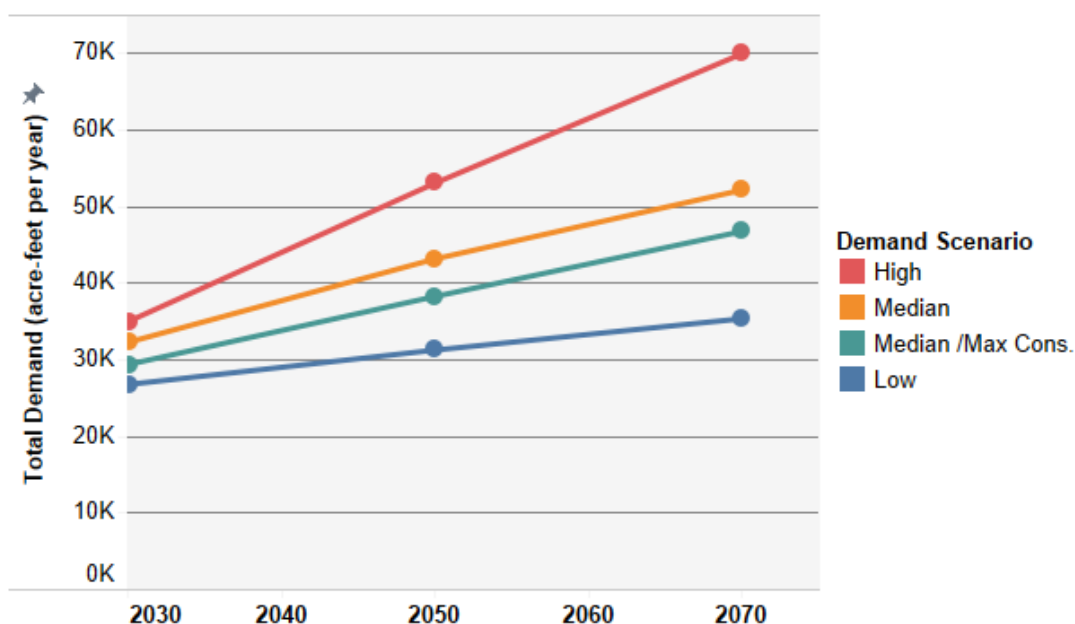


Figure 4-5. Comparison of Greeley’s Demand Growth Between 2030 and 2070





5.0 RISK IDENTIFICATION AND ASSESSMENT

5.1 METHODOLOGY

Risks to Greeley’s water supply system were identified within five categories by a combination of Greeley Staff, consultants, and a review of other studies and relevant published literature. These risks were then evaluated using a scoring survey. The purpose of the evaluation was to prioritize risks and identify which should be included in the IWRP.

The scoring survey had Greeley staff, stakeholders, and members of the Stantec Team assign numerical likelihood and impact scores to the individual risks. Participants assigned scores from 1 to 5 using their perception of each risk according to the definitions in **Table 5-1**. The likelihood and impact scores were then multiplied together to compute a composite score. The composite scores were then used to prioritize risks for IWRP inclusion. Participants assigned scores individually and were not required to score every risk.

Table 5-1. Impact and Likelihood Scores and Definitions Used by Scoring Participants

Score	Impact Definition	Likelihood Definition
1	<i>Insignificant</i> – If the risk occurs the impact to the water supply system would be negligible.	<i>Rare</i> – the risk will only occur in exceptional circumstances.
2	<i>Minor</i> – If the risk occurs the impact to the water supply system would be minimal.	<i>Unlikely</i> – the risk will occur in occasional circumstances.
3	<i>Moderate</i> – If the risk occurs there would be a noticeable impact to the water supply system.	<i>Possible</i> – the risk will occur in some circumstances.
4	<i>Major</i> – If the risk occurs there would be substantial impact to the water supply system.	<i>Likely</i> – the risk will occur in a majority of circumstances.
5	<i>Extreme</i> – If the risk occurs there would be catastrophic impact to the water supply system.	<i>Almost Certain</i> – the risk will occur in almost all circumstances/is imminent.





5.2 IDENTIFIED WATER SUPPLY SYSTEM RISKS

55 initial risks to Greeley’s water supply system were identified by the Greeley staff and the Stantec Team. These risks were grouped into five categories:

- **Climate Change and Hydrology** – Risks that relate to climate variability and other hydrologic factors, both short- and long-term, that can impact Greeley’s water entitlements
- **Colorado River Basin Issues** – Risks that could affect Greeley’s water supplies from the Colorado River Basin, including the Colorado-Big Thompson Project.
- **Demand** – Risks that could increase or decrease future water demands from what is projected, resulting in Greeley’s water supply system being unable to meet water needs or being overdesigned
- **Infrastructure and Operations** - Risks that include impacts to how Greeley captures and delivers their water entitlements water to customers
- **Water Rights** – Risks that could impact how Greeley’s existing and potential water rights could be acquired, changed, and/or administrated

The tables on the following pages show the risks identified for each category, a brief description, and the average impact, likelihood, and composite score from scoring survey participants. **Table 5-2** shows the Climate Change and Hydrology risks and scores. **Table 5-3** shows the Colorado River Basin Issues risks and scores. **Table 5-4** shows the Demand risks and scores. **Table 5-5** shows the Infrastructure and Operations risks and scores. **Table 5-6** shows the Water Rights risks and scores.



INTEGRATED WATER RESOURCE PLAN

Risk Identification and Assessment



Table 5-2. Identified Climate Change and Hydrology Risks with Corresponding Impact and Likelihood Scores

ID	Risk Name	Risk Description	Average Impact Score	Average Likelihood Score	Average Composite Score ¹	Composite Score Standard Deviation
CC3	Extended Droughts	Droughts with duration and severity greater than Greeley's historical record occur. Would occur independent of Climate Change.	4.2	4.2	18.1	6.1
CC1	Colorado River Administration CC Impacts	Climate change would increase the frequency, duration, and intensity of droughts, reducing Greeley's available supply from Colorado River basin. This would result in the Colorado River Basin risks occurring more often.	3.8	4.2	15.8	4.5
CC4	Hydrologic CC Impacts	More precipitation could occur as rain, runoff timing would compress and shift earlier in the season, resulting in net changes to volumetric yields and exchange availability.	3.5	4.0	14.5	4.6
CC5	Increased Extreme Events	Increased frequency and intensity of extreme events such as fire and flooding within Greeley's source basins would change the timing, quantity, and quality of water supply from those watersheds.	3.0	4.0	12.2	5.6
CC6	Municipal Water Use CC Impacts	Warmer temperatures increase water needs and increase the duration of the municipal irrigation season. Could also result in a change in landscaping practices - e.g., conversion of irrigated landscape to xeriscape.	3.0	3.8	11.5	3.9
CC2	Evaporation Rate CC Impacts	A warmer climate would increase evaporation losses from reservoirs	2.5	4.1	10.3	2.5
CC7	Water Rights Administration CC Impacts	Yields from existing water rights would change due to the shift in runoff magnitude and timing. Operational assumptions around exchange, timing, and positioning of yields would change.	2.5	3.7	9.5	4

¹ Values shown are the average of the composite scores and not the product of the Average Likelihood Score and the Average Impact Score



INTEGRATED WATER RESOURCE PLAN

Risk Identification and Assessment



Table 5-3. Identified Colorado River Basin Issues Risks with Corresponding Impact and Likelihood Scores

ID	Risk Name	Risk Description	Average Impact Score	Average Likelihood Score	Average Composite Score ¹	Composite Score Standard Deviation
CR1	Colorado River Basin Administrative Actions	To comply with the Colorado River Compact/critical operational parameters (e.g., power pools in Lakes Mead and Powell), a variety of impacts to Greeley's Windy Gap and CBT yields could occur.	4.2	4.6	19.1	3.4
CR3	Chronic Yield Reduction - Windy Gap	Chronic, 10% to 25% reduction in Windy Gap yields due to the effects of aridification in the Colorado River Basin. Reduction would be applied over the entire simulation period.	3.8	3.7	14	5.3
CR4	Chronic Yield Reduction - Windy Gap and CBT	Chronic, 10% to 25% reduction in Windy Gap and CBT yields due to the effects of aridification in the Colorado River Basin. Reduction would be applied over the entire simulation period.	4.3	3.1	13.2	2
CR10	Yield Reduction - Multi Year	2-year, 10% to 25% reduction of Windy Gap/CBT/WSSC yields as part of State-led coordinated effort.	4.2	3.2	13	5.5
CR8	Total Curtailment - Single Year, Windy Gap and CBT	1-year complete curtailment of Colorado River Basin yields could occur in the event of Compact Compliance failure.	4.1	3.1	12.5	6.9
CR11	Yield Reduction - Single Year	1-year, 10% to 25% reduction of Windy Gap/CBT/WSSC yields as part of State-led coordinated effort.	3.6	3.8	12.4	4.5
CR5	Total Curtailment - Multi-Year, Windy Gap	2-year complete curtailment of Windy Gap yields could occur in the event of Compact Compliance failure.	3.9	3.1	12.3	6
CR9	Yield Reduction - Extended	5-year, 10% to 25% reduction of Windy Gap/CBT/WSSC yields as part of State-led coordinated effort.	4.7	2.7	12.1	5.5
CR6	Total Curtailment - Multi-Year, Windy Gap and CBT	2-year complete curtailment of Colorado River Basin yields could occur in the event of Compact Compliance failure.	4.5	2.6	11.8	4.2



INTEGRATED WATER RESOURCE PLAN

Risk Identification and Assessment



ID	Risk Name	Risk Description	Average Impact Score	Average Likelihood Score	Average Composite Score ¹	Composite Score Standard Deviation
CR7	Total Curtailment - Single Year, Windy Gap	1-year complete curtailment of Windy Gap yields could occur in the event of Compact Compliance failure.	3.4	3.4	11.8	6
CR2	Emergency Municipal Demand Reductions	Greeley's water use would be significantly reduced as part of State-led effort to reduce demands on the Colorado River Basin. Only water use for public health and critical landscaping (e.g., mature trees) would be allowed.	2.9	3.1	8.8	3.4

¹ Values shown are the average of the composite scores and not the product of the Average Likelihood Score and the Average Impact Score
 WSSC is Water Supply & Storage Company

Table 5-4. Identified Demand Risks with Corresponding Impact and Likelihood Scores

ID	Risk Name	Risk Description	Average Impact Score	Average Likelihood Score	Average Composite Score ¹	Composite Score Standard Deviation
D10	Regional Water Issues - Long Term	Nearby communities experience long-term water reliability issues and City of Greeley decides to provide their water service.	3.5	3.7	13.1	5.3
D6	High Impact Water Rates	Higher rates to fund projects could cause demands to decrease due to affordability issues. Could also lead to political impacts where rates can no longer be raised.	3.1	3.8	11.8	5.6
D4	Demand Hardening	Long-term reductions in outdoor Municipal water use reduces the proportion of total demand that is for outdoor use. This would reduce assumed savings from drought response measures.	3.0	3.7	11.5	4.8
D12	Service Area Expansion	The City of Greeley expands beyond the current service area, potentially increasing buildout demand.	3.6	3.2	11.5	3.9



INTEGRATED WATER RESOURCE PLAN

Risk Identification and Assessment



ID	Risk Name	Risk Description	Average Impact Score	Average Likelihood Score	Average Composite Score ¹	Composite Score Standard Deviation
D7	Increased Suburban Growth	The proportion of suburban growth is more than assumed in demand forecasts, increasing proportion of overall demands that are outdoor demands.	3.0	3.6	10.9	4.4
D9	Increased Non-Potable System Growth	The non-potable system is not developed/built as assumed. Future demands assumed to be met from non-potable supplies instead are part of the potable system.	2.9	3.5	10.3	5.5
D13	Uncertain Industrial Demands	Large industrial demands could be added to the system, which would quickly increase the demands on the water system.	3.4	3.0	10.2	3.5
D2	Demand Growth Exceeds Forecast	Greeley's water demands could grow faster than anticipated due to a variety of conditions including rapid population growth and/or poor adoption of conservation practices.	3.5	2.6	9.6	4.5
D5	Demand Stagnation	Demands continue to remain relatively static for a longer period of time than assumed. This could affect the timing of CIP projects and reduce anticipated revenue, overburdening rate payers.	2.8	3.3	9.4	4.7
D8	Increased Urban Growth	The proportion of urban growth is more than assumed in demand forecasts, increasing the proportion of overall demands that are indoor demands.	2.5	3.5	8.9	3.5
D11	Regional Water Issues - Short Term	Nearby communities experience emergency water reliability issues and Greeley would provide water service to them for a short period of time.	2.2	3.8	8	3.6
D1	Conservation Program Ineffectiveness	Per capita water use does not decline as much as anticipated with the current water conservation program measures.	2.9	2.4	7.1	4
D3	Demand Growth Slower than Forecast	Greeley's water demand grows slower than anticipated due to conditions such as high rate burden, poor economic conditions, more rapid adoption of conservation practices, and new water fixture/irrigation technology.	2.0	3.0	6.5	5

¹ Values shown are the average of the composite scores and not the product of the Average Likelihood Score and the Average Impact Score



INTEGRATED WATER RESOURCE PLAN

Risk Identification and Assessment



Table 5-5. Identified Infrastructure and Operational Risks with Corresponding Impact and Likelihood Scores

ID	Risk Name	Risk Description	Average Impact Score	Average Likelihood Score	Average Composite Score ¹	Composite Score Standard Deviation
IO9	Increased Frequency/Severity of Wildfires - Poudre Watershed	Severe wildfires in Poudre watersheds would change the timing, quantity, and quality of water supply from those watersheds. July/August yields would be cut off completely for 3 of 10 years after a fire and would be reduced by 25% for the other 7 years. Barnes, Peterson, and Chambers would have a 50% reduction in storage capacity. Treatment costs would increase.	3.5	4.2	14.8	6.2
IO4	Degraded Surface Water Quality	Climate change creates frequent surface water quality issues such as algal blooms that reduce Greeley's ability to treat water.	3.1	3.3	9.9	3.3
IO17	Water Quality Regulation Changes	New/modified water quality environmental criteria (minimum flows, temperature standards, etc.) could be adopted that would affect Greeley's water rights and operations.	2.7	3.6	9.8	3.4
IO5	Environmental Permitting Problems	Failure to obtain the necessary federal or state environmental permits would make it impossible to implement a planned project.	2.8	3.3	9.2	3.8
IO2	Changes in Regional Agriculture	The regional ag. economy is more or less robust than assumed, affecting the availability/pricing of water rights for Greeley. More robust regional ag. economy would increase the likelihood of high-water use industries.	2.6	3.4	9.1	5.5
IO1	Budget Instability	Temporary monetary crisis or revenue instability forces Greeley to lower use of energy-intensive infrastructure such as Terry Ranch.	2.9	2.8	8.9	6.2
IO11	Multi-Year Grand River Ditch Outage	Grand River Ditch is taken out of service for 3 years due to natural hazard (flood, landslide, etc.).	3.0	2.8	8.6	3.4
IO14	Regional Agricultural Water Use Practices	Changes in agricultural water use and growth practices change how Greeley's water rights yield due to shared ditch infrastructure, senior water rights calls, and reduced runoff from water-intensive irrigation practices.	2.6	3.1	8.6	6.2
IO8	High Mountain Reservoir Chronic Outage	Natural disasters or changes in regulations take Greeley's High Mountain Reservoirs permanently offline.	3.3	2.5	8.3	4.2



INTEGRATED WATER RESOURCE PLAN

Risk Identification and Assessment



ID	Risk Name	Risk Description	Average Impact Score	Average Likelihood Score	Average Composite Score ¹	Composite Score Standard Deviation
IO10	Multi-Year CBT Infrastructure Outage	Variety of risks to CBT infrastructure that could take it offline for a period of time. This effect would be captured via reduced or eliminated quota to Greeley.	3.8	2.2	8.3	3.7
IO13	Multi-Year Laramie-Poudre Tunnel Outage	Laramie-Poudre Tunnel is taken out of service for 3 years due to natural hazard (flood, landslide, etc.).	3.0	2.8	8.3	4.6
IO6	Ground Water (GW) supplies cannot be used by Greeley	Greeley cannot utilize Terry Ranch for either GW supplies or storage.	4.2	1.9	8.1	3.9
IO7	High Energy Cost	High energy costs reduce Greeley's ability to use energy-intensive infrastructure such as Terry Ranch.	2.7	3.0	7.7	3.7
IO12	Multi-Year High Mountain Reservoir Outage	High Mountain Reservoirs are taken out of service for 3 years due to natural hazard (flood, landslide, etc.).	3.2	2.3	7.5	4
IO16	Terry Ranch Yield Limitations	Features of Terry Ranch such as neighboring owners over-drafting and/or inconsistent uranium presence in wells change the yield assumptions from the project.	2.8	2.6	7.3	3.4
IO15	Terry Ranch Interstate Compact	New interstate compacts or legal precedent changes how Greeley can use Terry Ranch	3.1	2.3	6.9	2.5
IO3	Contamination Event	Contamination of a surface water supply source, storage facility, or Terry Ranch requires significant operational changes for 2 or more years.	3.2	2.3	6.8	3.4

¹ Values shown are the average of the composite scores and not the product of the Average Likelihood Score and the Average Impact Score



INTEGRATED WATER RESOURCE PLAN

Risk Identification and Assessment



Table 5-6. Identified Water Rights Risks with Corresponding Impact and Likelihood Scores

ID	Risk Name	Risk Description	Average Impact Score	Average Likelihood Score	Average Composite Score ¹	Composite Score Standard Deviation
WR2	Competition for New Water Rights	New water rights would be more expensive and yield less than anticipated. Water rights that Greeley plans to acquire come off the market due to actions by other water providers.	3.2	4.4	14.4	5.3
WR1	CBT Operational Changes	Northern Water would no longer allow Greeley to carryover their CBT supplies.	3.5	3.4	12.2	4.2
WR6	Water Rights Change Complexity	Water rights that Greeley currently owns but has not changed to municipal use would have their yields reduced as part of the change process or could not be changed entirely.	2.9	3.9	12	5
WR3	Increased return flow obligations	Due to changes in future change cases or other water rights administration changes. Greeley must dedicate more water than planned to return flow obligations.	2.7	3.3	9.7	6
WR5	Terry Ranch Storage Ability	Water that is assumed to be storable in Terry Ranch would no longer be able to be stored there due to changes in water rights administration (e.g., wholly consumptive rights)	3.3	2.6	9.3	5.8
WR4	Reduced reusable effluent	Due to changes in water rights administration, treatment requirements, or operational changes Greeley has less reusable effluent than planned.	2.4	2.9	7.7	4.4

¹ Values shown are the average of the composite scores and not the product of the Average Likelihood Score and the Average Impact Score





5.3 WATER SUPPLY SYSTEM RISK ANALYSIS

5.3.1 Comparative Analysis of Risks and Uncertainties

When prioritizing risks, the average likelihood and impact scores resulting the scoring survey were evaluated using the criteria shown in **Figure 5-1**. Risks with a composite score (calculated as likelihood times impact) greater than 10 were generally prioritized for the IWRP. Risks with composite score less than 5 were not prioritized for the IWRP. Risks with an impact score above 4 and likelihood score above 2 were prioritized for the IWRP regardless of the composite score. All other risks were evaluated on a case-by-case basis.

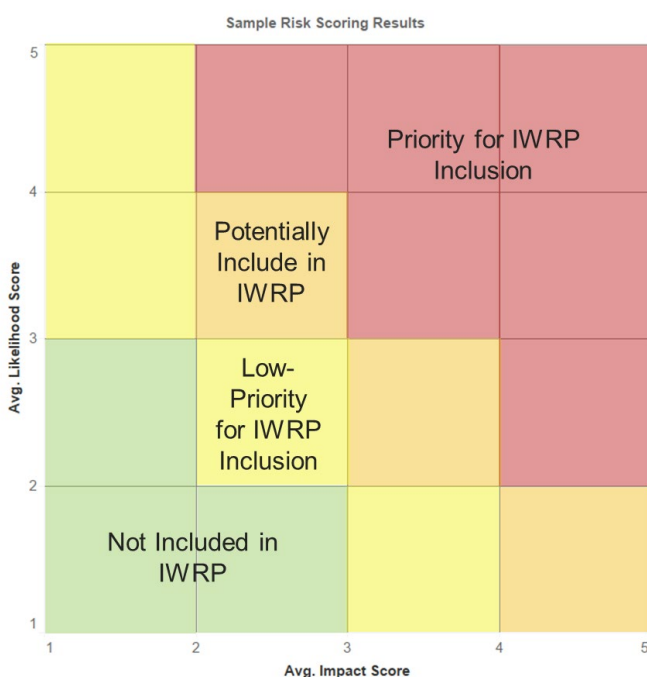


Figure 5-1. Overall Likelihood and Impact Criteria used to Prioritize Risks

Figure 5-2 presents the likelihood and impact scores of the risks averaged across all scoring survey responses with the risk category shown as the color. Labels within each circle correspond to the risk ID of a risk that was prioritized for IWRP inclusion. In this figure, the closer a risk is to the top right corner the more likely and impactful it was perceived to be. Risks from all the categories were included in the IWRP.



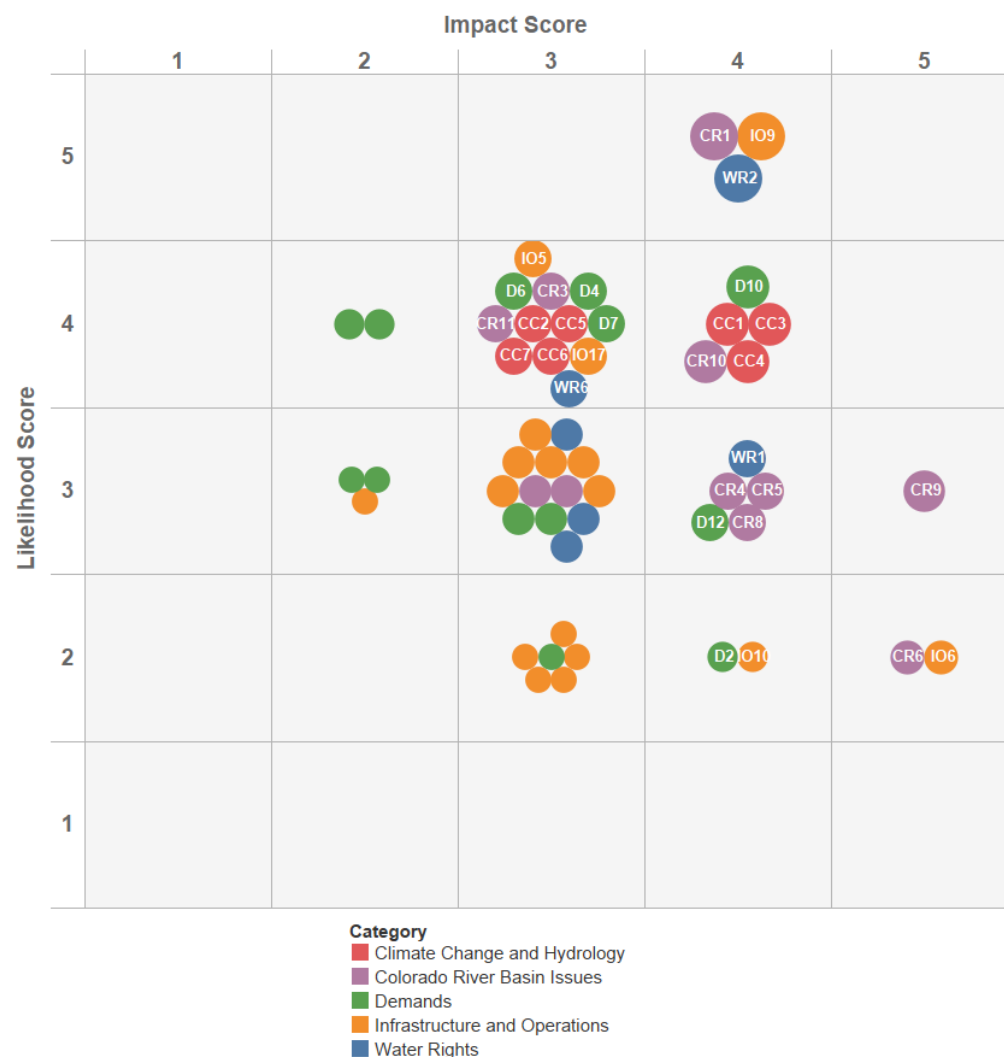


Figure 5-2. Average Impact and Likelihood Scores for Water Supply Risks

Another criterion evaluated when prioritizing risks for the IWRP was the variation of individual likelihood and impact scores. **Figure 5-3** (Climate Change and Hydrology, Colorado River Basin Impacts, and Demand risks) and **Figure 5-4** (infrastructure and Operations and Water Rights risks) show how many individual respondents assigned a likelihood/impact score of 1 to 5 for each risk (NA indicates a value was not assigned). The larger a bar is, the more respondents assigned the specified score. R&Us with larger bars of a single color indicate agreement within respondents on the likelihood/impact score while four or more individual colors indicate variability of individual scores. Most risks showed minimal variation between individual scores, indicating that the respondents have similar perceptions of likelihood and impact for most of the risks. Risks that had scores from 1 to 5 given by respondents include: Total Curtailments of the Windy Gap and CBT systems, Demand Growth Slower than Forecast, and Service Area Expansion. This variation was considered and ultimately no changes were made to the prioritized risks.



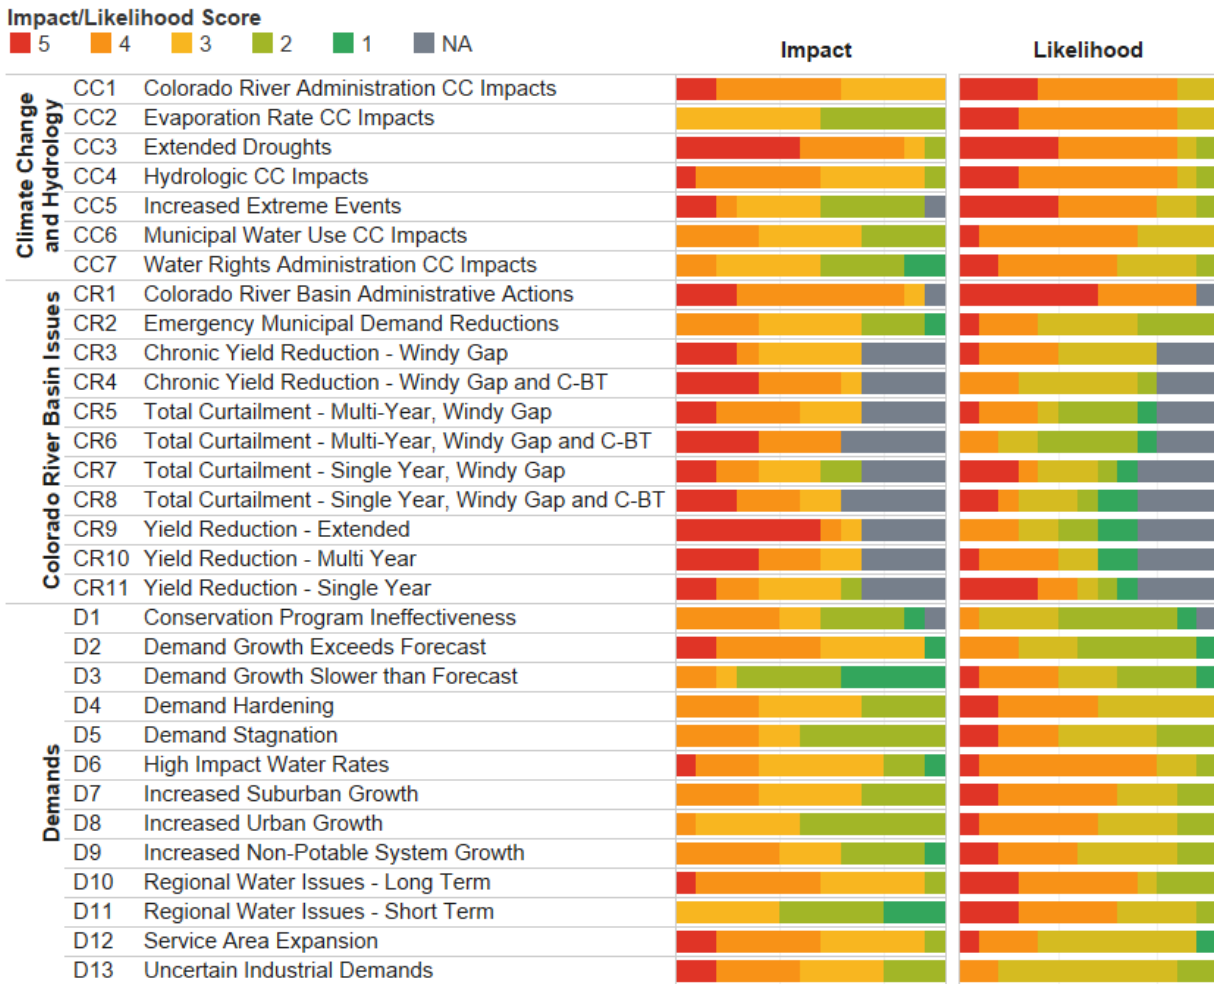


Figure 5-3. Variability in individual impact and likelihood scores for Climate Change Hydrology, Colorado River Basin Issues, and Demand Risks



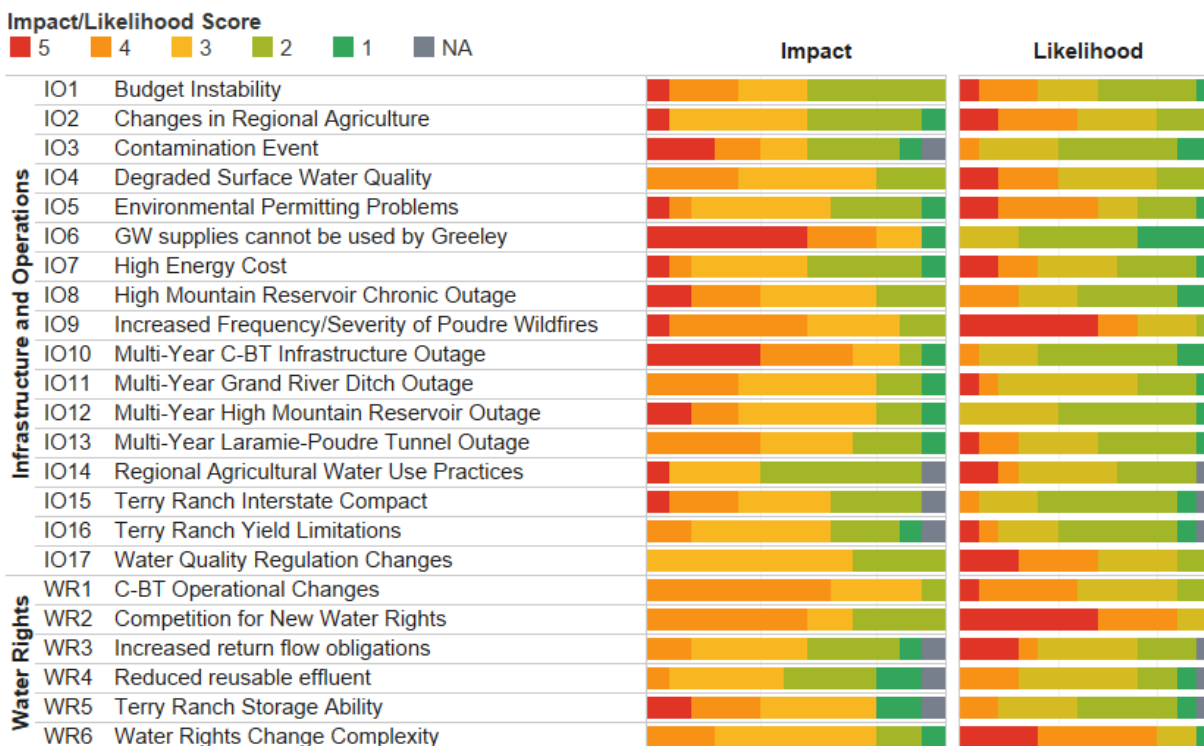


Figure 5-4. Variability in individual impact and likelihood scores for Infrastructure and Operations and Water Rights Risks

5.3.2 Prioritized Risks for IWRP Inclusion

Table 5-7 presents the water supply system risks prioritized for the IWRP using the analysis process described above, sorted by composite score. Impact and likelihood scores are the median across all responses. Prioritized risks were those that fell within the red region presented in Figure 5-1 (shown previously) and risks with an impact score greater than 4 paired with a likelihood score greater than 2. In total, 30 risks were prioritized for inclusion in the IWRP.



INTEGRATED WATER RESOURCE PLAN

Risk Identification and Assessment



Table 5-7. List of Prioritized Water Supply Risks for IWRP

ID	Risk Name	Impact Score	Likelihood Score	Composite Score
CR1	Colorado River Basin Administrative Actions	5	4	20
IO9	Increased Frequency/Severity of Poudre Wildfires	5	4	20
WR2	Competition for New Water Rights	5	4	20
CC1	Colorado River Administration CC Impacts	4	4	16
CC3	Extended Droughts	4	4	16
CC4	Hydrologic CC Impacts	4	4	16
CR10	Yield Reduction - Multi Year	4	4	16
D10	Regional Water Issues - Long Term	4	4	16
CR9	Yield Reduction - Extended	3	5	15
CC2	Evaporation Rate CC Impacts	4	3	12
CC5	Increased Extreme Events	4	3	12
CC6	Municipal Water Use CC Impacts	4	3	12
CC7	Water Rights Administration CC Impacts	4	3	12
CR11	Yield Reduction - Single Year	4	3	12
CR3	Chronic Yield Reduction - Windy Gap	4	3	12
D4	Demand Hardening	4	3	12
D6	High Impact Water Rates	4	3	12
D7	Increased Suburban Growth	4	3	12
IO17	Water Quality Regulation Changes	4	3	12
IO5	Environmental Permitting Problems	4	3	12
WR6	Water Rights Change Complexity	4	3	12
CR4	Chronic Yield Reduction - Windy Gap and CBT	3	4	12
CR5	Total Curtailment - Multi-Year, Windy Gap	3	4	12
CR8	Total Curtailment - Single Year, Windy Gap and CBT	3	4	12
D12	Service Area Expansion	3	4	12
WR1	CBT Operational Changes	3	4	12
CR6	Total Curtailment - Multi-Year, Windy Gap and CBT	5	2	10
IO6	GW supplies cannot be used by Greeley	5	2	10
D2	Demand Growth Exceeds Forecast	4	2	8
IO10	Multi-Year CBT Infrastructure Outage	4	2	8





5.4 RISK INCLUSION IN IWRP

The prioritized risks were further evaluated to collect and summarize common risks into “drivers” to incorporate into the IWRP Planning Scenarios. Drivers are major events or conditions that are outside Greeley’s control that could impact their ability to provide sustainable water supply to their customers. The drivers identified for the IWRP are presented below. **Table 5-8** presents how these drivers were incorporated into the Planning Scenarios described in Section 2.2.

- The **Climate Change Impacts on Hydrology** driver captures risks that could change what Greeley’s water rights yield and the timing of that yield compared to what has been experienced historically. This is due to a combination of droughts of increased intensity, duration, and/or frequency compared to the historical record, and impact on runoff and the overall hydrograph from a warmer climate.
- The **Future Demand Uncertainty** driver captures risks that affect how much water demand Greeley’s system would need to meet in the future and how water is used compared to historical. This includes future built areas being different than historical, less outdoor water use, and potential regional demand needs.
- The **Water Rights Administration Complexity and Uncertainty** driver captures risks that affect Greeley’s ability to change currently owned water rights, acquire new water rights, and how existing and future water rights may yield. This includes increased competition for new water rights, the legal complexity of changing existing rights, and uncertainty of how water rights administration may change under a different hydrograph than historical.
- The **Colorado River Basin Issues** driver captures risks to Greeley’s yields from the Colorado River Basin which could result in a variety of short- and long-term reductions or curtailments of these supplies.

Table 5-8. Risk Driver Settings for Planning Scenarios

Driver Name	Incorporate Impact	Planning Scenario Settings
Climate Change Impacts on Hydrology	Change in temperature of future climate conditions compared to historical.	<ul style="list-style-type: none"> • No Change • +2°F Warmer • +5°F Warmer • +8°F Warmer
Future Demand Uncertainty	Rate of population growth paired with per capita water use.	<p><u>Population Growth Rate:</u></p> <ul style="list-style-type: none"> • Planned Growth • Increased Growth • Decreased Growth <p><u>Per Capita Water Use:</u></p> <ul style="list-style-type: none"> • Highest Per Capita Use • Planned Per Capita Use • Lowest Per Capita Use
Water Rights Administration Complexity and Uncertainty	Reductions in modeled water rights yield due to combination of inability to change water rights as assumed, acquire new water rights, and/or reductions in yield due to administration changes	<ul style="list-style-type: none"> • No Change • 10% Reduction in All Yields





Driver Name	Incorporate Impact	Planning Scenario Settings
Colorado River Basin Issues	Combination of short- and long-term Colorado River Basin yield reductions and curtailments due to Colorado River Basin administration and Compact compliance.	<u>High Impacts to Yields</u> <ul style="list-style-type: none"> • 5-year 25% Reduction in CBT/Windy Gap • 1-year 100% curtailment of CBT/Windy Gap • Chronic 10% reduction in CBT/Windy Gap <u>Moderate Impacts to Yields</u> <ul style="list-style-type: none"> • 5-year 25% Reduction in CBT/Windy Gap • 1-year 100% curtailment of CBT/Windy Gap <u>Low Impacts to Yields</u> <ul style="list-style-type: none"> • 2-year 25% Reduction in CBT/Windy Gap

Table 5-9 shows how the prioritized risks were included in the IWRP. Certain risks were included as a driver for Planning Scenarios (“Planning Scenarios”), as described above. Demand risks were primarily included by incorporating their potential impacts into the updated demand forecasts as described in Section 4. Hydrology risks were primarily included by incorporating their potential impacts into the updated hydrology as described in Section 6. Colorado River basin impacts were explicitly modeled in the GSM. Water Rights risks were included in both the Planning Scenarios and in the Water Rights Evaluation described in Section 10. Any risks that were not included using the above methodology will be included in the Adaptive Plan that will describe specific conditions to monitor and corresponding actions to trigger if the risk occurs.

Table 5-9. Methodology for Implementing Prioritized Risks in the IWRP

ID	Risk Name	IWRP Inclusion Methodology
CR1	Colorado River Basin Administrative Actions	Planning Scenarios
IO9	Increased Frequency/Severity of Poudre Wildfires	Adaptive Plan
WR2	Competition for New Water Rights	Water Rights Assessment Tool
CC1	Colorado River Administration CC Impacts	Planning Scenarios
CC3	Extended Droughts	IWRP Hydrology Dataset
CC4	Hydrologic CC Impacts	IWRP Hydrology Dataset
CR10	Yield Reduction - Multi Year	Simulated in GSM
D10	Regional Water Issues - Long Term	Adaptive Plan
CR9	Yield Reduction - Extended	Simulated in GSM
CC2	Evaporation Rate CC Impacts	Adaptive Plan
CC5	Increased Extreme Events	IWRP Hydrology Dataset
CC6	Municipal Water Use CC Impacts	IWRP Demand Projections
CC7	Water Rights Administration CC Impacts	Planning Scenarios and WR Assessment Tool
CR11	Yield Reduction - Single Year	Simulated in GSM
CR3	Chronic Yield Reduction - Windy Gap	Simulated in GSM
D4	Demand Hardening	Adaptive Plan
D6	High Impact Water Rates	IWRP Demand Projections
D7	Increased Suburban Growth	IWRP Demand Projections



INTEGRATED WATER RESOURCE PLAN

Risk Identification and Assessment



ID	Risk Name	IWRP Inclusion Methodology
IO17	Water Quality Regulation Changes	Adaptive Plan
IO5	Environmental Permitting Problems	Adaptive Plan
WR6	Water Rights Change Complexity	Planning Scenarios and WR Assessment Tool
CR4	Chronic Yield Reduction - Windy Gap and CBT	Simulated in GSM
CR5	Total Curtailment - Multi-Year, Windy Gap	Simulated in GSM
CR8	Total Curtailment - Single Year, Windy Gap and CBT	Simulated in GSM
D12	Service Area Expansion	Adaptive Plan
WR1	CBT Operational Changes	Adaptive Plan
CR6	Total Curtailment - Multi-Year, Windy Gap and CBT	Simulated in GSM
IO6	GW supplies cannot be used by Greeley	Adaptive Plan
D2	Demand Growth Exceeds Forecast	IWRP Demand Projections
IO10	Multi-Year CBT Infrastructure Outage	Adaptive Plan



6.0 FUTURE HYDROLOGY ANALYSIS

6.1 METHODOLOGY

The IWRP's future hydrology analysis developed a new climate change hydrology dataset to be simulated in the GSM. This new hydrology dataset improved the robustness of GSM simulations by incorporating impacts to Greeley's water supplies from droughts of different intensity, duration, and frequency in combination with impacts from long-term changes in temperature and precipitation. This analysis applied the methodology, tools, and data originally developed by Fort Collins during their Water Supply Vulnerability Study (FCU, 2019). In applying that study for the IWRP, Greeley reviewed the decisions and assumptions made and determined they were appropriate for IWRP application.

Figure 6-1 summarizes the methodology used to develop the climate change hydrology dataset. Each step is summarized in this section, with additional detail documented in IWRP Greeley System Model TM, included as Appendix C. The climate-related decisions in the WSVS (i.e., selection of models, emissions scenarios, downscaling methodology) were made to align the WSVS with the methodology used in the Joint Front Range Climate Change Vulnerability Study (WRF, 2012). Results of Global Climate Models (GCMs), which project future temperature and precipitation (T&P) mean changes, were applied to the Poudre River Watershed source. This ensemble or 'spread' of T&P changes was evaluated and combinations of T&P changes used to develop hydrology selected. A series of models was used to determine the water legally and physically available to Greeley (referred to as 'entitlements') for each T&P condition.



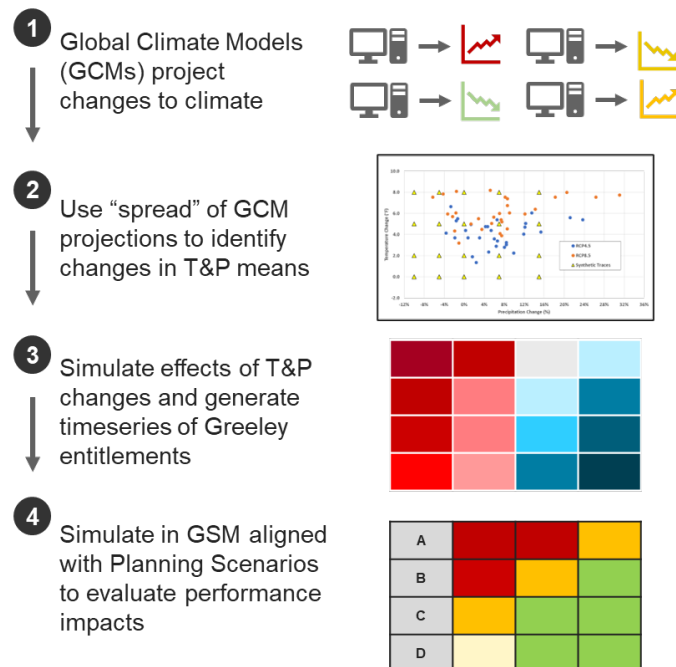


Figure 6-1. Summary of Climate Change Hydrology Dataset Development

The first step in developing the climate change hydrology dataset was establishing the long-term change in climate that could occur in Greeley’s source watersheds. GCMs project how long-term changes in climate, specifically temperature and precipitation, could occur based on different emission scenarios, warming trends, and other methodologies. This approach applied two emission scenarios to the full suite of available GCMs: RCP 4.5 assumes emissions peak around 2040 then decline while RCP 8.5 assumes emissions continue to rise throughout the twenty-first century.

The T&P changes compared to historical projected by the GCMs in the Upper Poudre Watershed between 2050 and 2074 for the two emissions scenarios described above is shown in **Figure 6-2**. The two respective GCMs used here project that the climate (i.e., mean annual temperature) will be 2°F and 8°F warmer but vary in mean annual precipitation projections, with some projecting a 5% drier climate and others projecting a 20%+ wetter climate. The yellow triangles are the combinations of T&P changes used in the IWRP. The selected T&P changes capture a majority of the T&P changes projected by the GCMs and include a drier condition (i.e., -10% precipitation, the left-most column of yellow triangles) consistent with a conservative planning approach.



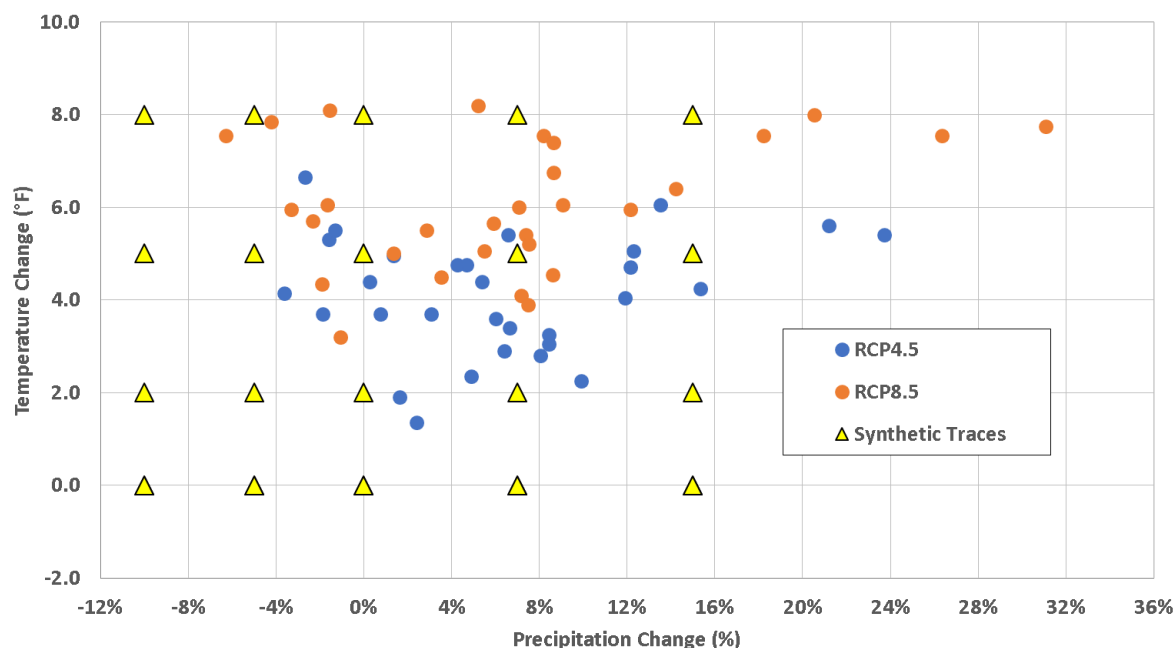


Figure 6-2. Projected Changes in Temperature and Precipitation Means in the Upper Poudre Watershed between 2050 and 2074

The selected T&P changes were applied to historical weather data and simulated in a hydrology model to generate natural watershed runoff in the Big Thompson, Colorado, and Poudre River Basins. The hydrology model developed for the Joint Front Range Climate Vulnerability Study (WRF, 2012) was used to generate natural watershed runoff. Prior to applying the T&P changes, the historical weather data was re-sequenced to generate new potential drought conditions, with six sequences selected based on their unique drought conditions. Ultimately 120 timeseries of natural watershed runoff (20 T&P changes applied to 6 drought conditions) were generated.

To translate natural watershed runoff in the Big Thompson and Poudre River Watersheds into legally and physically available water supplies for Greeley (known as entitlements), the existing Big Thompson Basin Network (BTBN) Model and the Poudre Basin Network (PBN) Model were applied. To determine Greeley’s quota from the Colorado-Big Thompson (CBT) Project, Northern’s CBT Quota model was applied. Because the PBN model includes all water users in the basin, the IWRP simulated the PBN Model under the two future conditions described below:

- PBN Run 2, as defined in "Summary of NISP/HSWSP CTP Model Runs and Modeling Conditions" (CDM Smith, 2013) was selected for the near-term
- A modified version of the CTP PBN Run 8, "Summary of NISP/HSWSP CTP Model Runs and Modeling Conditions" (CDM Smith, 2013) was selected for the long-term futures. These assumptions were further modified for the IWRP to exclude the expanded Seaman project and turn on CBT Carryover.





Initial simulations of the climate change hydrology in the BTBN and PBN models showed a significant increase of yields from junior water right systems under warming conditions. Analysis showed this increase was due to the peak runoff shifting in time, becoming misaligned from the agricultural demands (which are a majority of the senior water rights in the basins). To prevent overestimation of entitlements from Greeley’s junior water rights, the IWRP shifted agricultural demands in the BTBN and PBN models forward by one month for the +5°F and +8°F warmer climates – shown conceptually in **Figure 6-3**. Adjustments to agricultural demands outside of this shift were considered but ultimately deemed to be outside the scope of this project.

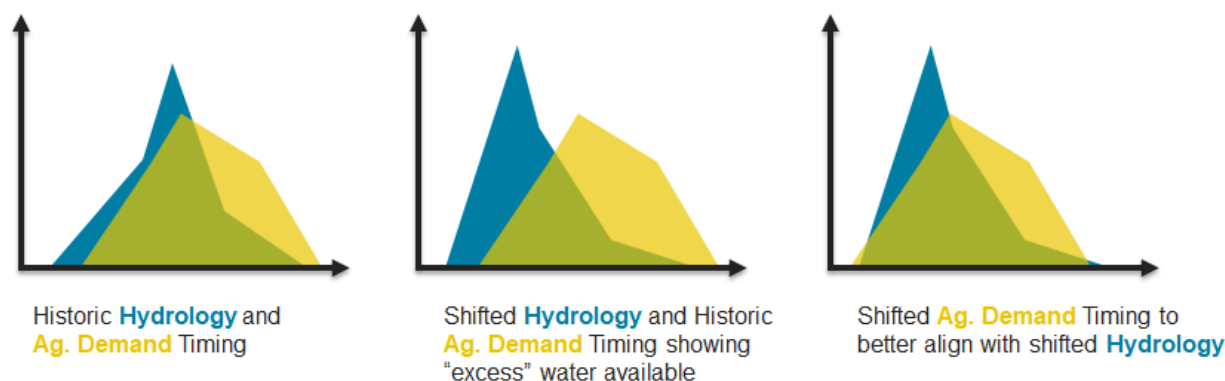


Figure 6-3. Conceptual Visual of Why Agricultural Demands Were Shifted for the IWRP

The final step in generating the climate change hydrology dataset was applying Greeley’s water rights ownership and corresponding conditions to outputs from the BTBN and PBN Models to determine Greeley’s entitlements from those basins. Due to the effects of climate change on the timing and volume of runoff, monthly and annual volumetric limits associated with Greeley’s water rights were applied to the results. These monthly and annual volumetric limits are based off historical hydrologic patterns and as climate change pushes the runoff season earlier in spring, Greeley could see reduced entitlements despite available water. Greeley’s entitlements from the climate change hydrology dataset capture the potential effect of the administrative constraint.

The climate change hydrology dataset developed using the methodology described above robustly captures the impacts of climate change and new possible droughts to Greeley’s entitlements.

6.2 DROUGHT CONDITIONS VARIABILITY RESULTS

This section presents how the different drought conditions selected for the IWRP could affect Greeley’s entitlements before climate change is applied. Annual entitlement values shown in this section are determined from outputs of PBN, BTBN, and CBT Models. As part of the Ft. Collins WSVS, six timeseries of droughts were selected based on how the drought was characterized compared to historical droughts. These droughts were also selected to be, on average, more severe than historical drought conditions in alignment with a conservative planning methodology. The six drought conditions and their corresponding historical characterization is shown in **Table 6-1**. As an example, **Figure 6-4** shows the timeseries of Greeley’s annual entitlements for historical hydrology and Timeseries 63. In Timeseries 63, there is a 3-





year period near the end of the timeseries where total annual entitlements are at or below the 2002 value – indicating a short and severe drought condition.

Table 6-1. Drought Timeseries Selected for the IWRP

Timeseries ID	Drought Characterization
15	Similar 10-year drought cycle to historical, greater severity
47	4 2002's in a 10-year period
52	Similar to Historical
63	Back-to-Back-to-Back 2002s
67	Severe 5-year drought
95	Drought and aridification

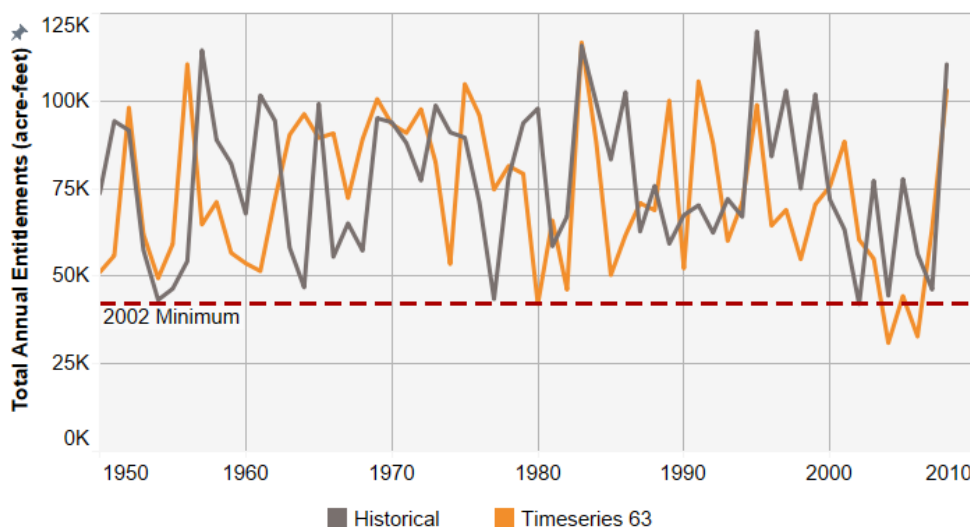


Figure 6-4. Annual Entitlements Timeseries of Historical and Synthetic Sequence 63

To numerically characterize drought conditions in the six drought timeseries, three statistics were evaluated: Greeley’s annual entitlements, and the 5-year and 10-year mean of those annual entitlements. These quantify the severity of individual years, mid-duration droughts, and longer-term drought cycles.

Figure 6-5 shows, using a box plot distribution, the variability of Greeley’s annual entitlements for historical hydrology compared to the six drought timeseries. In a box plot distribution, the solid line is the median value with the boxes extending to the 25th and 75th percentiles and the whiskers extending to the 5th and 95th percentile. Comparing the distribution of the historical data to the drought timeseries shows how the six drought timeseries have more frequent occurrences of single-year entitlements below the 2002 minimum.



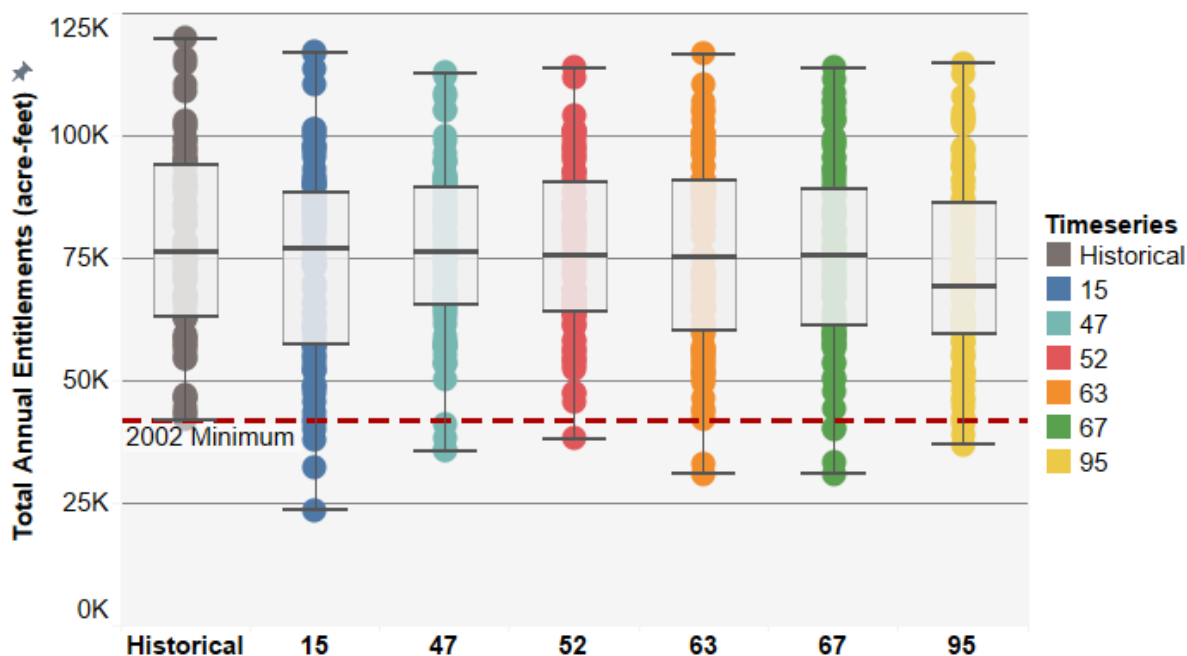


Figure 6-5. Distribution of Annual Entitlements for Historical and Synthetic Hydrology

Figure 6-6 shows, using a box plot distribution, the variability of the 5-year and 10-year Greeley annual entitlements mean for historical hydrology compared to the six drought timeseries. Comparing the distribution of the historical data to the drought timeseries shows how the six drought timeseries have more severe mid- and long-term droughts compared to the historical record. For example, nearly all drought traces have many occurrences of a 10-year mean below the historical low of 69,000 acre-feet per year. A similar trend is seen in the 5-year mean. This indicates the six drought timeseries have conditions with significantly drier mid- and long-term droughts.



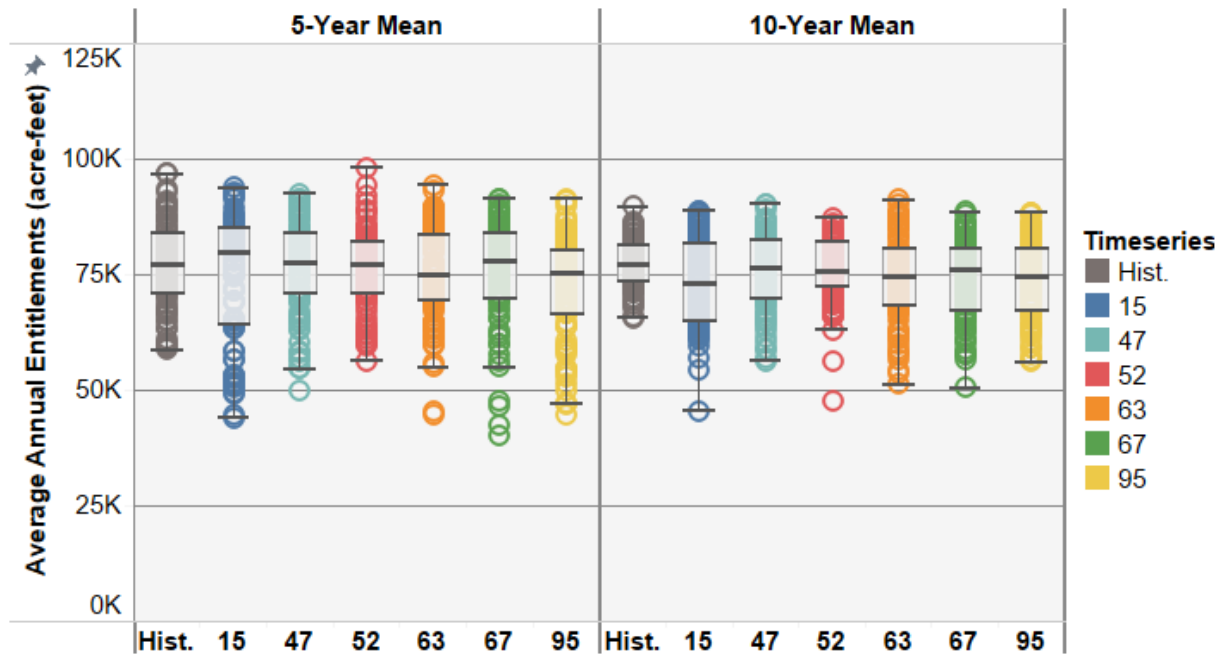


Figure 6-6. Distribution of 5-year and 10-year Mean Annual Entitlements for Historical and Synthetic Hydrology

The results above show the six drought timeseries selected for the IWRP will stress Greeley’s water supply system with droughts of greater intensity, duration, and frequency than the historical record. This outcome supports recommendations that could be robust to possible future droughts and is in alignment with a conservative planning methodology.





6.3 LONG-TERM CLIMATE CHANGE RESULTS

This section presents how the climate change-driven T&P mean changes could impact Greeley’s entitlements from the three major systems (Poudre River, CBT Project, and Big Thompson River). Results presented are for Greeley’s average annual entitlements, (e.g., legally and physically available water) displayed using a “T&P Grid,” and are shown conceptually in **Figure 6-7**. Each cell in the grid shows the average annual entitlement, averaged across the six drought timeseries described above, for a single T&P change condition.

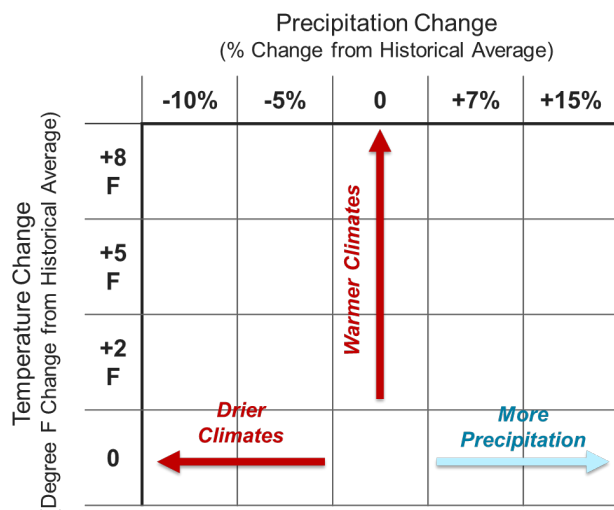


Figure 6-7. Example of Temperature and Precipitation Offset Results Presentation Grid

Figure 6-8 shows the effects of climate change on entitlements across Greeley’s entire water supply system. These results were used to develop the conclusion statements and associated confidence in those conclusion statements, shown in **Table 6-2**. In summary, Greeley’s water supply system is vulnerable to warming and/or drying climates. Results indicated that increases in precipitation could offset impacts to Greeley’s entitlements from a warming climate. However, there is significant uncertainty in how a shifting hydrograph could impact water use and administration. Additionally, the models used to allocate natural watershed runoff were not designed to account for a shifting hydrograph and may not simulate that impact with confidence. This is because demand patterns (both agricultural and municipal) and water right allocations are fixed based off historical use. It is possible that in response to a significantly shifted hydrograph, both demands and water right allocations could change. Thus, the effects of a warmer climate with increased precipitation on Greeley’s entitlements cannot be confidently quantified. Because of these uncertainties, the IWRP did not include warmer climates with increased precipitation when developing future recommendations.





Total Water Supply System Average Annual Entitlements (acre-feet per year)						Change from 0/0 Climate Average Annual Entitlements & Percent					
Delta T	Delta P					Delta T	Delta P				
	-10%	-5%	0	+7%	+15%		-10%	-5%	0	+7%	+15%
+8F	50,800	59,200	67,500	76,600	83,500	+8F	-24,600 -33%	-16,200 -21%	-7,800 -10%	1,200 2%	8,100 11%
+5F	51,000	59,000	67,100	75,700	82,200	+5F	-24,300 -32%	-16,300 -22%	-8,300 -11%	400 0%	6,800 9%
+2F	58,800	68,100	75,400	83,600	88,300	+2F	-16,600 -22%	-7,300 -10%	0 0%	8,200 11%	13,000 17%
0	59,300	68,300	75,400	82,600	87,200	0	-16,100 -21%	-7,100 -9%	0 0%	7,200 10%	11,800 16%

Figure 6-8. Average Annual Total Water System Entitlements Incorporating Climate Change Impacts

Table 6-2. Conclusion Statements of Total System Climate Change Impacts

Conclusion Statement	Confidence	Comment
Droughts of greater duration, frequency, and severity than observed are possible under current climate	High	<i>Results show these conclusions, they are consistent with other studies, and make logical sense.</i>
Climates with less precipitation will reduce Greeley's water supply system yields	High	
Warmer climates will impact Greeley's water supply system	High	
Greeley's water supply system is more vulnerable to reductions in precipitation than warmer temperatures	High	
Reductions in precipitation could decrease Greeley's entitlements between 20% and 30%	Moderate	<i>Specific yield reductions are difficult to quantify, but values in this range are plausible</i>
Climates with increased precipitation will mitigate impacts of a warming climate	Low	<i>Impacts from hydrograph changes cannot be confidently modeled with existing tools.</i>

Greeley's total water supply system entitlements derive from three major systems, with the Poudre River System divided into an Upper and Lower portion based on how these supplies can be delivered to Greeley. The proportion of typical entitlements from each system is shown in **Figure 6-9**. Each system has unique dynamics which can be impacted differently by climate change. The following subsections detail climate change impacts to each of these three systems.



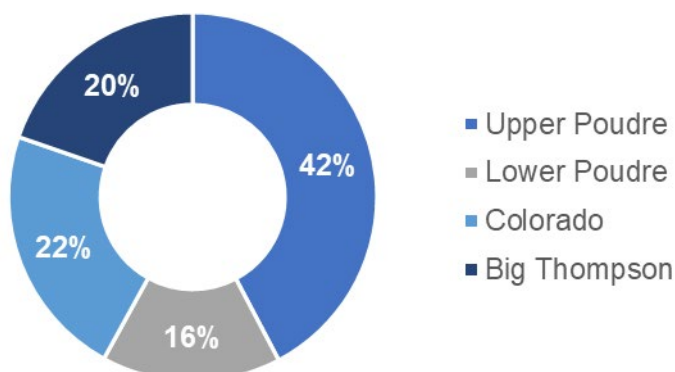


Figure 6-9. Distribution of Greeley's Typical Entitlements by Major System

6.3.1 Poudre River System Results

Figure 6-10 shows effect of climate change on Greeley's entitlements from the Upper Poudre System (e.g., locations west of Interstate 25). Figure 6-11 and Figure 6-12 shows the effect of climate change on subsystems within the Upper Poudre System. This system is vulnerable to warmer and drier futures and could see entitlement reductions between 10% and 35% under those conditions. Warmer conditions with increased precipitation, while showing an increase in entitlements, are difficult to quantify with confidence. The Poudre Direct and WSSC subsystems are the most resilient against climate change impacts due primarily to their seniority, though still have some entitlement reductions under warmer and drier conditions. The High Mountain Reservoirs, Seaman, and Upper Gravel subsystems are the most vulnerable to climate change impacts, with entitlements significantly reduced if climate warms by 5°F. This is due to the agricultural demands, which were shifted forward by one month in the 5°F and 8°F climate conditions. This is because these systems are more junior than direct Poudre rights. Other subsystems are moderately vulnerable to climate change impacts.





Upper Poudre System Average Annual Entitlements (acre-feet per year)						Change from 0/0 Climate Percent Change in Average Annual Entitlements					
Delta T	Delta P					Delta T	Delta P				
	-10%	-5%	0	+7%	+15%		-10%	-5%	0	+7%	+15%
+8F	19,700	22,400	25,300	30,100	35,400	+8F	-34%	-25%	-15%	1%	19%
							-10,200	-7,400	-4,500	300	5,600
+5F	18,700	20,900	24,300	28,900	34,600	+5F	-37%	-30%	-19%	-3%	16%
							-11,100	-8,900	-5,600	-900	4,800
+2F	22,800	26,600	30,500	36,000	40,200	+2F	-24%	-11%	2%	21%	35%
							-7,100	-3,200	600	6,200	10,400
0	22,500	26,300	29,800	35,200	39,600	0	-25%	-12%	0%	18%	33%
							-7,300	-3,600	0	5,300	9,800

Figure 6-10. Average Annual Upper Poudre System Entitlements Incorporating Climate Change Impacts

Upper Poudre Subsystems Average Annual Entitlements (acre-feet per year)						Change from 0/0 Climate Percent Change in Average Annual Entitlements						
	Delta T	Delta P					Delta T	Delta P				
		-10%	-5%	0	+7%	+15%		-10%	-5%	0	+7%	+15%
Poudre Directs	+8F	8,900	9,000	9,000	9,200	10,000	+8F	-5%	-5%	-4%	-2%	6%
	+5F	8,900	8,900	9,000	9,200	9,900	+5F	-6%	-6%	-5%	-3%	5%
	+2F	8,900	9,100	9,400	10,100	10,900	+2F	-5%	-4%	0%	7%	16%
	0	9,000	9,100	9,400	10,200	11,100	0	-5%	-4%	0%	8%	17%
HMR	+8F	1,500	2,400	3,400	4,900	6,100	+8F	-69%	-49%	-28%	4%	30%
	+5F	1,000	1,700	2,900	4,400	5,900	+5F	-78%	-64%	-39%	-7%	25%
	+2F	2,600	3,900	4,900	6,100	7,000	+2F	-44%	-17%	3%	31%	48%
	0	2,500	3,700	4,700	6,000	6,900	0	-47%	-20%	0%	27%	48%
Seaman	+8F	700	1,400	2,500	4,400	6,300	+8F	-83%	-67%	-41%	3%	50%
	+5F	400	1,000	2,200	4,300	6,500	+5F	-89%	-77%	-48%	1%	53%
	+2F	1,600	2,900	4,300	6,300	7,700	+2F	-62%	-31%	1%	49%	81%
	0	1,600	3,000	4,200	6,100	7,700	0	-63%	-30%	0%	45%	82%
Upper Gravel	+8F	0	0	100	600	1,800	+8F	-100%	-96%	-83%	-32%	114%
	+5F	0	0	200	700	1,800	+5F	-99%	-97%	-78%	-19%	114%
	+2F	100	200	800	2,000	3,200	+2F	-94%	-74%	-8%	138%	289%
	0	100	200	800	2,200	3,400	0	-90%	-77%	0%	159%	304%

Figure 6-11. Average Annual Upper Poudre Subsystems' Entitlements Incorporating Climate Change Impacts





Upper Poudre Subsystems						Change from 0/0 Climate						
Average Annual Entitlements (acre-feet per year)						Percent Change in Average Annual Entitlements						
	Delta T	Delta P						Delta P				
		-10%	-5%	0	+7%	+15%	Delta T	-10%	-5%	0	+7%	+15%
WSSC	+8F	3,900	4,200	4,500	4,700	4,700	+8F	-12%	-5%	0%	4%	6%
	+5F	3,900	4,200	4,400	4,600	4,800	+5F	-13%	-7%	-1%	4%	7%
	+2F	4,100	4,400	4,500	4,600	4,600	+2F	-8%	-2%	1%	3%	4%
	0	4,200	4,400	4,500	4,600	4,600	0	-7%	-3%	0%	2%	2%
Larimer and Weld	+8F	3,700	4,300	4,700	5,200	5,300	+8F	-25%	-13%	-4%	6%	7%
	+5F	3,400	3,900	4,300	4,500	4,400	+5F	-31%	-20%	-11%	-9%	-10%
	+2F	4,300	5,000	5,500	5,600	5,600	+2F	-12%	2%	11%	15%	14%
	0	4,100	4,700	4,900	4,900	4,700	0	-17%	-4%	0%	0%	-5%
New Cache	+8F	1,000	1,100	1,100	1,200	1,200	+8F	-22%	-16%	-10%	-4%	-1%
	+5F	1,100	1,200	1,300	1,300	1,300	+5F	-10%	-4%	0%	4%	6%
	+2F	1,100	1,100	1,200	1,200	1,300	+2F	-13%	-11%	-6%	-3%	0%
	0	1,200	1,200	1,300	1,300	1,300	0	-8%	-4%	0%	3%	4%

Figure 6-12. Average Annual Upper Poudre Subsystems’ Entitlements Incorporating Climate Change Impacts (Continued)

Figure 6-13 shows the effect of climate change on Greeley’s entitlements from the Lower Poudre System (e.g., locations east of Interstate 25). This system is vulnerable to drier climates but is likely resilient against warmer climates and changes to agricultural demand changes. This is due to the influence of return flows, which are greater at this reach of the Poudre, lessening the influence of snowmelt on the hydrograph.





Lower Poudre System Average Annual Entitlements (acre-feet per year)						Change from 0/0 Climate Percent Change in Average Annual Entitlements					
Delta T	Delta P					Delta T	Delta P				
	-10%	-5%	0	+7%	+15%		-10%	-5%	0	+7%	+15%
+8F	9,100	10,300	11,300	12,100	12,600	+8F	-18%	-7%	2%	9%	13%
							-2,000	-800	200	1,000	1,400
+5F	9,500	10,800	11,400	12,200	12,500	+5F	-14%	-3%	2%	10%	12%
							-1,600	-300	300	1,100	1,300
+2F	9,600	10,400	10,900	11,900	12,600	+2F	-14%	-6%	-2%	7%	13%
							-1,600	-700	-300	800	1,400
0	9,900	10,800	11,100	12,100	12,500	0	-11%	-3%	0%	8%	12%
							-1,300	-400	0	900	1,300

Figure 6-13. Average Annual Lower Poudre System Entitlements Incorporating Climate Change Impacts

These results presented above were used to develop the conclusion statements and associated confidence in those conclusion statements, shown in **Table 6-3**. In summary, the Poudre System is vulnerable to climate change impacts, with the Poudre Direct and WSSC subsystems being the most resilient against climate change impacts. However, due to the difficulty in confidently simulating the impacts of climate change on the complex operations of the Poudre River Basin, there is significant uncertainty with the numerical impact values. One significant trend from the results is that the greater the seniority of the subsystem, the more resilient the subsystem is against impacts from climate change.

Table 6-3. Conclusion Statements of Upper Poudre System Climate Change Impacts

Conclusion Statement	Confidence	Comment
Poudre Direct and WSSC entitlements are the most resilient to climate change and agricultural demand timing impacts.	High	<ul style="list-style-type: none"> Greeley's ability to utilize entitlements will be evaluated from GSM results. Uncertainties around results are captured in the 10% entitlement reduction risk.
HMRs ¹ , Seaman, and Upper Gravel entitlements are the most vulnerable to climate change and agricultural demand timing impacts.	High	
Larimer & Weld and New Cache entitlements are moderately vulnerable to climate change and agricultural demand timing impacts.	High	
The Lower Poudre system is moderately vulnerable to climate change impacts but resilient to agricultural demand timing impacts.	High	
The changes in entitlements due to climate change will occur as simulated.	Low	There is significant uncertainty in how long-term climate will impact hydrology, operations, and yields in the Poudre Basin

¹ High Mountain Reservoirs





6.3.2 Colorado-Big Thompson Project System Results

Figure 6-14 shows effect of climate change on Greeley’s entitlements from the CBT System (e.g., driven by the quota set by Northern). This system is vulnerable to warmer and drier futures and could see entitlement reductions between 5% and 35% under those conditions. Warmer conditions with increased precipitation show decreases in entitlements due to the methodology Northern Water uses to set the quota (e.g., it is supplemental water and greater precipitation could reduce the need for CBT water supplies and thus result in a lower quota). These results presented were used to develop the conclusion statements and associated confidence in those conclusion statements, shown in **Table 6-4**. It is important to note that events that could compound from warmer and/or drier conditions, such as a Colorado River Compact curtailment, are not included in these results. The IWRP is evaluating impacts from the Colorado River Compact curtailment as a separate risk, as described in Section 2.2.

CBT System Average Annual Entitlements (acre-feet per year)						Change from 0/0 Climate Average Annual Entitlements & Percent					
Delta T	Delta P					Delta T	Delta P				
	-10%	-5%	0	+7%	+15%		-10%	-5%	0	+7%	+15%
+8F	10,100	12,100	14,000	15,500	15,500	+8F	-36% -5,600	-23% -3,600	-11% -1,700	-1% -100	-1% -200
+5F	10,900	13,000	14,700	15,800	15,400	+5F	-31% -4,800	-17% -2,700	-6% -1,000	1% 100	-2% -300
+2F	11,800	13,800	15,200	15,800	15,100	+2F	-25% -3,900	-12% -1,900	-3% -500	0% 100	-4% -600
0	12,400	14,300	15,700	15,700	14,900	0	-21% -3,300	-9% -1,400	0% 0	0% 0	-5% -800

Note: Windy Gap Yields Not Included

Figure 6-14. Average Annual Colorado-Big Thompson System Entitlements Incorporating Climate Change Impacts

Table 6-4. Conclusion Statements of Colorado-Big Thompson System Climate Change Impacts

Conclusion Statement	Confidence	Comment
Greeley’s entitlements from the Colorado-Big Thompson Project are vulnerable to hydrologic climate change impacts.	High	Other climate change impacts (basin-wide, demand management, agricultural uses) are not accounted for in the climate hydrology. Impacts of curtailments of Colorado Basin supplies are captured as a separate risk.
The changes in entitlements due to climate change will occur as simulated.	Low	There is significant uncertainty in how long-term climate will impact hydrology, operations, and yields from the Colorado-Big Thompson Project





6.3.3 Big Thompson River System Results

Figure 6-15 shows effect of climate change on Greeley’s entitlements from the Big Thompson System. Figure 6-16 shows the effect of climate change on subsystems within the Big Thompson System. The system is vulnerable to warmer and drier futures and could see entitlement reductions between 15% and 50% under those conditions. Warmer conditions with increased precipitation, while showing an increase in entitlements, are difficult to quantify with confidence.

Evaluating the entitlement impacts of the Big Thompson subsystems highlights the sensitivity of these systems to a changing hydrograph and timing of agricultural demands. Entitlements from Boyd Lake, Loveland Lake, and Seven Lake inflows all increase in entitlements if climate warms by 2°F, but are then significantly reduced if climate warms by 5°F. This is due to the agricultural demands, which were shifted forward by one month in the 5°F and 8°F climate conditions. The Direct GLIC subsystem has a different behavior, but still exhibits high sensitivity to both climate warming and the timing of agricultural demands.

Big Thompson System						Change from 0/0 Climate					
Average Annual Entitlements (acre-feet per year)						Average Annual Entitlements & Percent					
Delta T	Delta P					Delta T	Delta P				
	-10%	-5%	0	+7%	+15%		-10%	-5%	0	+7%	+15%
+8F	7,100	9,500	12,000	14,000	15,100	+8F	-49%	-31%	-13%	1%	9%
							-6,800	-4,400	-1,900	100	1,200
+5F	7,100	9,500	11,900	14,000	14,900	+5F	-49%	-31%	-14%	1%	7%
							-6,800	-4,400	-2,000	100	1,000
+2F	9,900	12,400	14,000	15,100	15,600	+2F	-28%	-11%	1%	9%	12%
							-4,000	-1,500	100	1,200	1,700
0	9,700	12,100	13,900	14,800	15,400	0	-30%	-13%	0%	7%	11%
							-4,200	-1,800	0	900	1,500

Figure 6-15. Average Annual Big Thompson System Entitlements Incorporating Climate Change Impacts





Big Thompson Subsystems						Change from 0/0 Climate						
Average Annual Entitlements (acre-feet per year)						Average Annual Entitlements & Percent						
	Delta T	Delta P					Delta T	Delta P				
		-10%	-5%	0	+7%	+15%		-10%	-5%	0	+7%	+15%
Direct GLIC	+8F	2,300	2,700	3,200	3,800	4,500	+8F	-40%	-28%	-16%	0%	19%
	+5F	3,300	3,900	4,600	5,500	6,200	+5F	-13%	3%	22%	44%	64%
	+2F	2,000	2,400	2,800	3,400	4,200	+2F	-46%	-36%	-25%	-10%	10%
	0	2,700	3,200	3,800	4,500	5,400	0	-29%	-16%	0%	19%	43%
Boyd Lake Inflows	+8F	1,200	2,100	3,100	3,400	3,200	+8F	-64%	-37%	-8%	1%	-6%
	+5F	800	1,600	2,300	2,400	2,000	+5F	-77%	-53%	-32%	-29%	-42%
	+2F	2,800	3,800	4,200	4,000	3,400	+2F	-16%	13%	25%	19%	2%
	0	2,300	3,100	3,400	3,000	2,400	0	-32%	-8%	0%	-11%	-30%
Lake Loveland Inflows	+8F	2,400	3,000	3,600	4,200	4,500	+8F	-41%	-26%	-13%	1%	9%
	+5F	2,100	2,700	3,200	3,900	4,300	+5F	-50%	-35%	-21%	-4%	4%
	+2F	3,300	3,800	4,200	4,500	4,700	+2F	-21%	-7%	2%	10%	14%
	0	3,000	3,700	4,100	4,500	4,600	0	-26%	-10%	0%	8%	12%
Seven Lakes Inflow	+8F	1,200	1,700	2,200	2,700	3,000	+8F	-54%	-37%	-18%	1%	13%
	+5F	900	1,400	1,800	2,200	2,500	+5F	-64%	-48%	-34%	-17%	-6%
	+2F	1,800	2,400	2,800	3,200	3,300	+2F	-31%	-11%	5%	19%	25%
	0	1,700	2,100	2,600	2,900	3,000	0	-36%	-19%	0%	9%	13%

Figure 6-16. Average Annual Big Thompson Subsystems' Entitlements Incorporating Climate Change Impacts

These results presented were used to develop the conclusion statements and associated confidence in those conclusion statements, shown in **Table 6-5**. It is important to note that events that could compound from warmer and/or drier conditions, such as a Colorado River Compact curtailment, are not included in these results.

Table 6-5. Conclusion Statements of Big Thompson System Climate Change Impacts

Conclusion Statement	Confidence	Comment
Greeley's entitlements from the Big Thompson System are vulnerable to climate change impacts.	High	<i>Due to the junior nature of the Big Thompson Subsystems Greeley has ownership in, entitlements are likely to be highly vulnerable to changes in water supply volume and timing changes. This could be compounded by how senior agricultural users change their water supply use in the future.</i>
Greeley's entitlements from the Big Thompson System are vulnerable to the timing of agricultural demands.	High	<i>Due to the junior nature of the Big Thompson Subsystems Greeley has ownership in, entitlements are likely to be highly vulnerable to changes in water supply volume and timing changes. This could be compounded by how senior agricultural users change their water supply use in the future.</i>
Warmer climates with no change in precipitation or an increase in precipitation will increase Greeley's entitlements from the Big Thompson System.	Low	<i>There is significant uncertainty in how long-term climate will impact hydrology, operations, and yields within the Big Thompson River system.</i>





6.4 CONCLUSION

The IWRP's future hydrology analysis developed a new climate change hydrology dataset that captures the potential impacts of long-term climate change paired with droughts of increasing intensity, duration, and frequency. GCMs project changes in long-term T&P means for the Upper Poudre Watershed between 2050 and 2074 for both a moderate and high emissions scenario. GCM results indicated future climates will be between 2°F and 8°F warmer with between 10% less precipitation and 15% more precipitation. This spread of T&P changes was applied to a series of models that quantified how changes could impact Greeley's entitlements (e.g., water legally and physically available to Greeley).

Evaluating how changes in long-term T&P means could impact Greeley's entitlements showed consistent impacts across the three major river basins. Greeley's water supply system is vulnerable to warmer and/or drier climates, with results indicating these climates could reduce Greeley's entitlements. Some subsystems such as Poudre Direct and WSSC are more resilient against climate change impacts. Results from future climates that are warmer but have increased precipitation, while showing a potential increase in Greeley's entitlements, are highly uncertain. Warmer temperatures could alter the runoff pattern and hydrograph - the effect of that shift on the complex operations within the Big Thompson River and Poudre River basins cannot be confidently modeled. The most significant operational uncertainty in these basins is how agricultural demands and their corresponding water rights administration might change in response to a warmer climate. Results from this analysis showed that impacts to Greeley's entitlements from changes in agricultural demands could be as significant as impacts from climate change – especially in more junior water rights systems.

Results from this future hydrology analysis highlighted both the vulnerability of Greeley's water supply system to climate change impacts and the significant uncertainty of those impacts. The IWRP addressed these using the techniques listed below:

- Multiple climate change futures with increased warming were selected for the Planning Scenarios.
- Climate change conditions with increased precipitation were not included in Planning Scenarios due to the significant uncertainty around effects on entitlements.
- Some Planning Scenarios included an additional 10% reduction in entitlements to capture the uncertainty in agricultural demand and water right administration impacts.



7.0 TERRY RANCH PROJECT EVALUATION

This section provides an overview of the Terry Ranch project and presents the methodology and assumptions used to incorporate that project into the IWRP modeling. The information on the Terry Ranch Project presented in this section is limited to what was relevant for the IWRP, additional information on the Terry Ranch Project can be found in Greeley's Terry Ranch Project information section of the Water & Sewer Department website.

7.1 OVERVIEW OF TERRY RANCH PROJECT

The Terry Ranch Project will develop approximately 1.2 million acre-feet of non-tributary (i.e., does not flow from or to a surface water supply source) groundwater in northwest Weld County. The Terry Ranch Project is an aquifer storage and recovery project. In this type of project, treated surface water can be injected into the aquifer and stored and then recovered at a future time to be treated and delivered as water supply. Once brought online, Terry Ranch Project water will be used as a supply source during droughts when surface water supplies are stressed. Greeley plans to operate Terry Ranch 'sustainably' such that the aquifer supplies will be available to Greeley in perpetuity and would not be depleted.

The 1.2 million acre-feet of Terry Ranch Project water (referred to as Terry Ranch Project native supply) is already in the ground and is protected from droughts and other identified risks such as wildfires and Colorado River Compact curtailments. The same aquifer with the Terry Ranch Project native supply can also be used to store excess surface water supply by injecting treated water into the aquifer. This allows Greeley to use the same infrastructure facilities to inject excess surface water supplies during wet years and extract/recover water from the aquifer in drought years.

To utilize the Terry Ranch Project, Greeley will need to develop new conveyance, treatment, and wellfield infrastructure and integrate it into the existing water supply system. **Figure 7-1** shows the major infrastructure features and their locations. Terry Ranch Water will be extracted from primarily new wells, treated at a new centralized plant, and transmitted to Greeley via a new transmission pipeline. Water from the Terry Ranch Project will be delivered to Greeley via the existing Bellvue Transmission System using a new intertie with the Terry Ranch Transmission Pipeline. Facilities will be bi-directional, where surface water supplies can be delivered via the Bellvue Transmission System and injected into the Terry Ranch Aquifer. Note that extraction and injection cannot occur simultaneously.



INTEGRATED WATER RESOURCE PLAN

Terry Ranch Project Evaluation

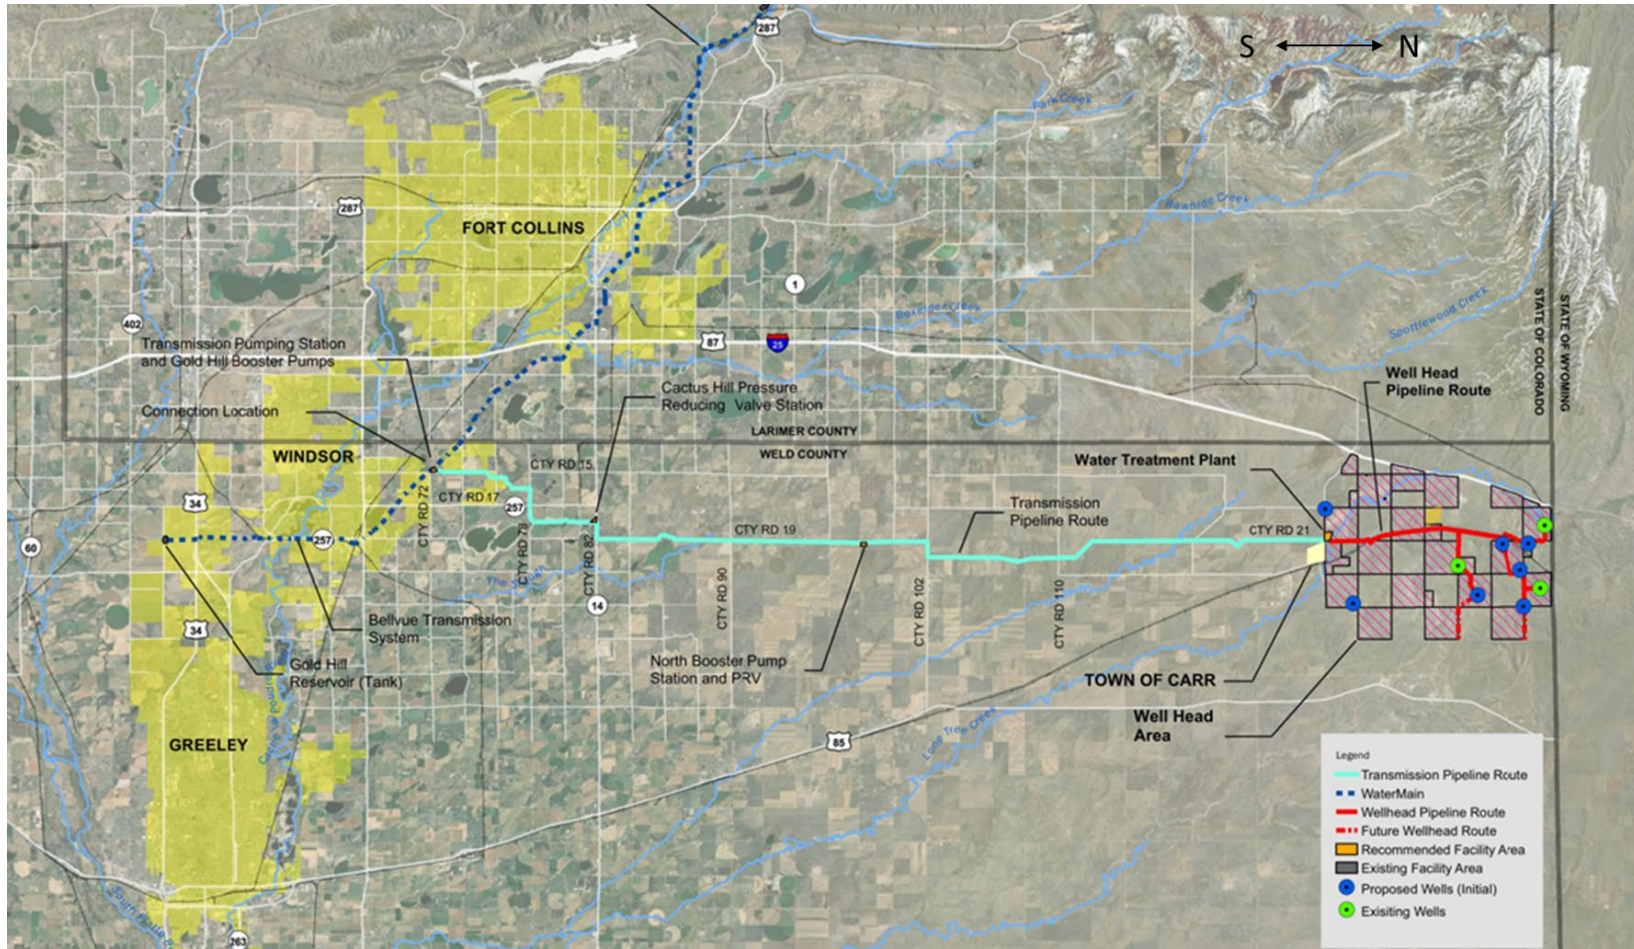


Figure 7-1. Terry Ranch Project Map. North is oriented on the right side of the map.





7.2 SIMULATION IN GSM

The IWRP evaluated a single Terry Ranch condition where it is fully developed and integrated into Greeley’s water supply system. In practice, the Terry Ranch Project can be developed in phases which will be evaluated in future studies. In this condition, Terry Ranch can inject surface water supplies delivered via the Bellvue treatment plant and extract Terry Ranch native and injected supplies for delivery to Greeley up to the project’s currently estimated maximum size. This section summarizes how Terry Ranch was implemented in and operated by the GSM for the IWRP. A more detailed description is included in the Greeley System Model TM, included as Appendix C.

Table 7-1 lists the key physical and infrastructure assumptions in the GSM of the Terry Ranch Project used for the IWRP. These assumptions were based off the maximum size Greeley could ultimately build Terry Ranch out to as well as the best understanding of the well operations at the time of the IWRP.

Table 7-1. Summary of Terry Ranch Facility Assumptions used in the GSM

Terry Ranch Feature	IWRP GSM Assumption
Initial Native Storage Volume	1,200,000 acre-feet
Maximum Aquifer Storage Capacity	1,500,000 acre-feet
Number of Wells ¹	30
Total Extraction Capacity	30 cfs
Extraction Losses	7%
Total Injection Capacity	22.5 cfs
Minimum Injection Rate	25% of Injection Capacity
Injection Losses	2%
Greeley Drought Restriction Policy	Level 1 Trigger: 75% of annual demands Level 2 Trigger: 60% of annual demands Level 3: Not Used

¹ Maximum feasible number of wells at the time of the IWRP.

When operating the Terry Ranch Project, the GSM is limited in its ability to balance injection and extraction to/from Terry Ranch with the surface water supply system. This is due to the monthly timestep and the limitations of GSM logic in capturing the nuances of Greeley’s system that real-life operators can account for. For the IWRP, the Terry Ranch Project operating logic in the GSM was developed to best address these limitations and is summarized below:





1. On April 1, determine if Greeley’s surface water storage on April 1st of the next year would be less than 0.75 years of demand (YOD) (e.g., a ‘storage shortage’).
 - a. If a ‘storage shortage’ is projected, the GSM proactively extracts water over the next 12 months from Terry Ranch to make up the deficit.
 - b. If next year’s projected storage is greater than 1.0 YOD, the GSM proactively injects water into Terry Ranch between October and April such that the excess storage is injected into Terry Ranch.
 - c. If next year’s projected storage is between 0.75 YOD and 1.0 YOD, Terry Ranch is not operated proactively for injection or extraction.
2. If during any month there is water entitled to Greeley that cannot be captured in the surface water system (referred to as a ‘spill’) that can be physically moved to Terry Ranch, the GSM opens injection pathways to reactively inject this spill volume into Terry Ranch.
3. If during any month Greeley would experience a demand shortage, the GSM reactively extracts this demand shortage volume from Terry Ranch.
4. Terry Ranch must always be operated at a minimum rate of 130 acre-feet per month (based on 30 wells) to sufficiently cycle the wells. If injectable supplies are not available, then the GSM will extract water from Terry Ranch to meet this minimum rate.

7.3 SUSTAINABLE USE

A unique aspect of the Terry Ranch Project in the context of the IWRP is its native volume of approximately 1.2 million acre-feet, significantly higher than Greeley’s current demands. This native volume could be further increased with injection of surface water supplies into Terry Ranch up to 1.5 million acre-feet total. As opposed to surface water supplies that can vary significantly from year to year and are vulnerable to climate change impacts, water from Terry Ranch can be extracted as needed even during the most severe droughts. Greeley plans to operate Terry Ranch ‘sustainably’ such that the aquifer supplies will be available to Greeley in perpetuity and would not be depleted. Certain future conditions could require the additional water resources opportunities described in Section 7.4.

As the IWRP simulated Terry Ranch in the GSM and used quantitative results to evaluate the performance of the system, the ‘sustainable’ use of Terry Ranch had to be established. The primary metric used to establish sustainable use of Terry Ranch was the percent of aquifer storage at the end of a GSM simulation compared to the initial aquifer storage volume of 1.2 million acre-feet. GSM simulations were 86 years long and contain a variety of hydrology conditions that alternative between droughts of differing intensity, duration, and frequency with wetter years. If after 86 years of operation, the Terry Ranch aquifer volume was at least 80% of the initial water supply volume of 1.2 million acre-feet, the long-term operations of Terry Ranch were considered sustainable. These criteria are an initial planning threshold used for the IWRP and will be refined and updated as further Terry Ranch analysis is completed.





7.4 ADDITIONAL WATER RESOURCES OPPORTUNITIES INCLUDED

The Terry Ranch Project is Greeley’s long-term new water supply source to deliver sustainable and affordable water through increasing demands, a changing climate, and other potential risks. The Terry Ranch Project’s superior performance compared to other large water supply projects was previously determined and as such, other large water supply projects were not evaluated in the IWRP. However, two water resources opportunities that could improve the sustainability of Terry Ranch if needed were evaluated in the IWRP and are described below.

- **Additional Surface Water Rights** – Greeley has developed a water rights acquisition strategy that bridges water supply needs prior to Terry Ranch Project completion using water rights that can be integrated into Terry Ranch or supplement Greeley’s growing non-potable system. If needed, Greeley could pursue more water rights than what is included in the existing water rights portfolio. For the IWRP, two surface water right conditions (moderate acquisition of water rights and low acquisition of water rights) were available if Terry Ranch sustainability was insufficient.
- **Retiming Storage** – Terry Ranch can store Greeley entitlements that cannot be captured in the surface water supply system (referred to as ‘spills’). These spills typically occur for a short duration during the runoff season. Due to limitations in Terry Ranch delivery and injection infrastructure, not all spills may be captured using the baseline assumed infrastructure. Greeley could develop ‘retiming storage’ that would capture these excess spills, store them, then gradually inject them into Terry Ranch when there is pipeline capacity. This retiming storage project was defined conceptually for the IWRP, with a maximum assumed capacity of 15,000 acre-feet. Post-IWRP analysis will further develop this retiming storage concept.





8.0 NEAR-TERM 10-YEAR ANALYSIS RESULTS

The IWRP near-term analysis simulated Greeley’s current and baseline water rights portfolio in the GSM across the IWRP Planning Scenarios. This analysis established the performance of Greeley’s currently planned water supply system to highlight potential future vulnerabilities and their severity. The current and baseline assumptions are described in Section 2.3. The Planning Scenario conditions applied in the GSM are shown in **Table 8-1**.

Table 8-1. Near-Term Planning Scenario Conditions

Planning Scenario Name	Climate Change	Colorado River Basin Impacts	Water Supply System
Unbearable	5°F Warmer	High Impacts	10% Reduced Yields
Stressed	5°F Warmer	Moderate Impacts	10% Reduced Yields
Continued Trends	2°F Warmer	Moderate Impacts	10% Reduced Yields
Optimistic	2°F Warmer	Low Impacts	No Reduction
No Climate Change	No Change	Low Impacts	No Reduction

Table 8-2 shows the simulated performance for the current and baseline water rights portfolios across the five Planning Scenarios. Values shown contain the GSM results across the six timeseries presented in **Table 6-1**. Cell values are colored with respect to the planning performance criteria of 1) drought restrictions occurring in less than 20% of years, 2) Level 3 drought restrictions occurring in less than 10% of years, and 3) meeting indoor demands in 100% of years. Results show that the current water rights portfolio will be insufficient to meet the planning performance criteria under the conditions in the Continued Trends, Stressed, and Unbearable planning scenarios. With the baseline water rights portfolio, the performance of the system under the Continued Trends conditions meets the planning performance criteria. The Unbearable and Stressed Planning Scenarios, while not meeting the overall percent of years in drought restrictions performance criteria, are close to meeting the Level 3 drought restrictions criteria. Indoor demands are met in all Planning Scenarios regardless of water rights portfolio.





Table 8-2. Near-Term Analysis Performance Results

Water Rights Portfolio	Planning Scenario	Percent of Years in Drought Restrictions	Percent of Years in Level 3 Drought Restrictions	Percent of Years with April 1 Storage > 6 months of Indoor Demand	Percent of Years Meeting indoor demands
Current	Unbearable	86%	51%	99.8%	100%
	Stressed	76%	41%	99.6%	100%
	Continued Trends	33%	14%	100%	100%
	Optimistic	15%	4%	100%	100%
	No Climate Change	11%	1%	100%	100%
Baseline	Unbearable	38%	12%	100%	100%
	Stressed	32%	11%	100%	100%
	Continued Trends	7%	0%	100%	100%
	Optimistic	0%	0%	100%	100%
	No Climate Change	0%	0%	100%	100%

Color Key Indicates Planning Performance Criteria: Green Passes, Yellow is close to meeting, Red Fails

Figure 8-1 shows the April 1st total system storage and drought restriction level under the No Climate Change Planning Scenario with Greeley’s current water rights portfolio for one of the six hydrology simulated, which included back-to-back-to-back 2002 conditions. Under these conditions, the water supply system does not need drought restrictions except in year 55 when a single Level 2 restriction is required. This is at the very end of the severe drought conditions and demonstrates strong resilience.

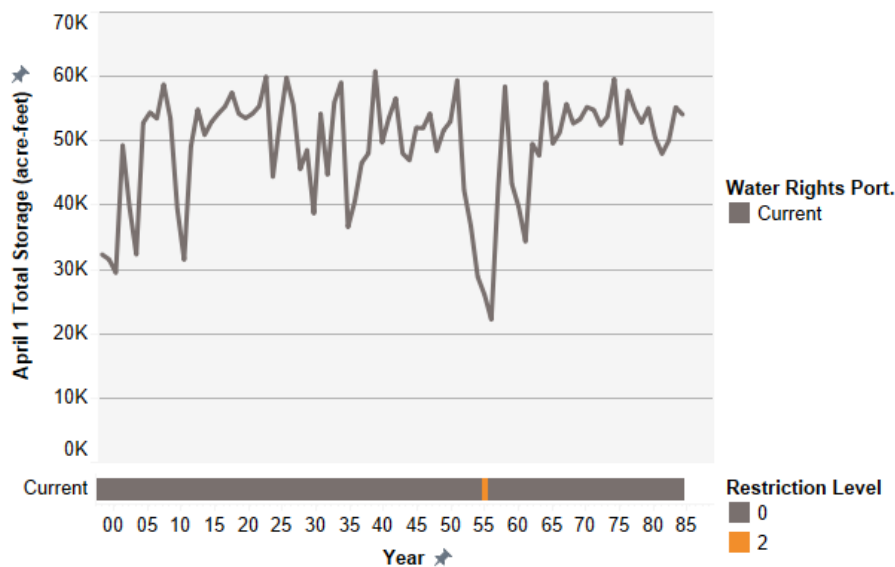


Figure 8-1. April 1 Storage Under No Climate Change Planning Scenario with Current Water Rights





Figure 8-2 shows the April 1st total system storage and drought restriction level under the Continued Trends Planning Scenario for the same sample hydrology as Figure 8-1 comparing the current and baseline water rights portfolio. With the current water rights portfolio, the water supply system needs three consecutive drought restrictions, including back-to-back level 3 restrictions during the severe drought period. When the baseline water rights are applied, the water supply system requires only a single level 2 restriction during the same drought period. This shows the benefit to the water supply system of changing all water rights as assumed in the baseline water rights portfolio.

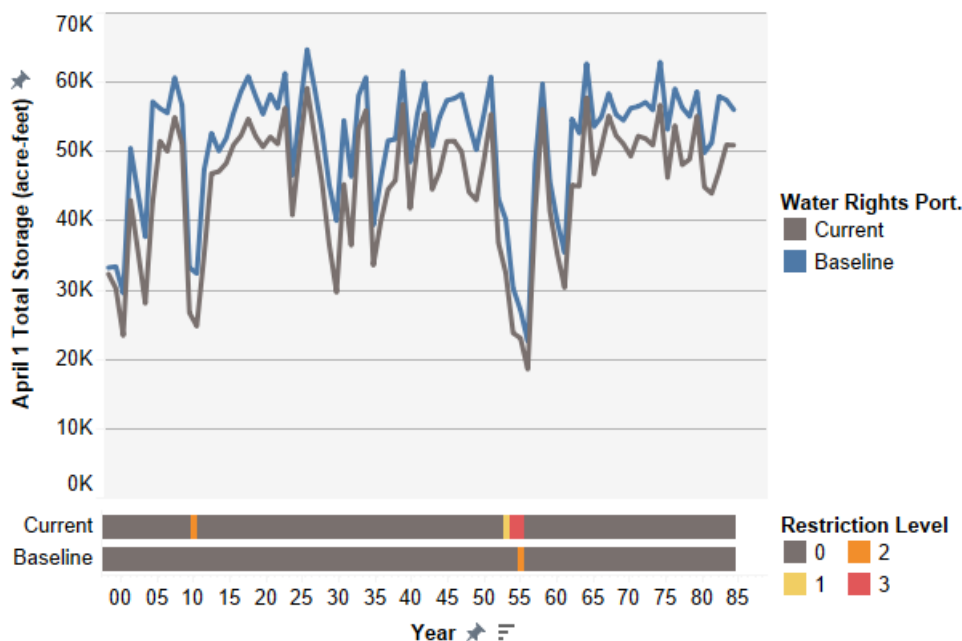


Figure 8-2. April 1 Total System Storage Under Continued Trends Planning Scenario Comparing Current and Baseline Water Rights

Results from the baseline analysis supported the conclusions below regarding Greeley’s water supply system. Note that this analysis used Greeley’s current demands of approximately 25,000 acre-feet, and the Terry Ranch Timing analysis described in Section 10.2 evaluates demand growth.

- The current water rights portfolio under current demands is sufficient to meet the Planning Scenario conditions anticipated to occur over the next decade. This includes conditions with mild warming and some Colorado River Basin risks.
- If the more stressful conditions of the Continued Trends Planning Scenario occur, Greeley will need the baseline water rights portfolio to meet planning performance criteria under current demands. This emphasizes the importance of Greeley changing existing water rights to municipal use in the near-term to improve robustness against more stressful futures.
- If the most stressful conditions in the Unbearable or Stressed Planning Scenarios occur, Greeley will need to do more than what is in the baseline water rights portfolio to meet planning performance criteria. This establishes the importance of the Terry Ranch Project in order to ensure a sustainable water supply for Greeley in the long-term.





9.0 TERRY RANCH TIMING AND INTEGRATION RESULTS

The IWRP evaluated the Terry Ranch Project using two of the Planning Horizons. The Terry Ranch Timing analysis established the water supply system and demand conditions under which the Terry Ranch Project would be required. The Terry Ranch Integration analysis established how Greeley could use the Terry Ranch Project after it is fully integrated (e.g., extracting and injecting water at the maximum feasible capacity) and if that use was sustainable. The IWRP used results from the Terry Ranch Timing analysis to recommend an approach for triggering the Terry Ranch Project. Results from the Terry Ranch Integration analysis were used to identify other water resources opportunities that would improve Terry Ranch operations that Greeley may need to act on in the next 10 years.

9.1 METHODOLOGY

The methodology for the Terry Ranch Timing and Terry Ranch Integration analyses used related approaches and tools for consistent evaluation, but a different overall analysis process. The Terry Ranch Timing analysis focused on determining the maximum demand Greeley’s baseline water supply system (without Terry Ranch) could meet while meeting the planning performance criteria described in Section 2.4. The Terry Ranch Integration analysis focused on determining if the use of Terry Ranch once fully implemented is sustainable using the sustainability criteria described in Section 7.3. Both analyses used the GSM to complete water supply system simulations and applied the Planning Scenarios.

In the GSM, the Terry Ranch Timing analysis simulated the Planning Scenario settings shown in **Table 9-1** across the baseline system described in Section 2.3 under annual potable demands from 28,000 acre-feet per year to 40,000 acre-feet in 2,000 acre-foot increments. Performance results were compared to the planning performance criteria defined in Section 2.4 to determine the maximum demand the baseline system could supply to Greeley. The climate conditions selected for the Terry Ranch Timing analysis reflected possible climates around the year 2040.

Table 9-1. Planning Scenario Settings for Terry Ranch Timing Analysis

Planning Scenario Name	Climate Change	Colorado River Basin Impacts	Water Rights Administration Impacts
Unbearable	5°F Warmer	High Impacts	10% Reduced Yields
Stressed	5°F Warmer	Moderate Impacts	10% Reduced Yields
Continued Trends	2°F Warmer	Moderate Impacts	10% Reduced Yields
Optimistic	2°F Warmer	Low Impacts	No Reduction
No Climate Change	No Change	Low Impacts	No Reduction





In the GSM, the Terry Ranch Integration analysis simulated the Planning Scenario settings shown in **Table 9-2** across the Terry Ranch Project assumptions described in Section 7.2. Performance results were compared to the planning performance criteria defined in Section 2.4 and the Terry Ranch sustainable use criteria identified in Section 7.3 to determine if additional water resources opportunities could be required. The climate conditions selected for the Terry Ranch Timing analysis reflected possible climates around the year 2070.

Table 9-2. Planning Scenario Settings for Terry Ranch Integration Analysis

Planning Scenario Name	Climate Change	Colorado River Basin Impacts	Water Rights Administration Impacts	Total Demands (Potable + Non-Potable)
Unbearable	8°F Warmer	High Impacts	10% Reduced Yields	70,000 af/yr (2070 High Bookend)
Stressed	8°F Warmer	Medium Impacts	10% Reduced Yields	57,100 ¹ af/yr
Continued Trends	5°F Warmer	Medium Impacts	10% Reduced Yields	46,800 af/yr (2070 Median w/Decreased Per Capita Use)
Optimistic	2°F Warmer	Low Impacts	No Reduction	46,800 af/yr (2070 Median w/Decreased Per Capita Use)
No Climate Change	No Change	Low Impacts	No Reduction	57,100 ¹ af/yr

¹ This demand value was selected as it is approximately twice the current annual demands.

9.2 TERRY RANCH TIMING RESULTS

The Terry Ranch Timing analysis used performance metrics from the GSM simulations of the Planning Scenario conditions described above to determine the maximum annual demand the system can meet under each Planning Scenario. **Table 9-3** shows the maximum annual demand the baseline system can meet for each Planning Scenario. Values listed are estimations used for planning purposes and do not reflect the firm yield of Greeley’s water supply system.

Depending on Planning Scenario conditions, the maximum demand the baseline system can meet varies between 32,600 acre-feet per year and 43,800 acre-feet per year. This compares to Greeley’s recent total annual demands of approximately 25,300 acre-feet per year. These results show that even if future conditions are like those in the *Unbearable* Planning Scenario, Greeley’s baseline system is sufficient to meet some demand growth. If future conditions are like those in the *Continued Trends* Planning Scenario, Greeley’s baseline system can accommodate an additional 10,000 acre-feet per year of demand growth, which is approximately 40% more demand than current. These results show that while the baseline system can accommodate some demand growth, it is vulnerable if demand growth occurs rapidly or in combination with climate and risk impacts to water supply. Therefore, the Terry Ranch Project will be required in order for Greeley to meet projected future demands under a range of projected future conditions.





Table 9-3. Maximum Demand the Baseline System Meets while Maintaining Planning Performance Criteria for each Planning Scenario

Planning Scenario	Annual Potable Demand (acre-feet per year)	Annual Non-Potable Demand ¹ (acre-feet per year)	Total Annual Demand (acre-feet per year)
Unbearable	28,000	4,600	32,600
Stressed	30,000	4,600	34,600
Continued Trends	32,000	5,800	37,800
Optimistic	36,000	5,800	41,800
No Climate Change	38,000	5,800	43,800

¹ Non-Potable demands are set based off annual potable demand. At certain demand thresholds, the non-potable demand was increased reflecting additional service area development.

A key outcome of this analysis was timing the Terry Ranch Project implementation using the demand results above. However, Greeley has not experienced demand growth over the last 10 years, as discussed in Section 4.1, and thus the IWRP cannot determine if the projected demand growth is going to begin immediately. In addition, the differences in projected 20-year demands between the high- and low-bookend scenarios is slightly less than Greeley’s current annual demands. Thus, there is also significant uncertainty in the rate of demand growth when it starts to occur again. Because of these highly uncertain demand factors, the IWRP could not confidently time the Terry Ranch Project implementation. If the Terry Ranch Project is implemented before it is needed, it could unnecessarily overburden Greeley’s customers with high water rates.

In-lieu of being able to time Terry Ranch Project implementation, the IWRP identified a process Greeley can use to monitor demands and water supplies, which is detailed as part of the Adaptive Plan in Section 12.2. In this approach, Greeley will monitor observed demands and compare them to the estimated maximum demand the water supply system can meet. After demand growth occurs, Greeley can compare the rate of growth to what the water supply system can meet. This approach is visualized in **Figure 9-1**. In this figure, the solid green line is Greeley’s observed total demand values, the green shaded area is a conceptual range of possible future demands, and the dashed green line as an example demand growth trajectory Greeley could experience. The grey and yellow lines showing the maximum demand the baseline system can meet under the *No Climate Change* and *Continuing Trends* Planning Scenarios, respectively. Note that the x-axis after 2020 is conceptual and is not tied to actual future years.

Figure 9-1 shows that as the future evolves, the demand Greeley’s baseline system can meet could gradually decrease as impacts from climate change and other risks occur. This is why the solid line decrease from the 2010 to 2020 value. Simultaneously, demand growth is expected to occur, though the exact start of growth and rate is unknown. Comparing the rate of demand growth to the water supply system conditions will provide Greeley sufficient foresight to start Terry Ranch implementation such that when it is required it will be fully completed.



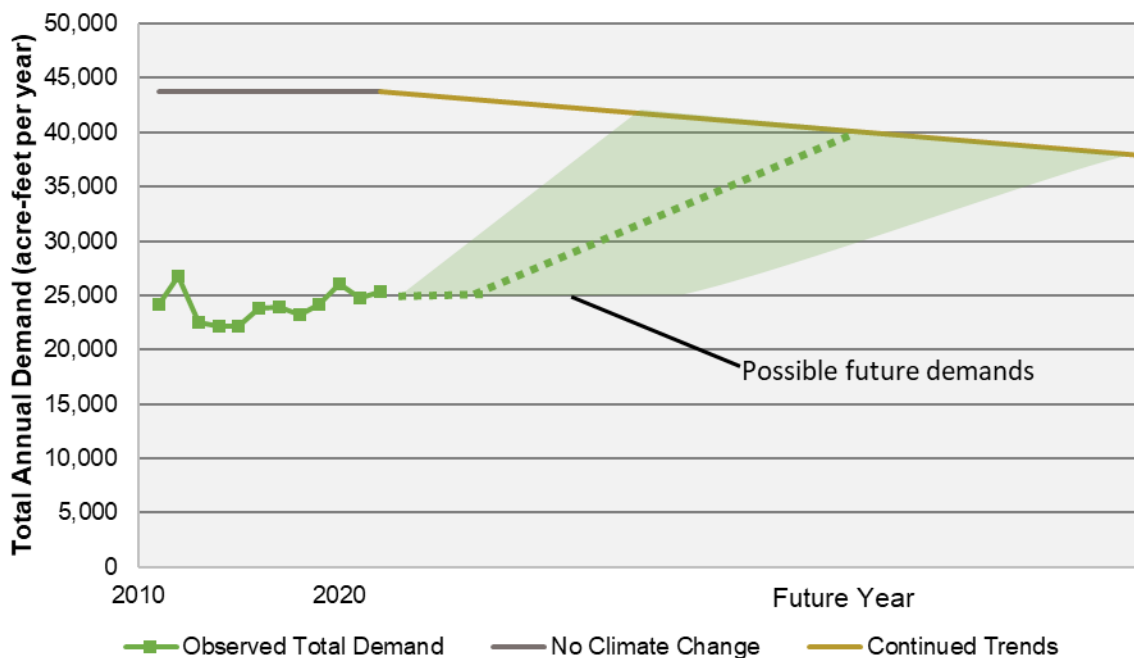


Figure 9-1. Conceptual example of timing the Terry Ranch Project showing how demands (green shaded area/dashed line) could grow while the water the supply system provides could decrease (grey and yellow line)

9.3 TERRY RANCH INTEGRATION RESULTS

The Terry Ranch Integration analysis used performance metrics and Terry Ranch sustainability results from the GSM simulations of the Planning Scenario conditions described above to determine if Terry Ranch operations were sustainable long-term. In summary, Terry Ranch operations are sustainable if it can deliver sufficient supplies during drought to minimize drought restrictions while maintaining at least 80% of the 1.2 million acre-foot native aquifer storage volume long-term. This sustainability definition was developed as a planning criterion for the IWRP to evaluate future conditions and could be altered in the future if desired. **Table 9-4** shows the results of the Terry Ranch integration analysis by Planning Scenario. This table indicates what (if any) additional water resources were included, the percent of years Greeley drought restrictions were used, the average annual Terry Ranch “Delta” (injection minus extraction), and the percent of the native aquifer remaining at the end of the 86-year simulation.





Table 9-4. Tabular Summary of Terry Ranch Integration Results

Planning Scenario	Additional Water Resources	% Years with Drought Response	Annual Terry Ranch Delta (acre-feet per year)	Ending Aquifer Volume (% of 1.2 million acre-foot Volume)
Unbearable	Retiming Storage + Moderate Water Acquisitions	100%	-10,700	23%
Stressed	Retiming Storage + Moderate Water Acquisitions	64%	-6,500	53%
Continued Trends	Retiming Storage + Moderate Water Rights	35%	-1,200	91%
Optimistic	None	12%	+1,900	113%
No Climate Change	Retiming Storage + Low Water Acquisitions	36%	-1,900	86%

Color Key Indicates Terry Ranch Sustainability Criteria: **Blue** has sufficient remaining aquifer percentage, **Orange** has insufficient remaining aquifer percentage

Results from the Terry Ranch integration analysis show that the Terry Ranch Project can be operated sustainably in the *Continued Trends*, *Optimistic*, and *No Climate Change* Planning Scenarios. Sustainable operation in these Planning Scenarios will require some additional water supplies and retiming storage. The percent of years in drought restrictions for the *Continued Trends* and *No Climate Change* Planning Scenarios are above the 20% performance planning criteria. As the Terry Ranch Project is a drought-resilient supply source, Greeley could change the current drought response policy by lowering the thresholds that trigger watering restrictions. How the drought response policy could change was not evaluated in this IWRP but should be considered in future studies. Simulations of the *Optimistic* Planning Scenario showed that the long-term Terry Ranch storage will be above the initial native aquifer storage volume. Comparing these results to the results of the *No Climate Change* Planning Scenario, which does not include climate change impacts but does include approximately 10,000 acre-feet more demands, highlights the sensitivity to annual demands. Completing the Terry Ranch Project at a lower total annual demand could help increase aquifer storage to be used as demand increases.

Results from the *Unbearable* and *Stressed* Planning Scenarios show that under these conditions, Terry Ranch Operations are not sustainable. Both Planning Scenarios use drought restrictions significantly more frequently than 20% of years, and the long-term aquifer storage is well below the 80% threshold. These results indicate that Greeley’s water supply system with Terry Ranch is vulnerable to the conditions listed in those Planning Scenarios, which include the hottest climate change projections and significant demand growth. The vulnerable demand and climate conditions identified in these Planning Scenarios will likely emerge gradually over an extended period of time. Greeley can monitor these conditions as part of the Adaptive Plan and, if they emerge, can adjust the long-term water supply strategy.

How the Terry Ranch Project use is simulated in the GSM was also evaluated. **Figure 9-2** shows deliveries to Greeley from the two existing surface water treatment plants (in blue) and the Terry Ranch Project (in orange) under future conditions for one of the six hydrology simulated, which included back-to-back-to-back 2002 conditions. **Figure 9-3** shows the annual Terry Ranch extraction (orange, negative




INTEGRATED WATER RESOURCE PLAN

Terry Ranch Timing and Integration Results



bars), injection (blue, positive bars), and the cumulative aquifer storage as a percent of the initial 1.2 million acre-foot native volume (black line). The first figure shows that Terry Ranch can be a significant supply source for Greeley during droughts, contributing up to 50% of needed supplies during the severe drought period. The second figure shows that in between these drought periods, the surface water supply system can inject excess supplies such that the aquifer volume nearly fully recovers. These results indicate that the GSM is simulating the Terry Ranch Project as intended – a water supply source during droughts and a large storage bucket for excess surface water supplies outside of droughts.



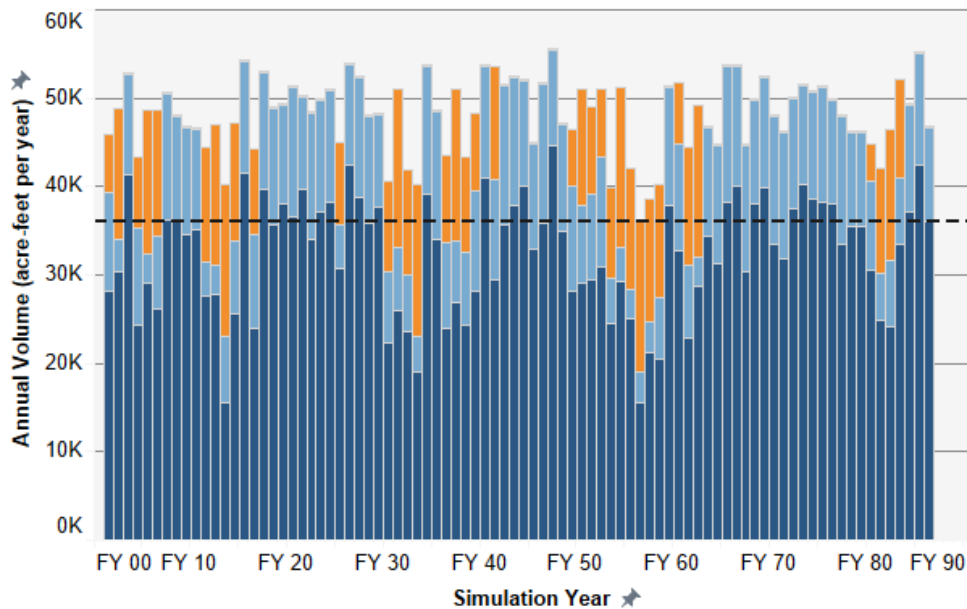

Supply Source
 TR Extraction Boyd Treated Water Bellvue Treated Water

Figure 9-2. Met Demand Source Under Continued Trends Planning Scenario for Timeseries 63. Dashed line is annual demand under Level 2 watering restrictions.

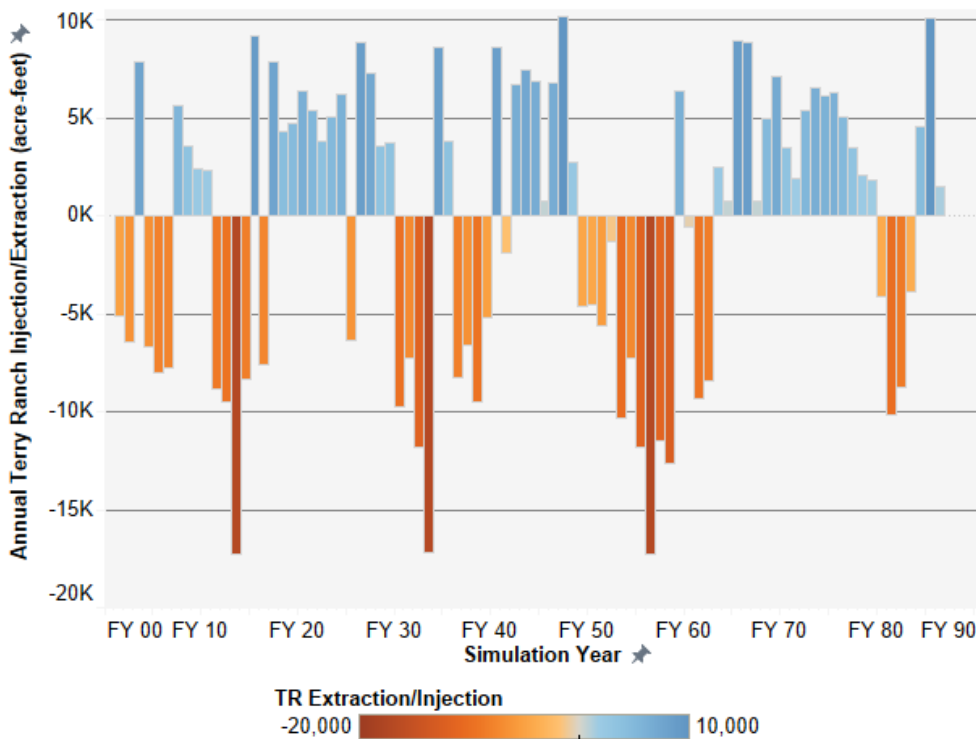


Figure 9-3. Terry Ranch Injection/Extraction Timeseries Under Continued Trends Planning Scenario for Timeseries 63. Left axis corresponds to bar chart and right axis corresponds to line plot.





Figure 9-4 highlights the value of the additional water resources opportunities to achieving sustainable operations of the Terry Ranch Project. This figure shows the percent of the native Terry Ranch aquifer level for the *Continued Trends* Planning Scenario under Timeseries 63. Including additional water rights and retiming storage with Terry Ranch without any additional projects (darkest line) preserves over 30% of the native aquifer level at the end of the 86-year simulation period compared to no additional acquired water rights and retiming storage (lightest line). This shows how these additional water resources will be essential to long-term sustainable operations of the Terry Ranch Project.

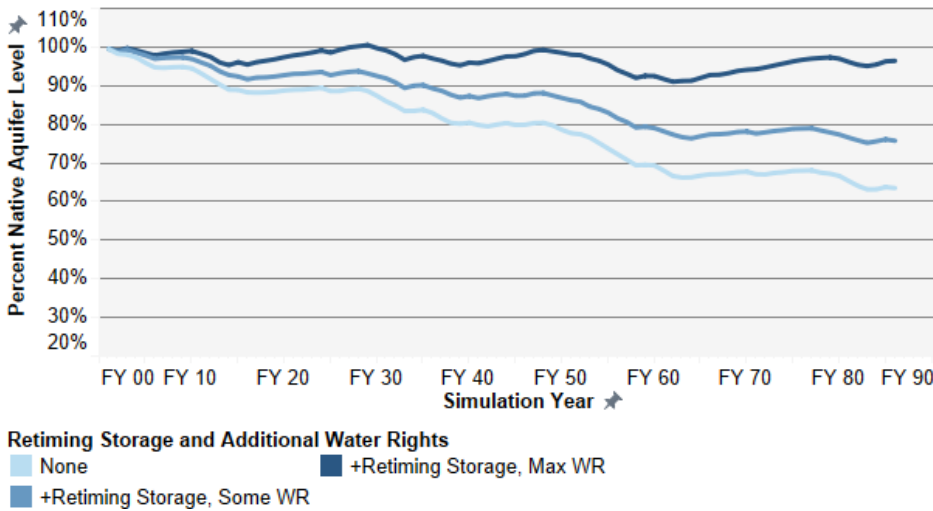


Figure 9-4. Use of Native Terry Ranch Aquifer by Retiming Storage and Additional Water Rights Combinations Under Continued Trends Planning Scenario for Timeseries 63





9.4 CONCLUSIONS

The IWRP evaluated the Terry Ranch Project using two approaches. The Terry Ranch Timing analysis established the water supply system and demand conditions under which the Terry Ranch Project would be required. The Terry Ranch Integration analysis established how Greeley could use the Terry Ranch Project after it is fully integrated. Results from these analyses showed the following conclusions:

- The Terry Ranch Project integrated into Greeley’s water supply system is resilient against many possible future conditions including warmer climates, higher demands, and reduced yields. In those same future conditions, Greeley can sustainably utilize the Terry Ranch Project as a water supply source during droughts long-term with some additional water resources.
- Additional water resources opportunities such as water rights and retiming storage, can significantly improve the long-term sustainability of the Terry Ranch Project in futures with warmer climates and/or significant demand growth. Under less stressful future conditions, the Terry Ranch Project is sustainable without these additional water resources opportunities.
- If impacts from climate change are severe and tracking with the hottest projections, Greeley may need to consider additional long-term solutions. These will have long lead times that Greeley can monitor and adapt to.
- Terry Ranch being implemented cannot be confidently scheduled due to the significant uncertainty in when demands will grow and the rate of that growth.
- Greeley should utilize an Adaptive Plan to properly time Terry Ranch and monitor emerging climate and demand conditions.





10.0 WATER RIGHTS EVALUATION

The Future Hydrology Analysis presented in Section 6 showed that Greeley's current water rights portfolio is vulnerable to climate change impacts across the three major river basins. In addition, near-term analysis results in Section 8 and results from the Terry Ranch Project timing and integration analysis in Section 9 show additional water rights will be required to meet projected demands. The IWRP therefore updated Greeley's water acquisition strategy. This section describes the Water Acquisition Decision Tool (WADT) developed that helps Greeley target the most beneficial water resources and presents a general overview of Greeley's water acquisition strategy resulting from the development of the WADT.

10.1 WATER ACQUISITION DECISION TOOL

As part of the IWRP, the Water Acquisition Decision Tool (WADT) was developed to help define Greeley's water acquisition strategy and to inform decisions on future updates to Greeley's water acquisition strategy. Another motivator for the WADT is to create a centralized location for water rights-related data and to improve knowledge transfer during future water acquisition strategy updates. . The WADT is not designed to determine if acquisitions are needed; rather it is an adaptable, data-driven tool to inform decision-making when evaluating potential acquisitions or when re-evaluating the acquisition strategy. Importantly, the tool will help to track purchases and SME opinions over time.

The WADT identifies water rights in the Poudre River, Big Thompson River, and Colorado River basins as well as non-tributary groundwater rights as possible acquisition targets. These acquisition targets are divided into three different Water Right Classes based on their acquisition strategy: Aggressive Acquisition, Active Acquisition, and Passive Acquisition. **Table 7-1** shows the criteria used to classify each water right and the overall acquisition strategy. A water right should meet most of the criteria to be assigned to a certain Class, but it is not necessary for it to meet all of the criteria.





Table 7-1. Water Right Classification Strategies and Criteria in Water Acquisition Decision Tool

Water Right Class	Criteria	General Acquisition Strategy
<p>Class 1</p>	<ul style="list-style-type: none"> • Use for potable supply • Sources are from the upper Poudre River, Big Thompson, and Colorado River basins. Also, non-tributary groundwater rights to the extent that they can be integrated into Greeley’s potable water system • Ability to provide firm yield at existing Bellvue and Boyd WTFs • Relatively low regulatory risk; established history of changes in water court • Ability to meet return flows from existing supplies and infrastructure • Greeley already owns shares or has the ability to acquire a large number of shares or interest in the company 	<p>Aggressive Acquisition - Greeley is actively seeking acquisitions and is willing to make offers based on a predetermined offer price, subject to budget availability</p>
<p>Class 2</p>	<ul style="list-style-type: none"> • Use for potable or non-potable supply • Sourced from upper/lower Poudre River or Big Thompson River basins. Also non-tributary groundwater rights to the extent that they can be integrated into Greeley’s potable water system • Ability to provide firm yield at existing Bellvue and Boyd WTFs or for use in non-potable system. • Relatively low regulatory risk; may or may not have established history of changes • May have other issues that make it less desirable than Class 1 water • Ability to acquire a moderate number of shares or interest in the company • Price per AF is less than Class 1 rights 	<p>Active Acquisition - Greeley evaluates potential sales brought by sellers or brokers and executes only if Class 1 water is unavailable to buy, the water is priced at or below market, or the water has other positive attributes</p>
<p>Class 3</p>	<ul style="list-style-type: none"> • Use primarily for non-potable supply or for meeting return flow obligations • Sourced from lower Poudre or Big Thompson River basins • Not required to be a firm supply • No or limited prior change cases in the system • May only be able to acquire smaller volumes of shares and interest in the company • Price per AF is less than Class 1 and 2 rights 	<p>Passive Acquisition - Greeley evaluates potential sales on a case-by-case basis and executes only if Class 1 and 2 water is unlikely to be available for the duration of budget. To purchase, Class 3 water should be priced below market or have some other positive attributes</p>

There are many variables that can be used when assessing water rights acquisitions. To define and organize these, the WADT defined five categories that are used to evaluate and prioritize water rights within the three Water Right Classes. These categories are cost, reliability, availability, system integration, and water rights administration considerations. More categories may be added in the future if desired. Within each of these categories, the WADT defined discrete evaluation criteria and defines how to score water rights for each criterion. The evaluation criteria and their categories are shown in **Table 7-2**.

The WADT allows Greeley to assign individual scores for each evaluation criteria and then weight the scores between categories. Scores and weights can be adjusted based on departmental priorities, budget





constraints, changes in acquisition strategy informed by IWRP updates, or other factors. The resulting weighted scores will help identify, target, and prioritize water rights for acquisition.

Table 7-2. Evaluation Criteria and Categories in Water Acquisition Decision Tool

Category	Evaluation Criteria
Cost	<ul style="list-style-type: none"> • Purchase Price • Integration Cost • Operation and Maintenance Cost
Reliability	<ul style="list-style-type: none"> • Potential Yield under Shifted Hydrograph • Seniority of Water Right • Vulnerability to Change of Water Right
Availability	<ul style="list-style-type: none"> • Availability of Water for Acquisition • Willingness of Owner to Sell • Risk of Price Escalation
System Integration	<ul style="list-style-type: none"> • Integration into Existing System • Integration into Terry Ranch • Time to Implement
Water Right Administration Considerations	<ul style="list-style-type: none"> • Legal Complexity • Ditch/Reservoir Company Considerations • Water Right Operational Flexibility

10.2 WATER ACQUISITION STRATEGY

Greeley has actively acquired raw water supplies through purchase of water rights and via its raw water dedication program. The primary focus of Greeley’s past water acquisition strategy was to acquire water resources that were within Greeley’s growth path and to obtain water resources that could be stored in an enlarged Milton Seaman Reservoir. The Terry Ranch Project has changed the focus of Greeley’s water acquisition strategy to water supplies that improve the sustainability of that project as described in Section 7.4. The IWRP updated Greeley’s acquisition strategy in parallel with developing the WADT using subject matter expertise on how potential water acquisitions can be integrated into Greeley’s system and their associated characteristics (price, changeability, etc.).

The goals of the acquisition strategy include water supplies with the following features:

- add security and redundancy to the water supply system prior to Terry Ranch implementation
- improve the sustainability of the Terry Ranch Project
- maximize and make the most efficient use of potable water supplies
- allow for the retiming of water resources for utilization in the Terry Ranch Project
- can be used in Greeley’s non-potable system

The primary supplies that can be most easily integrated into the Terry Ranch Project are direct flow or storage rights in the upper Poudre River and Colorado River basins, and non-tributary groundwater rights. Although additional water supplies in the Big Thompson River basin cannot be currently integrated into



INTEGRATED WATER RESOURCE PLAN

Water Rights Evaluation



the Terry Ranch Project, they can be used for direct potable use, storage, and non-potable use to decrease the immediate demands from and make most efficient use of the Poudre River and Colorado River potable supplies for integration into the Terry Ranch Project when needed. The water supplies on the upper Poudre River, upper Big Thompson River, and Colorado River basins have high demand, high increases in water right costs, and decreased availability relative to other supplies in those basins.

While Greeley should still pursue these more expensive water resources, reliance on these resources can be partially offset by integrating non-potable supplies into Greeley's acquisition strategy. Greeley's 2022 Non-Potable Master Plan identifies a goal of 15 percent of its future demands to be met by non-potable supplies. This goal will serve several purposes such as maximizing the use of untreatable water supplies, providing the lowest cost of water service to citizens, and making the most efficient use of potable water supplies that can be integrated into the Terry Ranch Project.

Northern Colorado has experienced a high population growth rate over the last decade with this population growth projected to continue. Because of this, regional demand for water rights has increased dramatically, resulting in decreased water rights acquisition availability, rapidly increasing costs, and increased competition. Additionally, water providers that historically relied on water from the mainstem of the South Platte River are also now acquiring water rights on tributaries such as the Poudre River because of the increased competition for water rights on the mainstem of the South Platte River. It is anticipated that these challenges will continue or worsen as availability of water resources diminish across the entire South Platte River basin. Therefore, it is recommended that Greeley continue acquiring additional water rights as aggressively as possible given budgetary considerations and constraints.

The following are recommendations for Greeley in order to meet the water acquisition strategy goals identified in the IWRP while also preserving Greeley's agricultural heritage.

1. Acquire potable direct flow and storage supplies in the Poudre River, Big Thompson River, and Colorado River basins and non-tributary groundwater rights.
2. Acquire non-potable direct flow and storage supplies in the Poudre River and Big Thompson River basins.
3. The distribution of acquisitions between potable and non-potable can be dynamic if the availability of water resources for acquisitions warrants.
4. Pursue water rights that will permit Greeley to lease out water rights for decreed agricultural irrigation uses until such time as those water rights are needed by Greeley.
5. Pursue water rights that will allow for Interruptible Supply Use in order to support the agricultural community while maintaining the water supplies for Greeley's use during droughts. These opportunities exist under a number of ditch systems within the Cache la Poudre River and Big Thompson River.
6. Pursue changes of water rights as quickly as possible given budgetary, personnel, and other constraints. This may result in Greeley obtaining a higher yield with more favorable terms and conditions than if Greeley waited to change the water rights in the future.
7. Prioritize agricultural leases for individual farms and ditch companies that connect to the Greeley economic zone and pursue recovery of higher value leases for industrial and augmentation water to support the CIP and water acquisition goals.





10.3 WATER ACQUISITION SUMMARY

The IWRP recommends that Greeley develop a water acquisition strategy to meet projected demand growth and mitigate the impacts from climate change and other risks to their existing water supply system. The goals of the acquisition strategy include water supplies with the following features:

- add security and redundancy to the water supply system prior to Terry Ranch implementation
- improve the sustainability of the Terry Ranch Project
- maximize and make the most efficient use of potable water supplies
- allow for the retiming of water resources for utilization in the Terry Ranch Project
- can be used in Greeley's non-potable system.

The IWRP also developed the WADT, which provides Greeley a data-driven tool to help make informed decisions on water acquisition strategy to meet these acquisition strategy goals. The WADT is intended to be adaptive as it can be updated to reflect changes in market conditions, meet changing goals and strategies, and/or to include additional evaluation criteria.





11.0 10-YEAR CAPITAL IMPROVEMENT PLAN

A water resources Capital Improvement Plan (CIP) was developed provide a timeline and estimated budget for implementation of the outcomes and recommendations from the IWRP. This section lists the CIP assumptions and summarizes the CIP. The detailed water resources CIP is included Appendix A.

A 10-year planning horizon was utilized for this CIP, starting in 2024 and continuing through 2033. This 10-year planning horizon does not capture the full implementation of recommendations identified in Greeley’s IWRP. To the extent additional CIP projects may be required beyond 2033, those needs are addressed in the discussion about the identified capital improvement plan projects below.

This CIP represents Greeley Water Resources Department portion of project costs. Cost sharing opportunities with developers, funding partners, or other Departments within Greeley do exist for some of the projects included in this CIP. Those cost sharing opportunities are described in further detail in the project descriptions below. Costs do not include “internal City costs” to complete projects. Internal City costs are defined as additional staff requirements associated with project development and implementation

Project cost estimates presented within this CIP are in 2023 dollars. Project costs associated with reoccurring projects assume an annual escalation rate of 3%. Project costs were developed based on input from Greeley, existing cost estimates from previous CIPs, and actual spending by Greeley.

Overall project sequencing is based on input from Greeley staff on the interdependencies between projects and on progressive expansion of Greeley’s water resources portfolio to meet or exceed the demand projections described in this IWRP.

The following key assumptions were made to develop this CIP:

- Land and/or easements will be required and ready for development of projects when needed.
- Cost associated with land acquisition / easements and right-of-ways are not included in this CIP.
- Estimated capital costs include costs associated with permitting, design, and construction management.
- Ancillary costs associated with capital projects such as pipeline connections, inlet and outlet structures, measurement, and controls were assumed to be included in the total project costs.
- Management of Greeley’s water rights portfolio could include such things as maintenance of ditch and conveyance systems, regular measurement and recording of water deliveries, preparation of water accounting, land management for compliance with dry up or revegetation requirements. These on-going compliance requirements are considered regular operations and maintenance and are therefore not included in this CIP.

Figure 11-1 presents the 10-year Water Resources CIP by project category and illustrates the annual and cumulative capital requirements associated with all water resource projects included herein through the 2033 planning horizon. A summary of the CIP identified water resources projects and their corresponding categories are listed below. **Table 11-1** lists individual projects, their associated costs to



INTEGRATED WATER RESOURCE PLAN

10-Year Capital Improvement Plan



Greeley, and anticipated start dates. The total capital requirement for the recommended IWRP CIP between 2024 and 2033 is \$134,480,000. Delays to the projects in this CIP may delay other projects and potentially result in Greeley not being able to meet demands. For this reason, this CIP should be reviewed and updated annually.

- **Terry Ranch Infrastructure** – projects associated with implementing the Terry Ranch Project which include pipeline installation and State Land Board wellfield development. This infrastructure is being developed using the first \$62.5 million from the Wingfoot deal, plus Greeley’s \$12.5 million 20% match for a total investment of \$74 million.
- **Water Rights Acquisition** – Greeley continues an opportunistic and strategic approach to acquiring water rights. The CIP includes an annual cost of \$6 million per year with a 5% escalation factor.
- **Water Rights Development** – The legal and engineering costs associated with protecting existing water rights and changing new water rights at a rate consistent with the 2018 to 2022 expenditures. The CIP assumes \$350,000 per year for legal costs and \$275,000 per year for engineering costs, escalated at 3% per year.
- **Planning Studies** – Completing the planning studies identified in the IWRP. This includes \$250,000 for the Storage Retiming Investigation in 2024 and 2025, \$200,000 for Greeley’s portion to update the PBN Model, \$300,000 for an update to the IWRP in approximately 2028, and \$550,000 for a Terry Ranch Investigation Study after the IWRP update.
- **Water Resources Projects** – Variety of additional water resources projects including continuation of investment into water conservation, infrastructure projects required for growing demands, infrastructure projects associated with water rights, and any retiming storage project. Water conservation programs should address environmental justice goals and provide sustainable landscaping opportunities to the entire community. Cost sharing opportunities exist for a number of identified water resources projects and should be further evaluated during project planning.



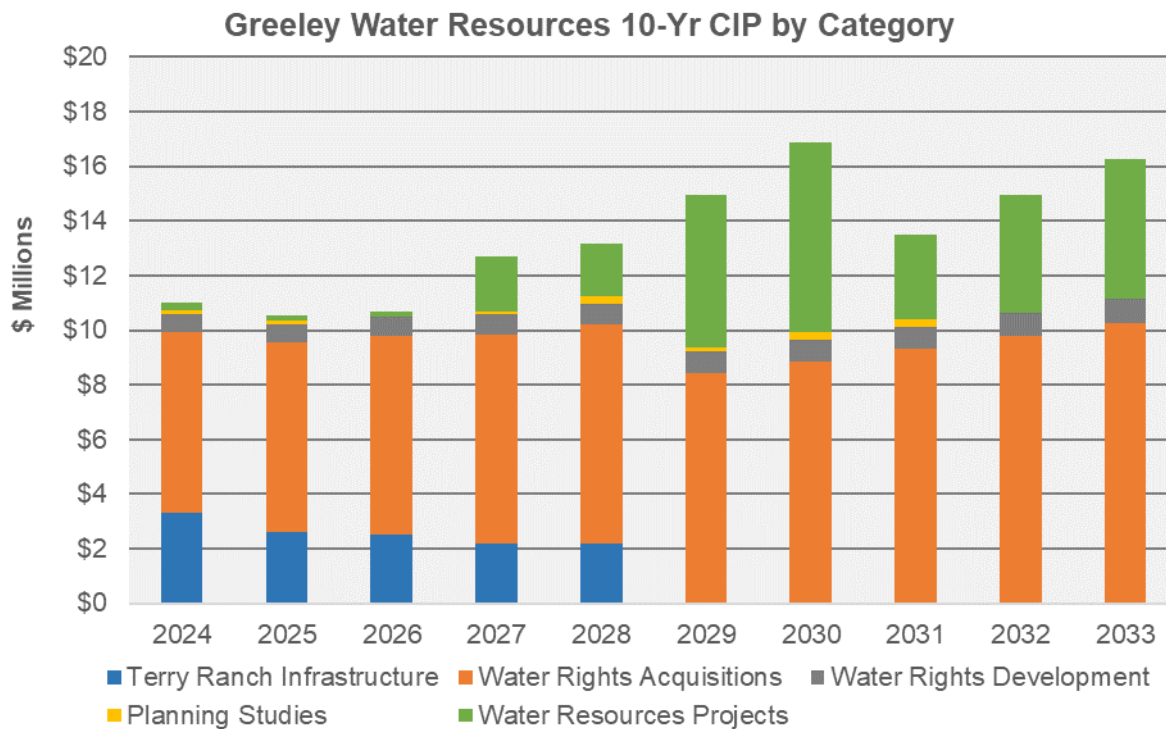


Figure 11-1. Water Resources 10-Year CIP Costs by Project Category



INTEGRATED WATER RESOURCE PLAN

10-Year Capital Improvement Plan



Table 11-1. List of Water Resources CIP Project Costs and Details

Project Name	Start Year	Duration	Annual Project Cost	Total Project Cost	Greeley (Water Resources Dept)	Developer / Funding Partner / Greeley non-WR Contribution	Greeley - Water Resources Dept Total 2024 to 2033
Terry Ranch Infrastructure Projects							
Terry Ranch: Phase 1 - Windsor to Hwy 14 Pipeline	2023	2 yrs		\$31,250,000	\$6,250,000	\$25,000,000	\$3,125,000
Terry Ranch Phase 1b - Pipeline Construction 2025 to 2026	2025	2 yrs		\$25,000,000	\$5,000,000	\$20,000,000	\$5,000,000
Terry Ranch Phase 1b - Pipeline Construction 2027 to 2028	2027	2 yrs		\$21,875,000	\$4,375,000	\$17,500,000	\$4,375,000
Terry Ranch Phase 2 Development	2034				TBD		
State Land Board Wellfield Development	2023	3 yrs		\$1,500,000	\$1,300,000	\$200,000	\$300,000
Sub-Total for Terry Ranch Infrastructure Projects							\$12,800,000
Water Right Acquisition							
Acquisition of Agricultural Water Rights	2023	Every year	\$6,000,000 per year w/ 5% escalation		\$6,000,000 per year w/ 5% escalation		\$83,202,759
Sub-Total for Water Rights Acquisitions							\$83,202,759
Water Rights Development							
Water Rights Development - Legal Fees	2023		\$350,000 per year w/ 3% escalation		\$350,000 per year w/ 3% escalation		\$4,256,710
Water Rights Development - Engineering Fees	2023		\$275,000 per year w/ 3% escalation		\$275,000 per year w/ 3% escalation		\$3,344,558
Sub-Total for Water Rights Development							\$7,601,268



INTEGRATED WATER RESOURCE PLAN

10-Year Capital Improvement Plan



Project Name	Start Year	Duration	Annual Project Cost	Total Project Cost	Greeley (Water Resources Dept)	Developer / Funding Partner / Greeley non-WR Contribution	Greeley - Water Resources Dept Total 2024 to 2033
Planning Studies							
Storage Retiming Investigation	2024	2 yrs		\$250,000	\$250,000		\$250,000
Poudre Basin Model Updates	2027	2 yrs		\$600,000	\$200,000	\$400,000	\$200,000
Update to Greeley IWRP	2028	2 yrs		\$300,000	\$300,000		\$300,000
Terry Ranch Integration Study	2030	2 yrs		\$550,000	\$550,000		\$550,000
Sub-Total for Planning Studies							\$1,300,000
Water Resources Projects							
Life After Lawn	2023	Every year	\$150,000 per year w/ 3% escalation		\$150,000 per year w/ 3% escalation		\$1,824,304
Aerial Imagery and Planimetric Data Acquisition for Update to Residential Water Budget	2024	Every 3 years (2024, 2027, 2030, 2033)	\$200,000 per update w/ 3% escalation		\$68,000 per update w/ 3% escalation	\$132,000 per update w/ 3% escalation	\$327,099
Rehab of Poudre River Diversion Structure	2029	3 yrs		\$8,000,000	\$8,000,000	Partnership Opportunities Should Be Evaluated	\$8,000,000
Poudre Raw Water Intake Pipeline Expansion - Between River Diversion and Bellvue Intake	2030	5 yrs total 2 yrs design and 3 yrs construction		\$8,750,000	\$8,750,000		\$8,750,000
Assessment of the Raw Water Pipeline between Lake Loveland & Boyd	2033	1 yr		\$200,000	\$200,000		\$200,000
Lower Latham Bypass Structure for Optimization of Water Rights	2027	4 yrs		\$3,000,000	\$1,000,000	\$2,000,000	\$1,000,000



INTEGRATED WATER RESOURCE PLAN

10-Year Capital Improvement Plan



Project Name	Start Year	Duration	Annual Project Cost	Total Project Cost	Greeley (Water Resources Dept)	Developer / Funding Partner / Greeley non-WR Contribution	Greeley - Water Resources Dept Total 2024 to 2033
Development of Overland Trail Gravel Pits	2023	7 yrs		\$3,210,000	\$3,210,000		\$3,175,000
Expansion of Gravel Pit Storage at the Poudre Ponds Complex (Martin Marietta storage)	2027	4 yrs		\$6,000,000	\$6,000,000		\$6,000,000
WSSC Return Flow Structures	2033	5 yrs		\$2,500,000	\$2,500,000	<i>Partnership Opportunities Should Be Evaluated</i>	\$500,000
Sub-Total for Water Resources Projects							\$29,776,403
TOTAL FOR ALL PROJECTS							\$134,680,431



12.0 RECOMENDATIONS AND ADAPTIVE PLAN

12.1 IWRP OUTCOMES AND RECOMMENDATIONS

Greeley's IWRP is a long-term strategic water resources master plan for Greeley that ensures sustainable and affordable water supplies for their customers. The IWRP is a comprehensive plan that integrated Greeley's water supply system (analyzed in Section 6) and projected demands (presented in Section 4) with possible future conditions around hydrology, climate change, and risks to Greeley's water supply system (shown in Section 5). The IWRP establishes a plan for triggering the Terry Ranch Project (Section 9), a process for evaluating and strategically acquiring water rights (Section 10), a 10-year CIP (Section 11), and an Adaptive Plan (Section 12.2) for Greeley to follow.

The IWRP analysis showed that Greeley is well-positioned to provide sustainable and affordable water supplies through an uncertain future if the water supply system is developed as planned. Past planning efforts and decisions have created a robust water supply system. The Terry Ranch Project, when complete, will likely be an effective drought supply source and can be operated sustainably long-term. The Terry Ranch Project is also flexible to develop, with infrastructure incrementally completed such that when it's needed it can be integrated efficiently. The IWRP process also established several important outcomes and conclusions regarding Greeley's current, near-term, and long-term water supply system, shown below.

- Greeley's current water supply system is resilient against the most likely near-term conditions, but additional water supplies are required to meet projected demands and to mitigate impacts from warmer climate conditions.
- With the Terry Ranch Project fully integrated, Greeley's water supply system is likely resilient against many possible future conditions including warmer climates, higher demands, and reduced yields. In those same future conditions, Greeley can sustainably utilize the Terry Ranch Project as a water supply source during droughts long-term when the Terry Ranch Project is coupled with some additional water resources.
- Balance implementation of the Terry Ranch Project with other water resources and non-water resources CIP needs to minimize financial risk and maintain affordable water supplies.
- If impacts from climate change are severe and tracking with the hottest projections, Greeley may need to consider additional long-term solutions (i.e., in addition to Terry Ranch and additional water supplies).
- The most impactful drivers to Greeley's water supply system – demand growth and climate change impacts – will have long lead times that Greeley can monitor and adapt to.
- Terry Ranch cannot be confidently timed until Greeley sees sustained, significant demand growth.

To ensure the IWRP outcomes hold true and continue providing sustainable and affordable water supplies, the IWRP includes the recommendations for Greeley summarized in **Table 12-1**. These recommendations were used to identify the water resources projects from the 10-year CIP in Section 11 and define the key actions of the Adaptive Plan defined in Section 12.2.





Table 12-1. Summary of IWRP Recommendations Used to Develop 10-year CIP and Adaptive Plan

Recommendation	Action
Change Water Rights	Greeley should continue to aggressively change existing water rights to municipal use as these will improve the security and redundancy of the existing water supply system before the Terry Ranch Project is integrated.
Continue Strategic Acquisitions	Greeley should acquire additional water supplies and prioritize the acquisition of water supplies that can be integrated into the current system and the Terry Ranch Project. These water supplies are required to meet projected demands and mitigate climate and risk impacts to the current water supply system. These additional water supplies will also help the Terry Ranch Project operate sustainably once integrated.
Develop Priority Terry Ranch Infrastructure	The Terry Ranch Project needs to be efficiently integrated into Greeley's water supply system once it is required. Greeley should continue incrementally implementing project components (pipelines, right of way, water rights) to ensure this project is readily available to Greeley.
Study Potential Conceptual Retiming Storage Options	The IWRP identified a retiming storage project as a potentially beneficial project to improve the sustainability of Terry Ranch operations. As the IWRP only included a conceptual definition of the project, Greeley should further define this project and align the concept with real facilities.
Implement Adaptive Planning to Monitor Drivers and Trigger Terry Ranch	While the IWRP showed Greeley's water supply system is resilient against warmer futures and increased demands, it is still vulnerable to significantly stressful future conditions. Additionally, the IWRP could not confidently define when Terry Ranch is required due to uncertainty in demand growth. Greeley should implement an Adaptive Planning process that regularly updates IWRP outcomes and re-evaluates the Terry Ranch timing.

To develop Priority Terry Ranch infrastructure, Greeley is implementing the approach described below, primarily consisting of a phased pipeline installation. This approach was used to develop the 10-year CIP.

- Phase 1a Pipeline is installing the first six miles of Terry Ranch conveyance pipeline from Windsor to Highway 14. This phase is ongoing and is expected complete in 2025.
- Phase 1b Pipeline will continue to install Terry Ranch conveyance pipeline from the termination point of Phase 1a along the northern alignment. This phase is expected to start in 2025.
- State Land Board Wellfield development is installing and testing monitoring wells on the 16 State Land Board-owned sections that are interspaced with the Terry Ranch Project property. The primary purpose of this effort is to secure the rights to the groundwater underlying the State Land Board parcels. This project is expected to complete by the end of 2024.





12.2 ADAPTIVE PLAN

An important recommendation from the IWRP is that Greeley implements an Adaptive Plan after IWRP completion. This section presents an initial definition of what is included in Greeley's Adaptive Plan and how it will be implemented.

12.2.1 Purpose and Implementation

While the IWRP showed Greeley's water supply system is likely resilient against warmer futures and increased demands, it is still vulnerable to significantly stressful future conditions. Additionally, the IWRP could not confidently define when Terry Ranch is required due to uncertainty in demand growth. Therefore, the Adaptive Plan will serve to re-evaluate the outcomes, assumptions, and recommendations from the IWRP and the potential need for the Terry Ranch Project on an annual basis. The primary goal of the Adaptive Plan is to ensure Greeley continues planning for a future water supply system that delivers sustainable and affordable supplies to its customers. This Adaptive Plan focuses on trends and longer-term changes as opposed to near-term water supply conditions and operations which Greeley already monitors. To achieve this, the Adaptive Plan takes the five actions listed below based on the major IWRP outcomes and assumptions:

1. Monitor Significant Water Resources Drivers
2. Evaluate Terry Ranch Need
3. Update 5- and 10-year Terry Ranch Implementation Plan
4. Assess Water Rights Changes and Acquisitions
5. Review Other Water Resources Opportunities

The Adaptive Plan will have both formal and informal implementation protocols. Greeley staff plan to regularly update the Adaptive Plan and present updates to the W&S Board and other identified stakeholders on at least an annual basis. The Adaptive Plan update will focus on the five actions defined above and will include the topics and types of information presented in Section 12.2.2. As needed, Greeley staff will also provide updates on Adaptive Plan actions if conditions require it or at the request of the W&S Board.

12.2.2 Adaptive Plan Actions

This section presents how Greeley staff will complete each Adaptive Plan action. The content in this section is intended as a guide to start the Adaptive Plan and can be modified and updated as the Adaptive Plan progresses.





Action 1: Monitor Significant Water Resources Drivers

The IWRP developed outcomes and recommendations based off assumed future drivers for Greeley’s water supply system. While the IWRP utilized a robust approach to capture a variety of possible future drivers, there could be new or significantly different future drivers than what was planned for. In this first action, Greeley’s Adaptive Plan will 1) compare the future drivers assumed in the IWRP Planning Scenarios to recent experiences 2) determine if new drivers have emerged that could change IWRP outcomes.

The drivers used in the IWRP Planning Scenarios were climate warming, Colorado River Basin Impacts, Water Supply System Yields, and Demands. In the Adaptive Plan, Greeley staff will characterize recent trends of each driver. If recent trends fall outside the Planning Scenarios, then Greeley may consider re-evaluating previously developed outcomes using the observed conditions as a new Planning Scenario.

There are many future conditions that could impact Greeley’s water supply system that were not explicitly included as a driver in the IWRP Planning Scenarios. The Adaptive Plan will complete a table, like the one shown in **Table 12-1**, identifying major trends or events that have occurred within different geographic categories. If these trends or events are significantly different than IWRP assumptions, the Adaptive Plan could recommend a follow-up planning study to evaluate the potential changes to IWRP outcomes. The IWRP developed robust assumptions around many of these categories, and stressful events were assumed to occur – what is important is if an event is significantly different than what was assumed. For example, the IWRP developed three types of Colorado River Basin impacts that could occur because of larger Colorado River Basin issues. However, if a multi-year 100% curtailment of the CBT system is possible, the IWRP did not include that condition and Greeley could do a planning study focused on evaluating such a condition.

Category	Example Significant Trends or Events Outside IWRP Assumption
Colorado River Basin	<ul style="list-style-type: none"> • Multi-year CBT system 100% curtailment • Northern Water eliminates carryover storage option • Chimney Hollow Reservoir construction is halted
State of Colorado	<ul style="list-style-type: none"> • Water court decision that retroactively applies to changed water rights • Platte River Recovery Implementation Program non-compliance by Colorado water users, threatening Federal authorization
Poudre/ Big Thompson River Basins	<ul style="list-style-type: none"> • A change case outcome is significantly worse than the 10% reduction assumed in the IWRP • A key source of future water supply becomes unavailable to Greeley • Glade Reservoir is constructed at largest proposed size, impacting junior water rights and operations in the Poudre Basin
Weld County	<ul style="list-style-type: none"> • A nearby community’s water supply system at high risk of failure • Political climate around Terry Ranch becomes highly unfavorable • Large regional water project is constructed
City of Greeley	<ul style="list-style-type: none"> • A significant new water supply user (new residential development or industrial user) beyond the assumed growth occurs • Terry Ranch acceptance changes significantly • Water quality regulatory requirements cause Greeley to construct a new advanced water treatment facility





Action 2: Evaluate Terry Ranch Need

Greeley’s most consequential water resources planning decision is when to begin implementation of the Terry Ranch Project and when the full project needs to be operational. When completed, this project will provide a drought-resilient supply source for Greeley. However full implementation of Terry Ranch will be expensive and completing it too soon could overburden Greeley’s customers with high rates.

Due primarily to the high uncertainty around when future demand growth resumes and the rate of growth once it does resume, the IWRP could not confidently time Terry Ranch implementation. Therefore, a key action in the Adaptive Plan will be re-evaluating the future Terry Ranch need and when the implementation of the project needs to begin. To assess this need, the Adaptive Plan will compare demand indicators to supply indicators and trigger potential actions as a result. **Figure 12-1**, which repeats Figure 9-1 shown in Section 9.2, conceptually shows why the Adaptive Plan will monitor these indicators. There is a wide spread of possible future demands as shown by the shaded area. At the same time, the demand Greeley’s water supply system can meet while meeting the planning performance criteria could gradually diminish due to the effects from climate change, water rights administration, and other factors. This is why the solid line decrease from the 2010 to 2020 value. A future with high demand growth but a resilient water supply system could require the same Terry Ranch timing as a future with low demand growth but high reductions in water supplies.

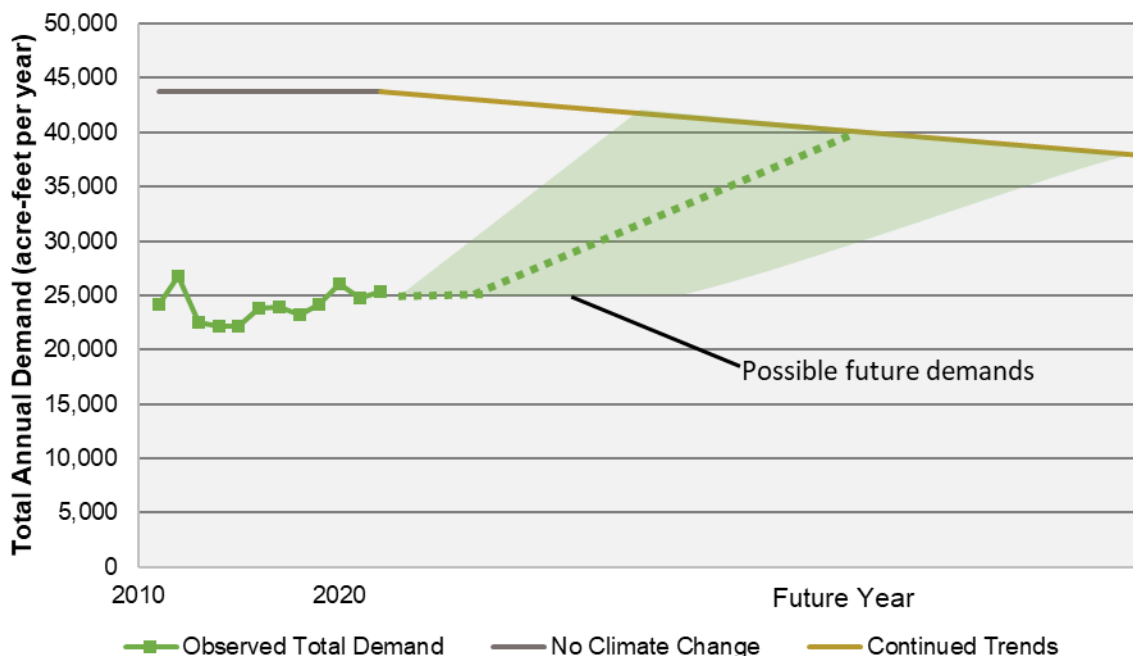


Figure 12-1. Conceptual example of timing the Terry Ranch Project showing how demands (green shaded area/dashed line) could grow while the water the supply system provides could decrease (grey and yellow line)





The purpose of the demand indicators is to establish if Greeley is experiencing significant, sustained growth in total water demand and the rate of that growth. If this demand growth is not occurring, the demand indicators will be used to anticipate if and when demand growth could resume. **Figure 12-2** is an example of how the Adaptive Plan could establish if significant and sustained demand growth is occurring. The total demand line and the year-to-year demand change bars show that since 2010 there has been minimal change in total demands. If year-to-year demand change occurs for three consecutive years and the cumulative volume of that change is greater than 2,500 acre-feet that could indicate sustained, significant demand growth. The criteria used in the Adaptive Plan may differ, but this process would establish the occurrence of sustained growth regardless of source (e.g., population, new industrial use, warming climate).

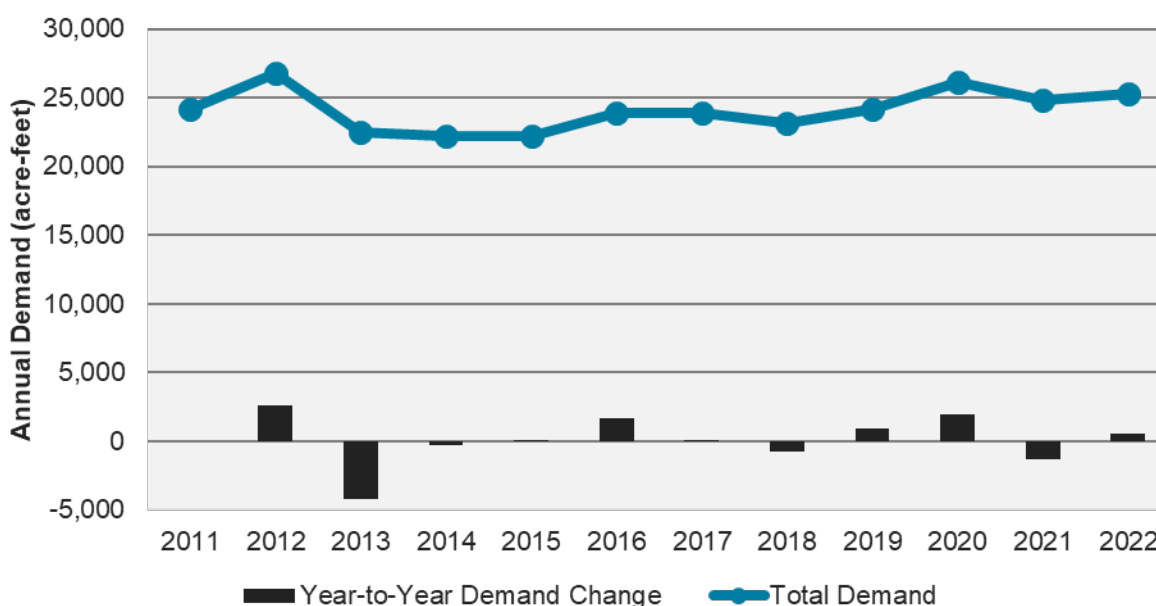


Figure 12-2. Historical Annual Total Demands and Year-to-Year Change

There are other demand indicators Greeley could use in the Adaptive Plan to monitor and assess future demands, which are described below. As the Adaptive Plan is implemented, these indicators may be updated with new indicators.

- **Residential Per Capita Demand** – This indicator will measure Greeley’s residential per capita demands and if those values are reducing, varying significantly, or stagnant year-to-year. Greeley’s future demand growth will primarily be driven by residential use. Due to improved indoor and outdoor conservation since the 2002 drought, reductions in residential per capita use have been significant enough that overall water use was flat despite population growth. Eventually reductions in residential per capita use will reach a floor after which demand growth would occur with population growth.
- **Conservation Rebate Use** – This indicator will measure how customers are utilizing rebates Greeley makes available to reduce water use. While there are many factors that affect why customers utilize rebates, multiple years with minimal rebate use despite broad community outreach and incentives could further indicate conservation measures have reached a floor.





- **Drought Restriction Use** – The IWRP used a maximum drought restriction use of 20% of years in any level and 10% of years in Level 3. If Greeley has required drought restrictions at or in excess of those assumptions (e.g., 2-in-10 years at any Level and 1-in-10 years at Level 3), that could indicate a need for the Terry Ranch Project.

In addition to the demand indicators described above, the Adaptive Plan will also monitor supply indicators to establish if the yield from Greeley’s water supply system is decreasing. These water supply indicators will emphasize the long-term trends of Greeley’s water supply system as Greeley already monitors near-term indicators such as snowpack. The Adaptive Plan will characterize the long-term health of Greeley’s Colorado system, Upper Poudre System (e.g., west of Interstate 25), and the Big Thompson System into *Resilient*, *Vulnerable*, and *Degraded* (defined below) using the visual shown in **Figure 12-3**. In this figure, the solid arrow represents the current status of each system with the arrow outline representing the previous status.

- Resilient – Yields from the system are consistent with IWRP assumptions and do not show signs of potential reduction.
- Vulnerable – Yields from this system are consistent with IWRP assumptions but do show signs of potential reduction if certain conditions emerge or persist.
- Degraded – Yields from this system are lower than IWRP assumptions.

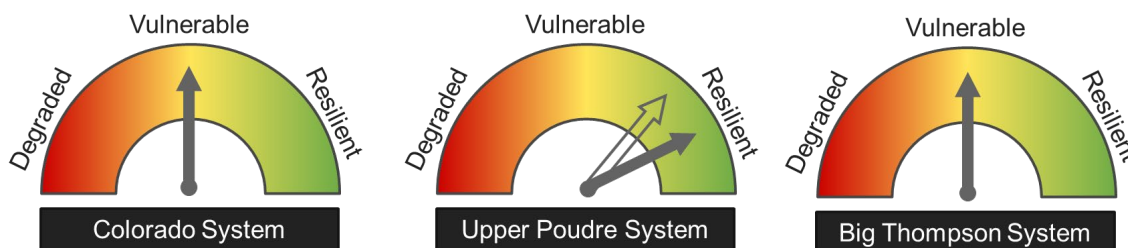


Figure 12-3. Example of how the Health of Greeley’s Water Supply Systems will be Described

The Adaptive Plan will also include a more detailed assessment of each system that justifies the overall system health characterization. **Table 12-2** lists examples of quantitative and qualitative indicators in each system that could be included in the adaptive plan.

Table 12-2. Examples of Qualitative and Quantitative Indicators to Establish System Health

System	Quantitative Indicators	Qualitative Indicators
Colorado	<ul style="list-style-type: none"> • CBT Quota History 	<ul style="list-style-type: none"> • Political headlines and updates
Upper Poudre	<ul style="list-style-type: none"> • Native yields at canyon mouth • Greeley Poudre rights yield 	<ul style="list-style-type: none"> • River commissioner report
Big Thompson	<ul style="list-style-type: none"> • GLIC allocations 	<ul style="list-style-type: none"> • Natural disturbance tracking





Action 3: Update 5- and 10-year Terry Ranch Implementation

While full implementation of the Terry Ranch Project is not defined, Greeley will continue to incrementally implement key components of the larger project. This ensures Greeley has the flexibility to fully implement the project when required by minimizing potential barriers such as right-of-way access, water rights ownership, and permits. The Adaptive Plan will update of Greeley’s 5- and 10-year Terry Ranch Implementation strategy to account for any changing conditions with the project.

Figure 12-4 shows an example of what the Adaptive Plan update of the 5- and 10-year Terry Ranch implementation could look like. In this example the planned projects within the next five years are shown by major category, which at the time of the IWRP included pipe installation, the State Land Board water court process, and future need assessment that is part of the Adaptive Plan. Greater detail about each project will be elaborated with key updates provided. The Adaptive Plan will also include regular updates on Greeley’s 10-year strategy including topics such as financial planning, partnerships, and other emerging factors. The Adaptive Plan’s Terry Ranch Implementation update will be closely tied to and aligned with any corresponding update to the CIP.

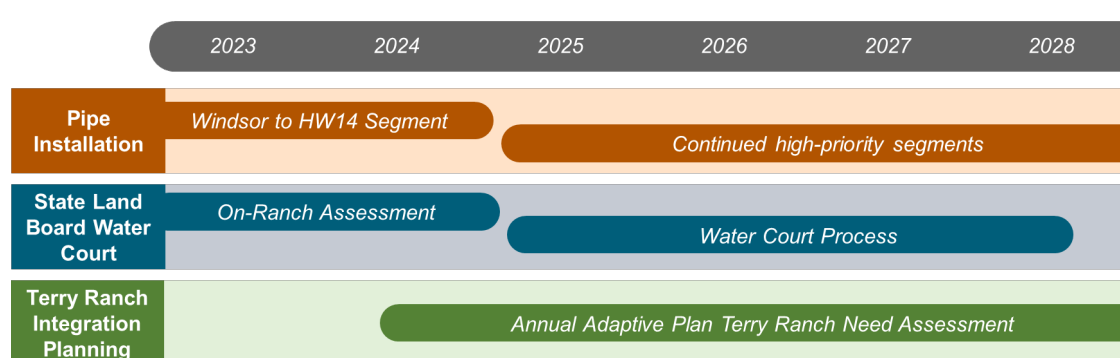


Figure 12-4. Example of 5-year Terry Ranch Implementation Plan

Action 4: Assess Water Rights Changes and Acquisitions

The IWRP recommends that Greeley changes currently owned water rights for Greeley use and continues strategically acquiring new water rights. There is significant uncertainty in the outcome of many water right changes and the competition and cost of acquiring new water rights continues to increase. The Adaptive Plan will assess how water rights changes and acquisitions are progressing compared to the IWRP goals and if changes are required.

To assess water right changes cases, the Adaptive Plan will include a figure like **Figure 12-5**. Greeley’s existing water rights portfolio will be classified into four categories: available for use, long-term leases, change in-progress, or unchanged based on acre foot estimations (e.g., the size of the wedge is an approximation of equivalent acre-foot volume as opposed to number of shares). As part of the Adaptive Plan, change case outcomes will be summarized and if those outcomes were significantly different than what was assumed.



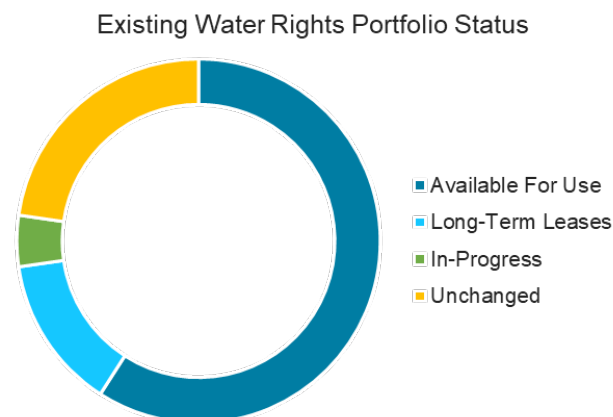


Figure 12-5. Example of How Greeley's Current Water Rights Portfolio is Characterized

Similar to the assessment of water right change case outcomes, the Adaptive Plan will also update Greeley's water rights acquisitions. Recent water right acquisitions and their purpose within Greeley's water supply system will be summarized. How water rights acquisitions are occurring compared to Greeley's water acquisition strategy will be characterized and any potential changes to that strategy discussed. The WADT will be updated as needed with new information or as acquisitions are made available to Greeley. This could include the portion of new water rights acquired for potable, non-potable, or multi-use purposes. Finally, the Adaptive Plan will include an update on the water rights landscape for the region include price changes, any major non-Greeley acquisitions, and other news that could potentially affect Greeley's acquisitions strategy.

Action 5: Review Other Water Resources Opportunities

The final action of the Adaptive Plan will be providing an update on other water resources opportunities beyond the Terry Ranch Project and water rights. Greeley will continue to invest in a variety of projects that improve the water supply system such as the non-potable system, conservation, and smaller-scale infrastructure projects. Status updates of these projects, such as function, schedule, and budget will be provided. In addition, the Adaptive Plan will provide an update on other regional projects that either could affect Greeley's water supply system or that Greeley could participate in.

An important part of this action will also be acting on new identified water resources opportunities. The Adaptive Plan will provide an update on new water resources opportunities such as decisions made, the results of any studies, and recommended next steps. For example, the IWRP identified retiming storage for Terry Ranch as a potentially effective new water resources project. Greeley is planning on evaluating in more detail retiming storage options after the IWRP. The Adaptive Plan will update what is learned from that study and any further recommendations.





13.0 REFERENCES AND SUPPORTING DOCUMENTATION

13.1 SUPPORTING DOCUMENTATION

The following supporting documentation was developed during the IWRP and is included as Appendices to this Report.

- Appendix A: Water Resources 10-year Capital Improvement Plan
- Appendix B: Demand Forecast Technical Memorandum
- Appendix C: IWRP Greeley System Model Documentation Technical Memorandum
- Appendix D: IWRP Presentation Slides

13.2 REFERENCES

BBC Research & Consulting. *City of Greeley Population and Water Demand Projections*. 2018.

CDM Smith. *Northern Integrated Supply Project Environmental Impact Statement Common Technical Platform Hydrologic Modeling Report*. 2013.

City of Fort Collins Utilities (FCU). *Water Supply Vulnerability Study*. 2019.

City of Greeley Water & Sewer Department. *Greeley System Network Model Upgrade*. 2021.

Water Research Foundation (WRF). *Joint Front Range Climate Change Vulnerability Assessment*. 2012.



**CITY OF GREELEY, COLORADO
ACTING BY AND THROUGH ITS WATER AND SEWER BOARD**

RESOLUTION ____, 2023

A RESOLUTION TO ADOPT THE 2023 INTEGRATED WATER RESOURCE PLAN

WHEREAS, the City of Greeley (“City”) is a Colorado home rule municipality empowered pursuant to Sections 1 and 6 of Article XX of the Colorado Constitution to, *inter alia*, construct, purchase, acquire, lease, add to, maintain, conduct, and operate water works and everything required therefor, within or without its territorial limits, for use of the City; and

WHEREAS, Section 17-4 of the City Charter and Section 14.04.110 of the Greeley Municipal Code authorize and require the Water and Sewer Board (“Board”) to, *inter alia*, acquire water and sewer assets for the City; and

WHEREAS, Section 17-7 of the City Charter obligates the Board to develop and submit long range plans to the City Council for water improvements; and

WHEREAS, staff in coordination and collaboration with the Board has developed a long-term strategic water resource master plan that will ensure sustainable and affordable water supplies for the City’s customers now and into the future (“2023 Integrated Water Resource Plan”); and

WHEREAS, the Board intends to utilize the 2023 Integrated Water Resource Plan, attached as Exhibit A, to respond to future supply and demand changes by managing its water rights acquisition program and identifying and recommending to City Council appropriate short-term and long-term capital improvement projects.

NOW THEREFORE, BE IT RESOLVED BY THE WATER AND SEWER BOARD OF GREELEY, COLORADO, AS FOLLOWS.

1. The Board hereby adopts the 2023 Integrated Water Resource Plan, attached as Exhibit A, and recommends that City Council approve and accept the same as the Board’s long range plans for the water system.
2. This Resolution shall become effective immediately upon its passage and signature.

PASSED AND ADOPTED, SIGNED AND APPROVED THIS ____ DAY OF MAY 2023.

ATTEST

CITY OF GREELEY
WATER AND SEWER BOARD

Raymond Lee
Secretary to the Board

Harold Evans
Chairman, Water and Sewer Board



Water & Sewer Agenda Summary

Date: May 17, 2023

Key Staff Contact: Michaela Jackson, Water Quality and Regulatory Compliance Manager Keri Fishlock, Civil Engineer I

Title: Lead and Copper Rule Revisions – Lead Service Line & Replacement Project Update

Summary:

This presentation will be an update from December, 2022 on the Lead and Copper Rule Revisions. This update will present the progress, inventory, communications, and next steps for Greeley Lead Protection program. The attached documents are an information booklet about the Lead Protection program in Greeley and how customers can participate.

Recommended Action: None

Attachments: Lead-Fact-Booklet

LCRR Compliance Update: Lead Protection Program

Keri Fishlock
Project Manager

Michaela Jackson
WQ & Regulatory Compliance Manager

**Water & Sewer Board Presentation
May 17, 2023**


Lead and Copper Rules Revisions (LCRR)

- **EPA revisions to Lead and Copper Rule, effective October 16, 2024**
 - **Establishes a "Trigger Level" at 10 ppb for regulatory sampling results**
 - **Changes to site sampling – collection procedure and site selection**
 - **School and childcare facility sampling requirements**
 - **Defines "galvanized downstream" as a lead source requiring replacement (galvanized service lines connected to current or historical lead)**
 - **Inventory of material of all service lines in distribution system (public and private)**

Background on Service Lines

What is a service line?

- A service line is the pipe that provides drinking water from the water main to customers homes
- Two Maintenance Responsibilities:
 - Public: From the water main to the curb stop
 - Private: from the curb stop to the internal plumbing

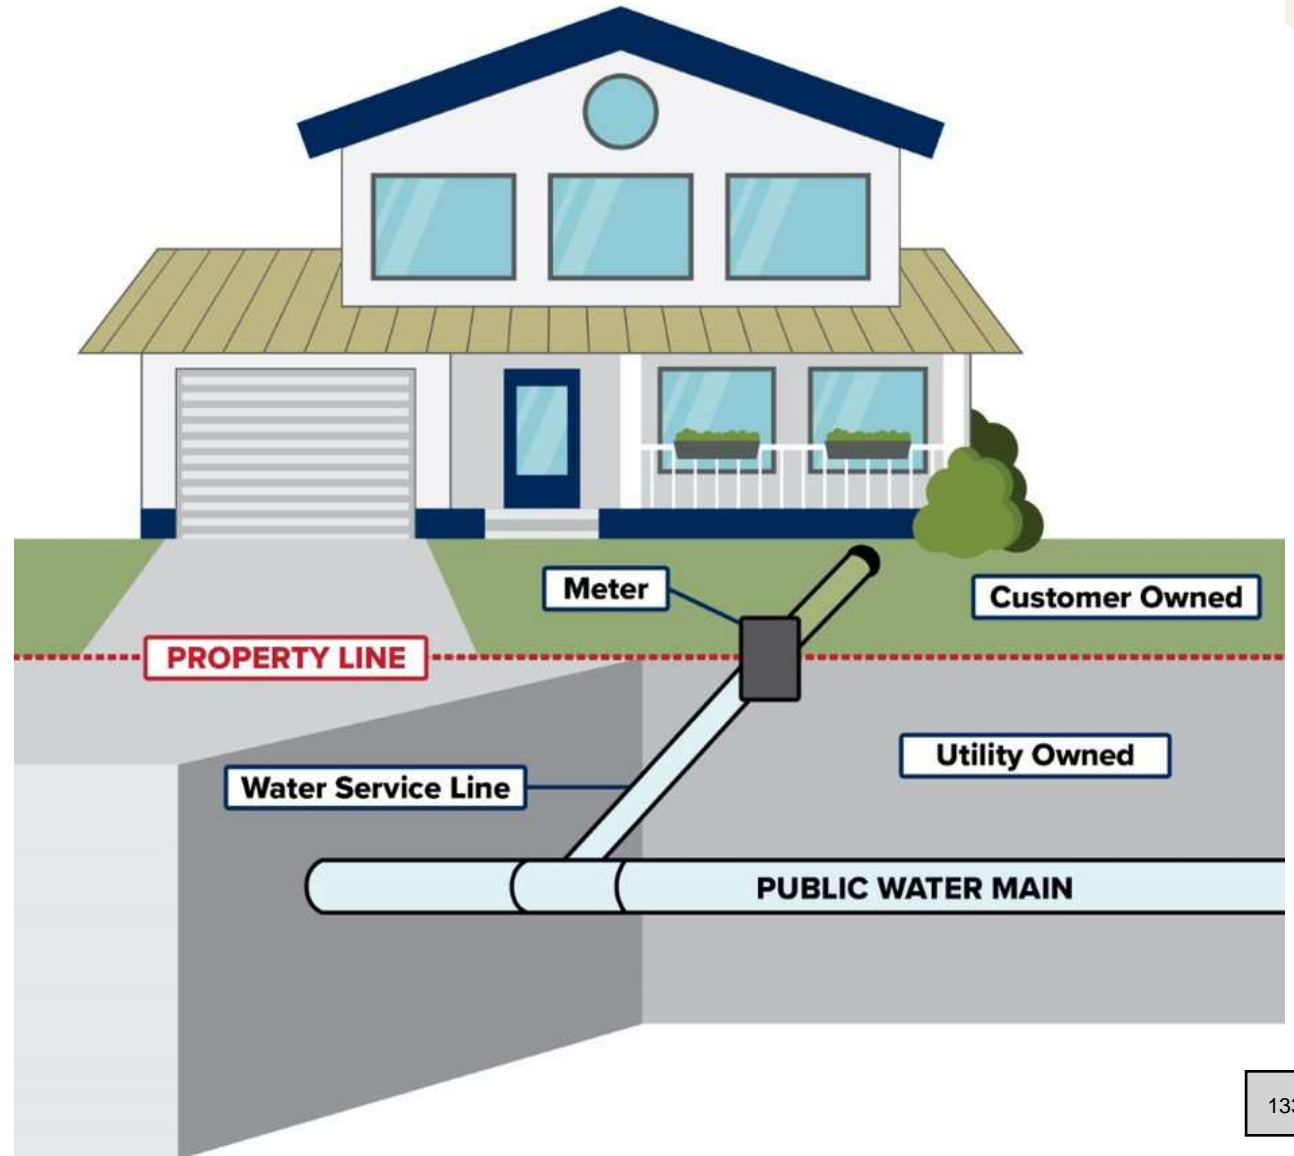

Lead Protection Program

- **Program Initiation:**
 - Updated page on Greeley Water & Sewer Website
 - Email: LeadProtection@GreeleyGov.com
 - Developed Communications Plan:
 - Messaging
 - Graphics
 - Education/Outreach Materials
 - Coordination with schools and childcare facilities
 - Coordination and outreach with Private Systems
 - Project: Lead Service Line Inventory and Replacement




Lead Service Line Inventory and Replacement Project

- **Project to identify and replace lead service lines in Greeley's Distribution System**
 - **Potholing**
 - **Other verification methods**
 - **Replacing lead and galvanized downstream lines**
 - **Public-facing inventory for LCRR (October 2024)**




Background: Greeley Lead

- In 1980, Greeley adopted the International Plumbing Code banning the use of lead in water service lines.
- Greeley started removing *public* lead lines in 1990's found through:
 - Meter program
 - Cement mortar lining program
 - Leak detection
- Recorded in "Lead Book"

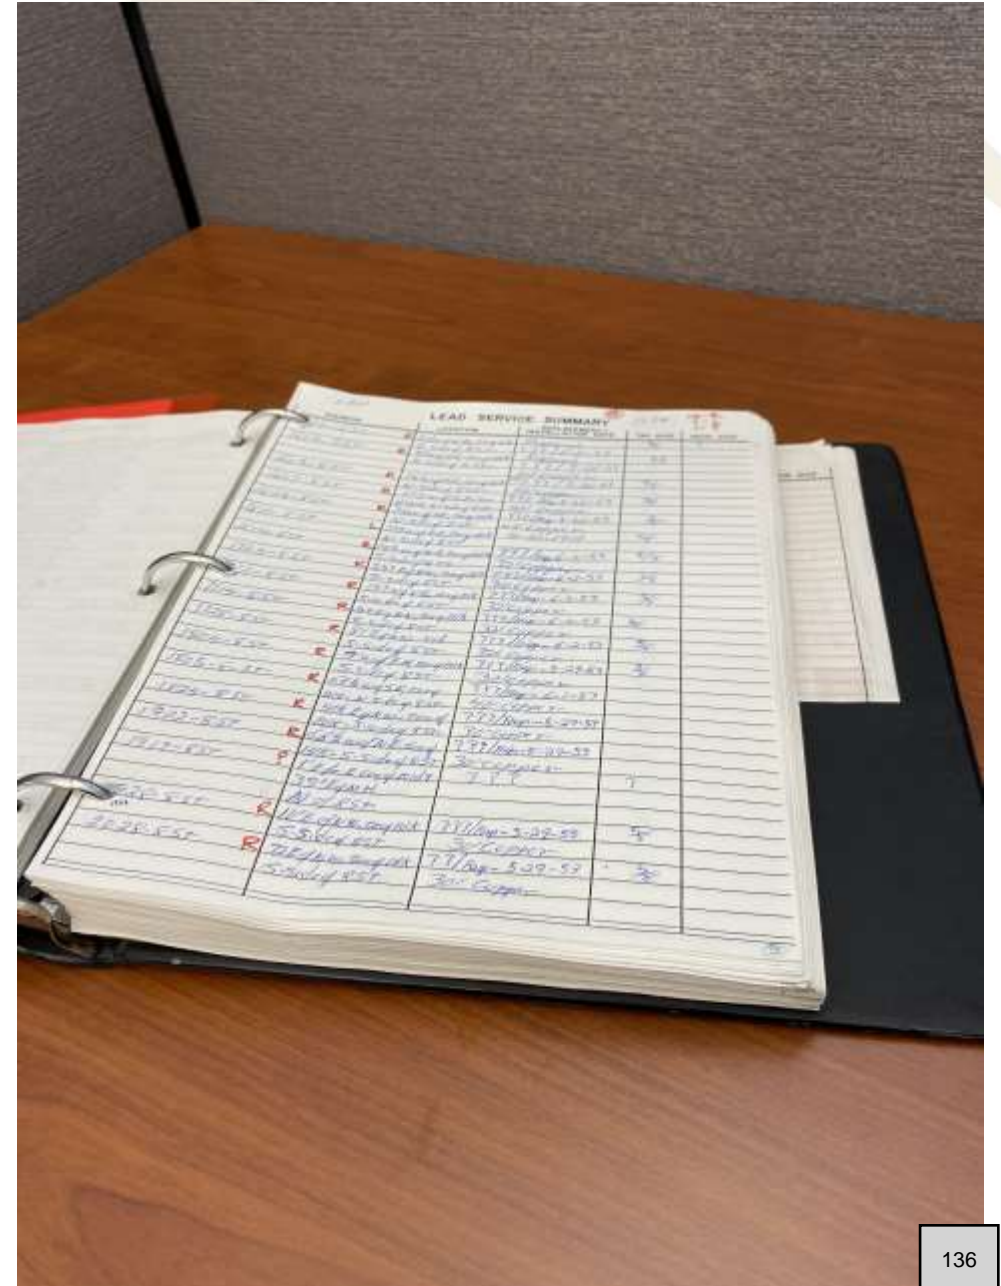

High Priority Locations: Lead Book

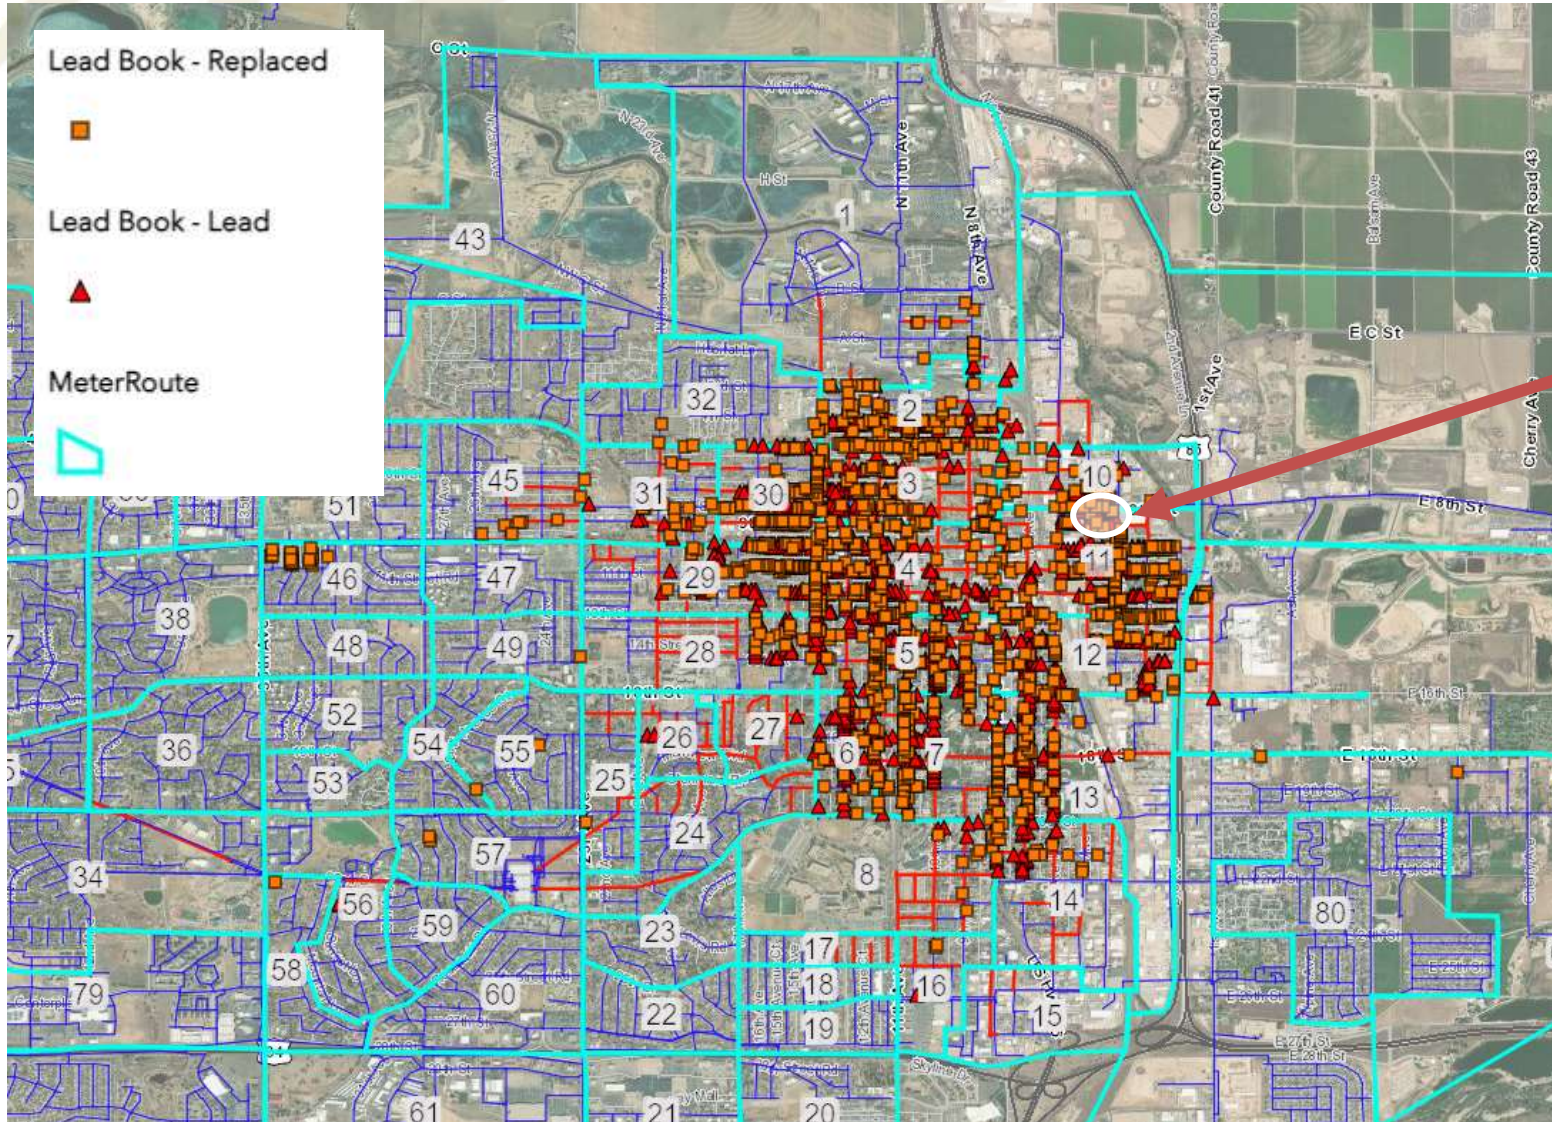


- 1,800 properties recorded
- 860 “lead”
- 975 “replaced”

Phase 01 Initial Potholing Area

- To ensure possible risk of lead exposure is minimized, all Lead Book sites are being provided with a pitcher filter and replacement cartridges

Phase 01 Potholing: February-March 2023

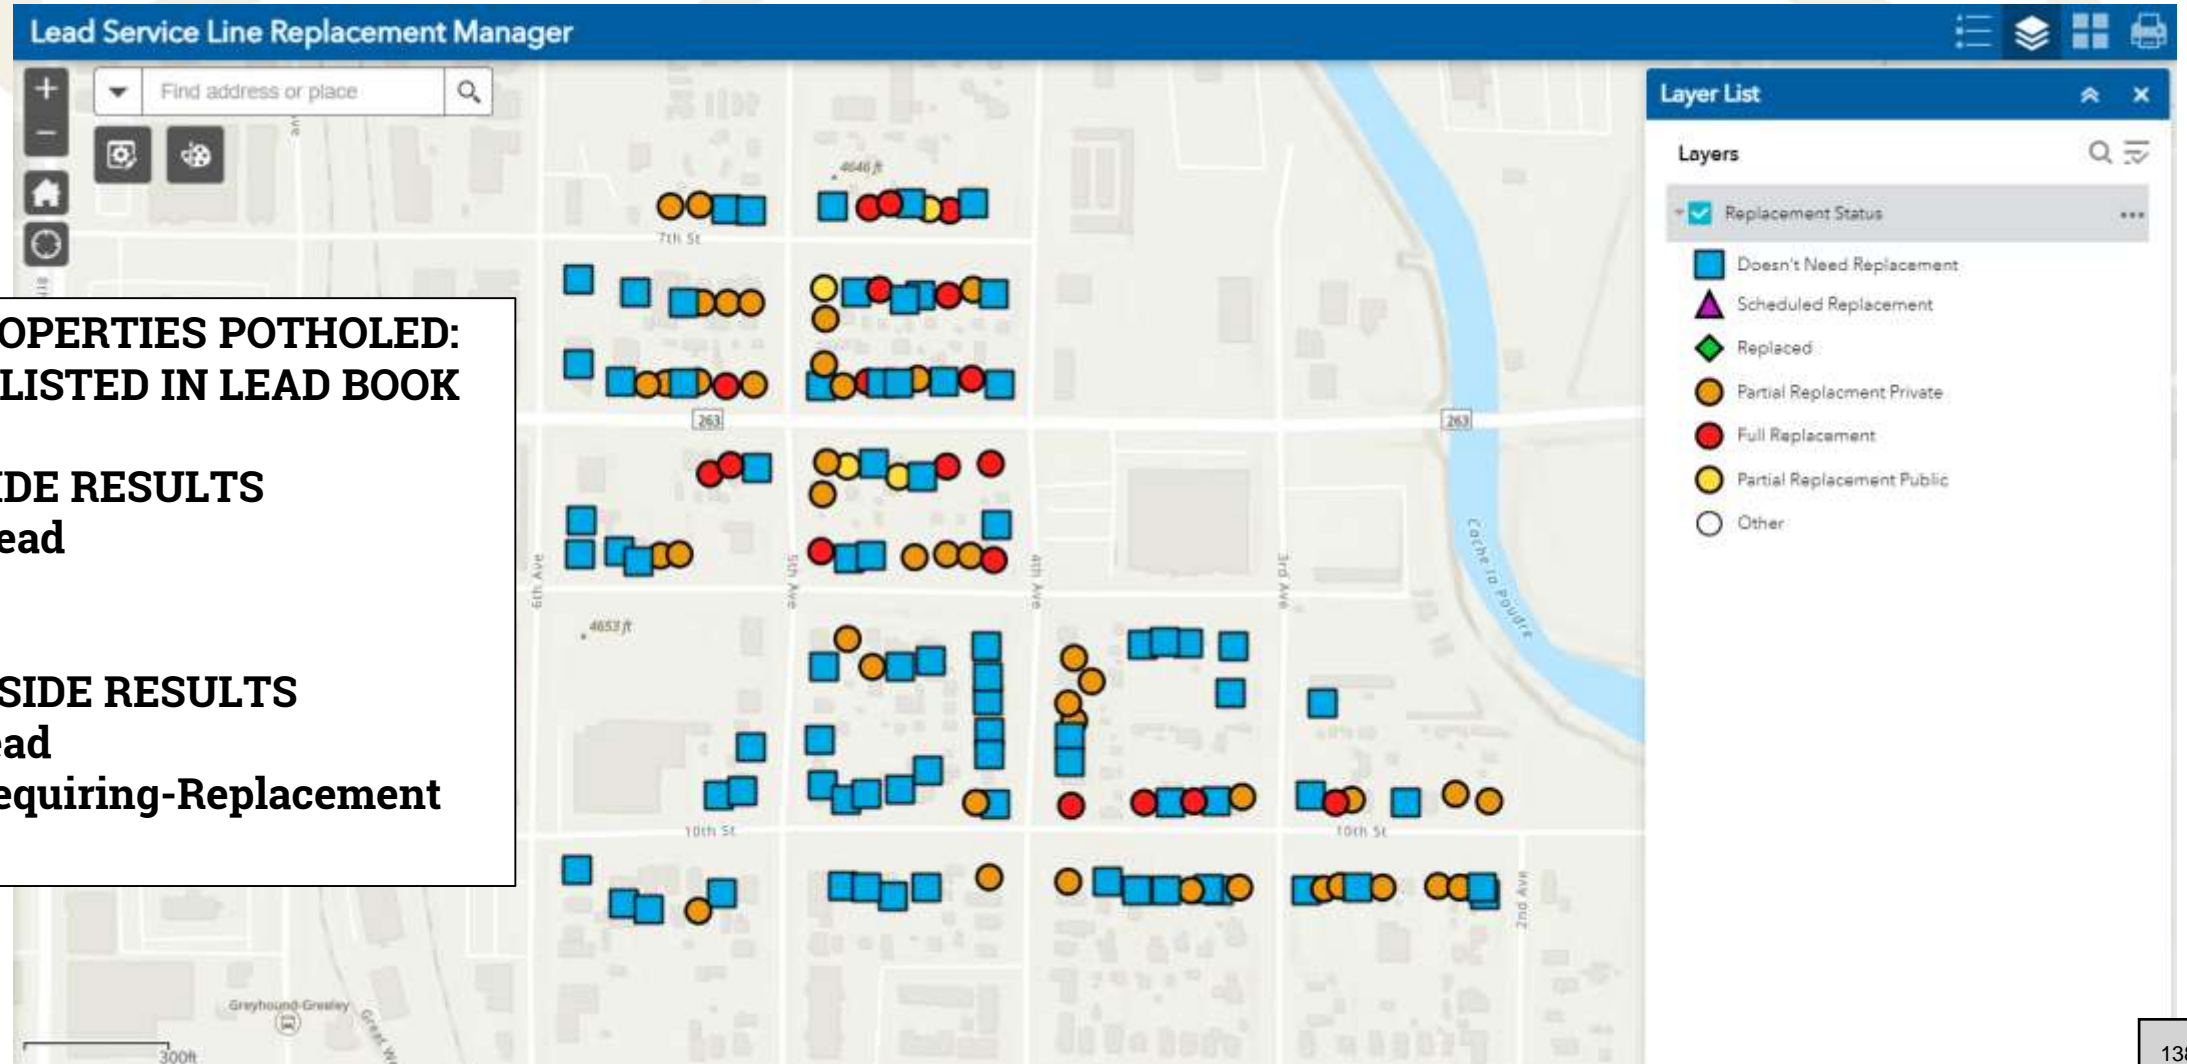

**OF 139 PROPERTIES POTHOLED:
111 WERE LISTED IN LEAD BOOK**


PUBLIC SIDE RESULTS

**118 Non-Lead
21 Lead**

PRIVATE SIDE RESULTS

**94 Non-Lead
44 Galv-Requiring-Replacement
1 Lead**

Phasing Plan 2023-2025 (DRAFT)

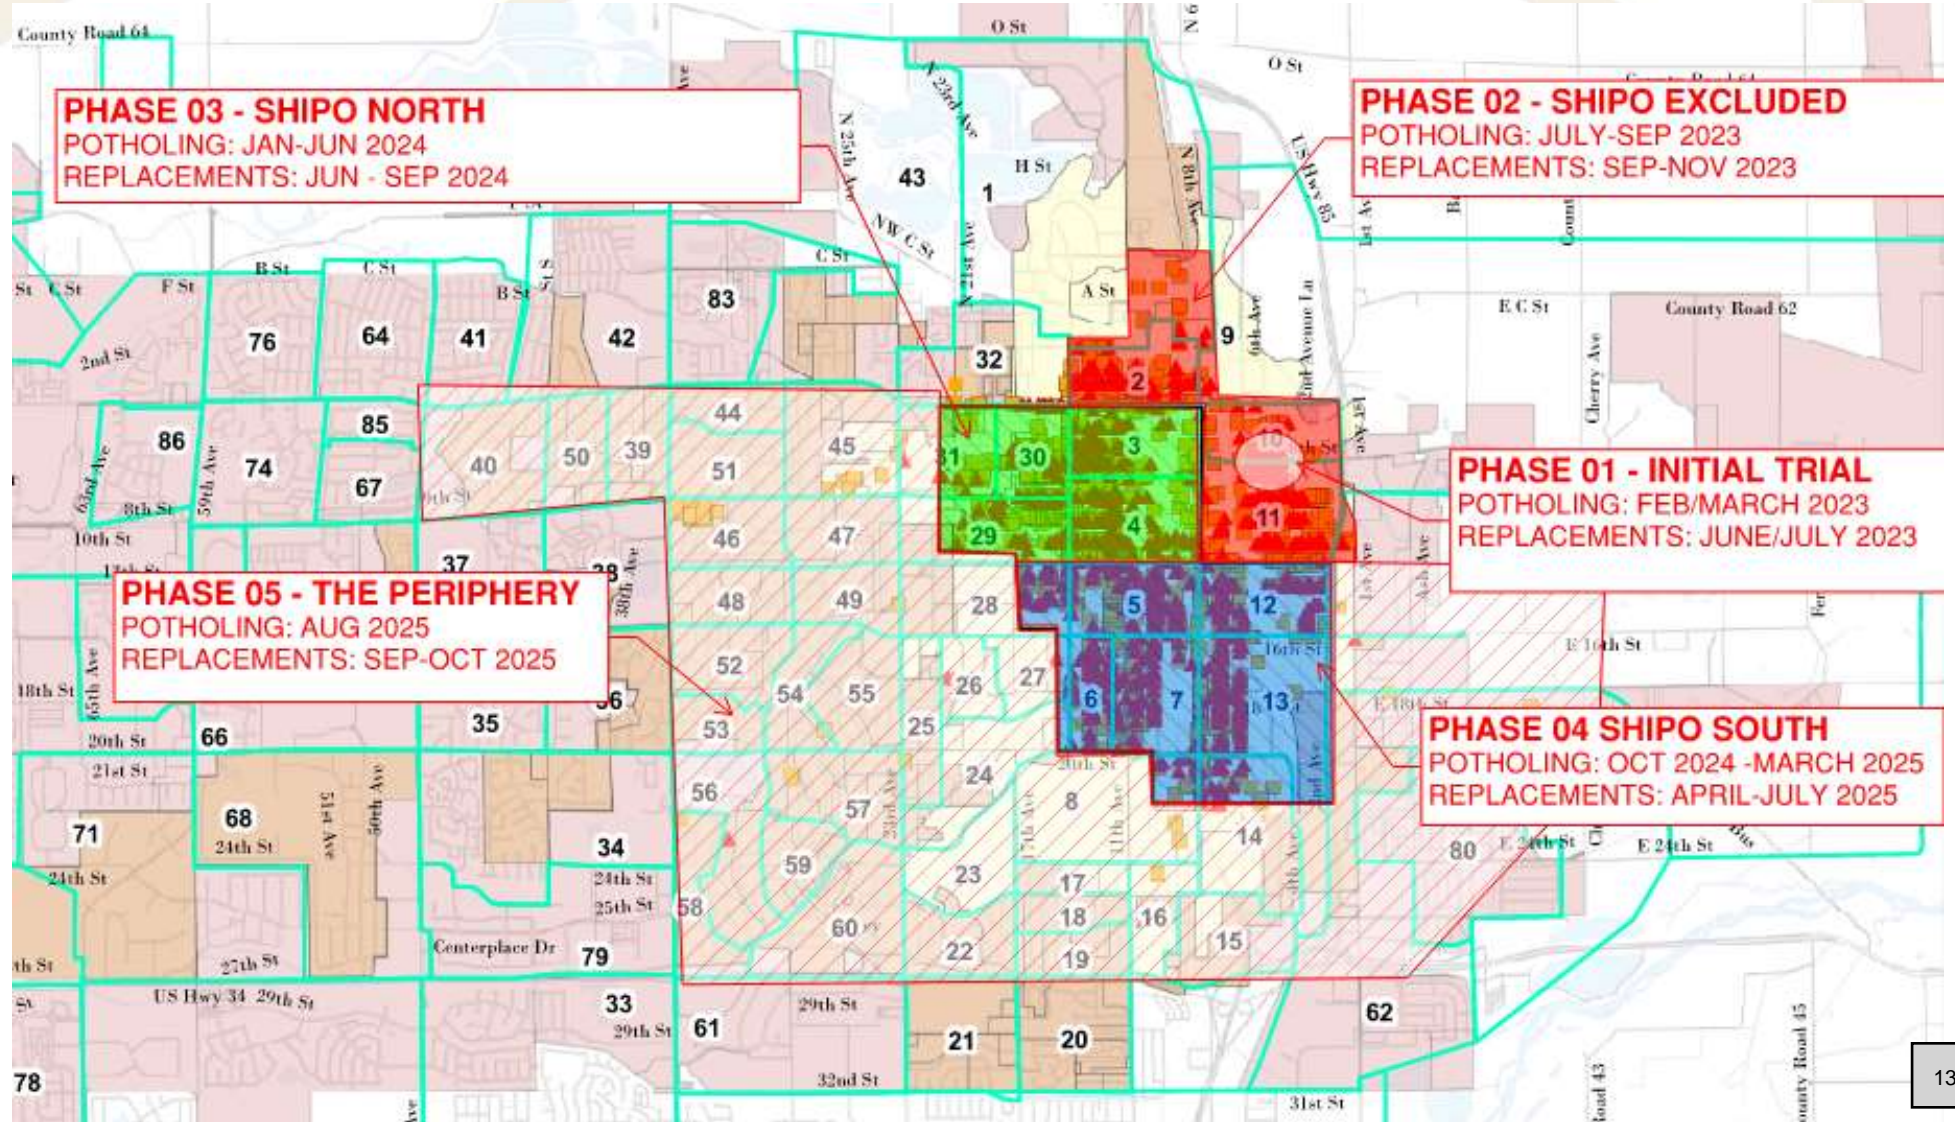

Annual Budget - Estimates

	ORIGINAL ESTIMATE	REVISED ESTIMATE
2023	\$2.0M	\$4.5M - \$5.5M
2024	\$2.0M	\$7.5 - \$8.5M
2025	\$2.0M	\$7.0 - \$9.0M
2026	\$2.0M	-
2027	\$2.0M	-
TOTAL	\$10M	\$19M - \$23M


APPROXIMATE BREAKDOWN:

POTHOLING	\$4.3M
REPLACEMENTS	\$15.8M
OTHER COSTS	\$1.6M




State Revolving Fund – Grant Application

- Pursuing low interest loan and 50% loan forgiveness through State-administered Federal funds
- Eligibility requirements include:
 - Public Meeting: May 18th at 6:30 PM, City Center South Council Chambers
 - Analysis of construction project area by State Historical Preservation Office (SHPO)

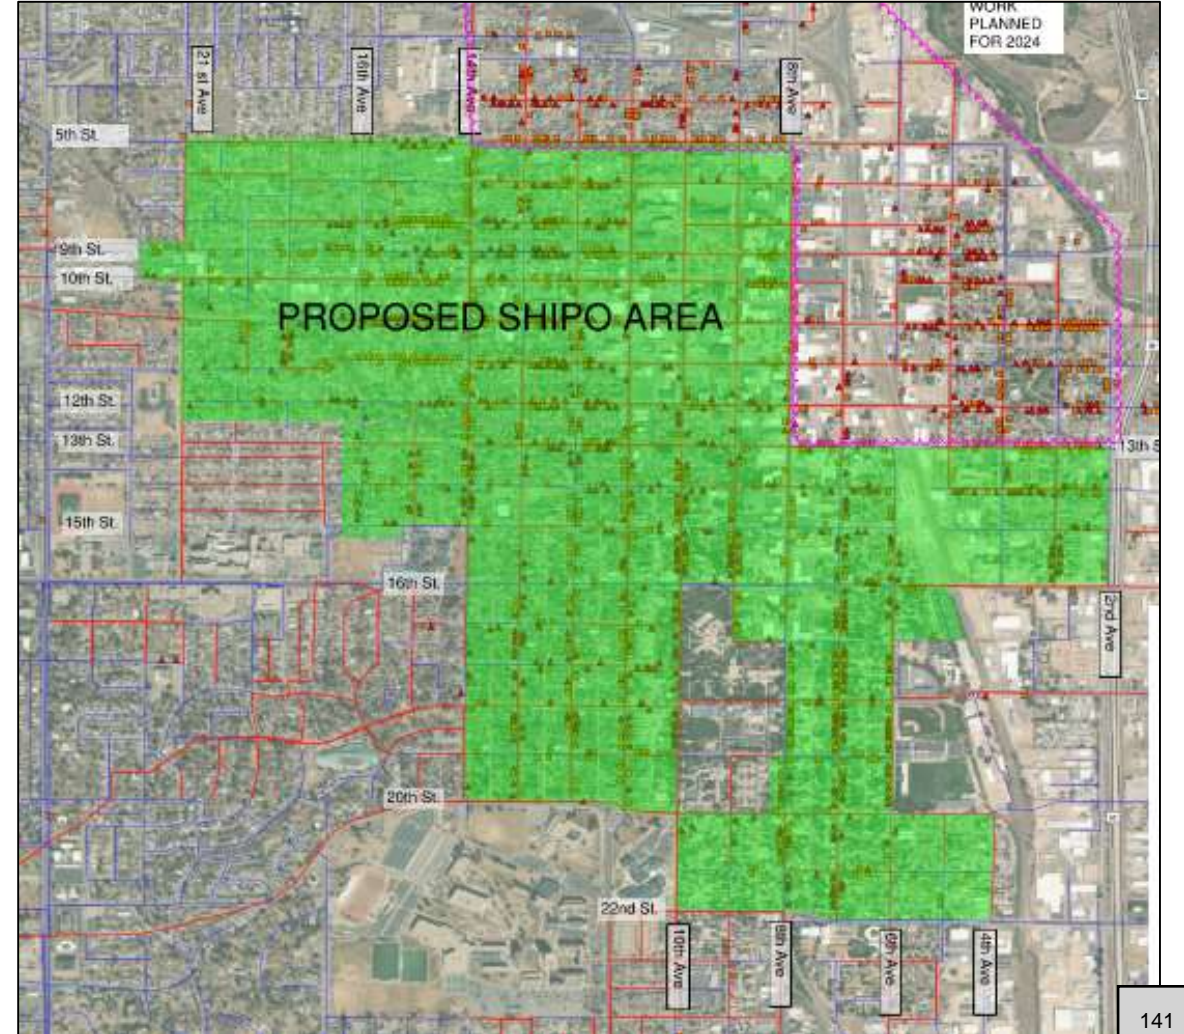

Cost Savings: Other Verification Methods

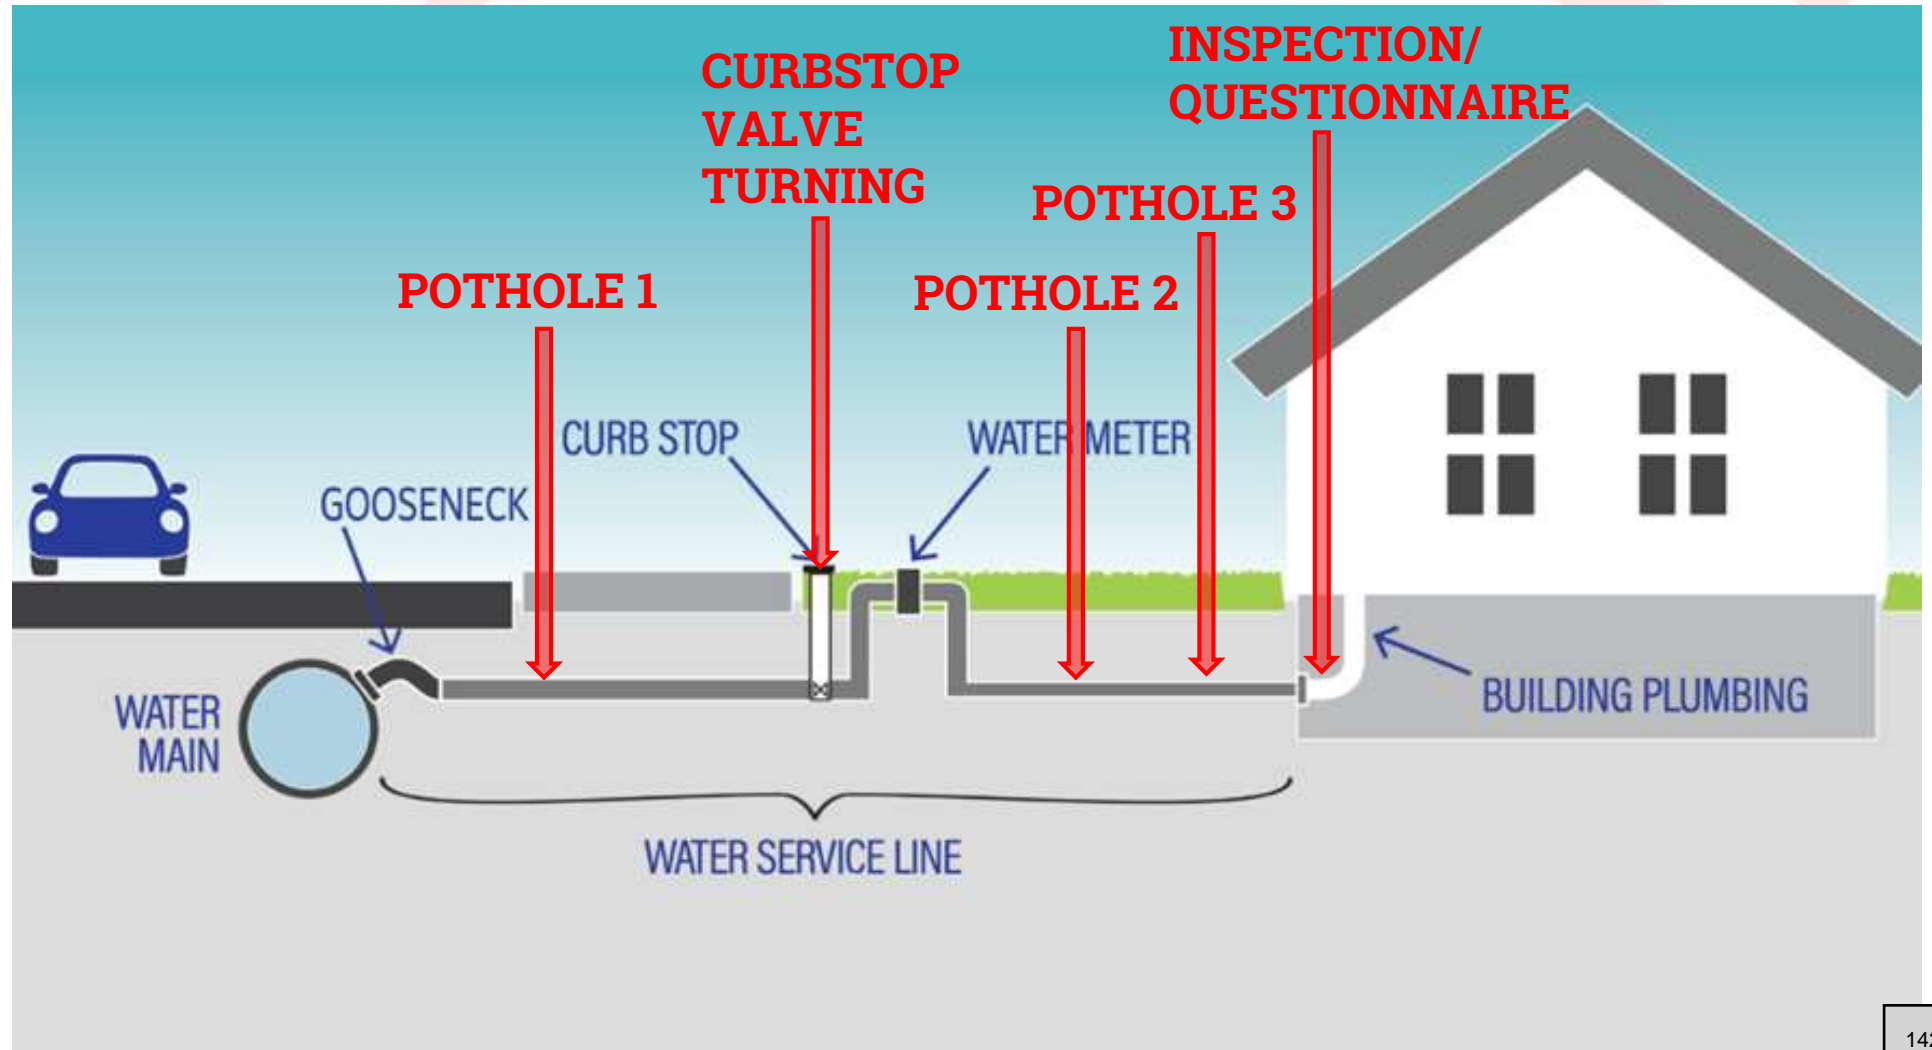


Cost Savings: Other Verification Methods

- **Historical Records**

- Lead Book Entries
- Build Date
- Tap Cards
- Archive Cards

Age of Greeley Homes Determines Potential for Lead Service Lines

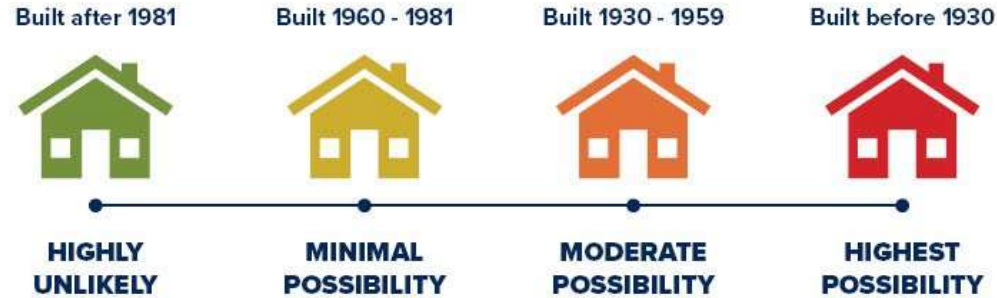


**This graphic refers to customer-owned service lines only*

- **Service Line Questionnaire**

- Private-side material



Data Integration & Statistical Analysis

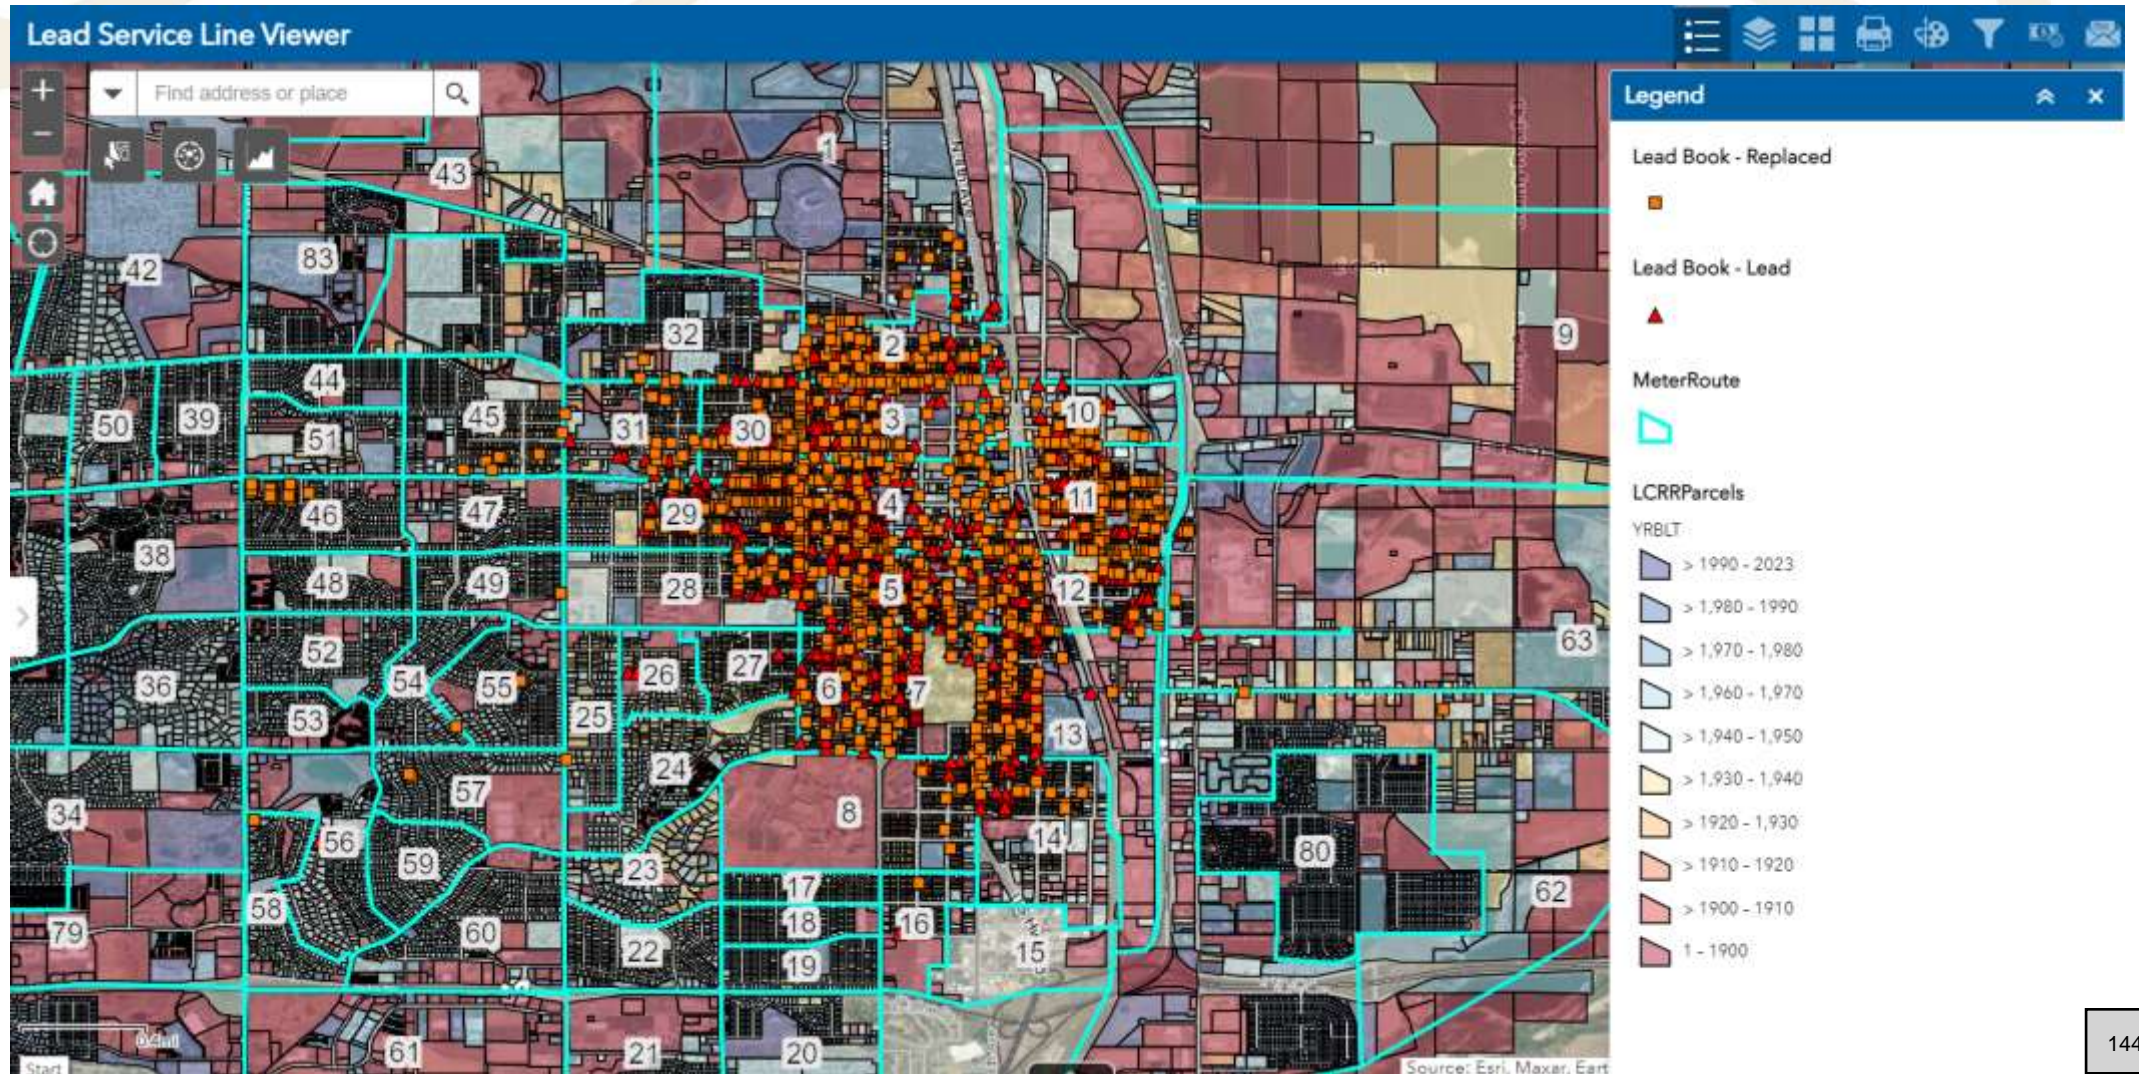

Next Steps

- **Pushing Service Line Questionnaire out to whole city (Pre-1981 Build Dates)**
- **Ongoing potholing and replacements – supplemented with other verification methods**
- **Contract with 120Water on pitcher filter distribution and post-replacement sampling**
- **Pipe Loop Study and optimizing corrosion control at Water Treatment Plants**
- **Partnering with Asset Management to utilize Esri ArcGIS Solution for data management, tracking project progress, and developing public-facing map**

Questions?



Steps you can take to reduce risks from lead

If you're concerned that your service line or plumbing fixtures may contain lead, here are some steps you can take to reduce your risk:

- ◆ Inspect older plumbing (pre-1987) and use filters.
- ◆ Inspect and replace faucets and indoor plumbing with "lead-free" components.
- ◆ Use a water filter that is labeled as NSF53/ANSI-certified. Filter water for drinking, making tea and coffee, cooking food like rice, pasta, beans, and soup, and for baby formula. Follow manufacturer recommendations on filter replacements.
 - Note: The City of Greeley will provide free filters to select customers who are believed to have a lead service line.
- ◆ Clean out faucet aerators (the small screen added to the end of a faucet), as they may have trapped particles from older service lines. Here's a video to show you how: todayshomeowner.com/video/cleaning-a-faucet-aerator
- ◆ If the tap water has sat in the lines overnight or while you were at work, use that water for non-consumption uses first--showing, laundry, cleaning, or watering houseplants.

Lead in drinking water

If present, elevated levels of lead can cause serious health problems (especially for pregnant women and young children). It is possible that lead levels at your home may be higher than other homes in the community as a result of materials used in your home's plumbing. If you are concerned about lead in your water, you may wish to have your water tested. When your water has been sitting for several hours, you can minimize the potential for lead exposure by flushing your tap for 30 seconds to 2 minutes before using water for drinking or cooking.



Additional information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available from the Safe Drinking Water Hotline (1-800-426-4791) or at epa.gov/safewater/lead.

Connect to Your Water

Water & Sewer Department
970-350-9811
water@greeleygov.com
greeleygov.com/water

Lead Protection
970-336-4273
leadprotection@greeleygov.com
greeleygov.com/leadprotection

Emergencies
Water (7am - 3pm) 970-350-9320
Water (7am - 3pm) 970-350-9322
After Hours 970-616-6260

Utility Billing
970-350-9811

Water Taste or Odor
970-336-4097

Water Pressure
970-350-9320

Water Conservation
970-336-4134
conserve@greeleygov.com
greeleygov.com/conserve

Water Restrictions & Violations
970-336-4134



Greeley Water is committed to working with businesses, residential property owners, schools and childcare centers, to identify potential lead service lines, test water for lead, and take appropriate actions based on those results.



Additional Resources:

- ◆ Greeley Water & Sewer: greeleygov.com/leadprotection
- ◆ EPA: [EPA.gov/lead](https://epa.gov/lead)
- ◆ Colorado Department of Public Health and Environment: cdphe.colorado.gov/lead



Greeley Water Service Line Inventory Project Lead Protection Starts With Inspection

Lead and Drinking Water

Greeley Water's top priority is to provide safe drinking water and protect public health. In recent years, there has been greater national awareness of the potential health risks of lead in drinking water. The water leaving Greeley's treatment facilities is lead-free. Our water testing confirms that lead does not come from our water supplies or the city's water delivery pipelines. However, lead may be present in older homes' plumbing and service lines. We are working with customers to identify and reduce those risks.


Lead Protection Starts with Inspection

Prior to 1981, lead piping was sometimes used for the service lines that connect older homes to the city's water system. As water runs through lead service lines or plumbing, the lead can dissolve or break off into tiny particles – ending up in drinking water.

Exposure to lead over a long period may cause health effects, so it's important to identify its presence and remove any source that may contaminate water as it enters a home or building. You can learn about potential health impacts here: epa.gov/lead/learn-about-lead.

What is a water service line?

A water service line is an underground pipe that carries water from the public water main, in the street, into your home or building.

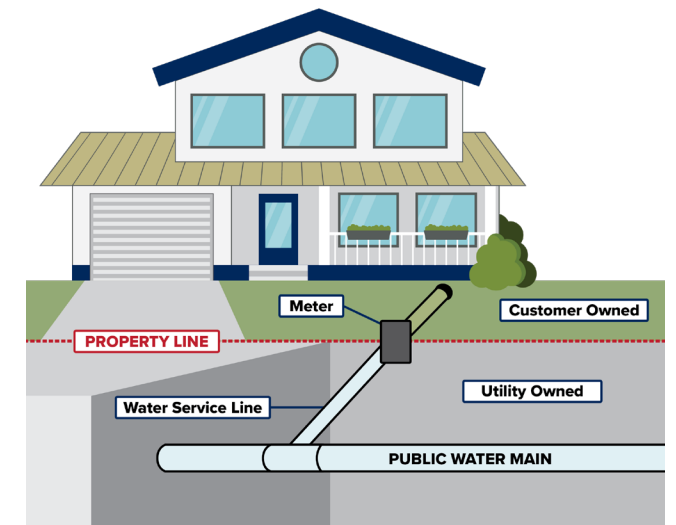

As shown in this diagram, the city owns the service line that runs from the main water line to the property line. The customer owns the service line, which may include the curb stop and water meter, that runs from the property line into their house.

The Water & Sewer Department has already replaced all known lead service lines on the city's side. However, there may still be sections that contain lead on the customer side of the water meter.

Inspection and Replacement Program Beginning in 2023

- ◆ In early 2023, Greeley Water will begin inspecting and replacing customer service lines that are found to contain lead at no cost to the homeowner.
- ◆ **Having a lead service line does not necessarily mean a customer has lead in their drinking water. Part of the inspection process may involve water sampling and testing.**
- ◆ The City of Greeley must create a publicly available inventory of the materials used in water service lines to comply with the new Environmental Protection Agency revisions to the regulation known as the Lead and Copper Rule by October 2024.
- ◆ The inventory will help Greeley Water plan for the phased replacement of customer-owned lead service lines.

Learn more at greeleygov.com/leadprotection


Lead Protection Starts With Inspection

How the inspection program will work

Greeley Water will begin with inspecting about 1,900 older houses that have a higher possibility for having lead service lines. When a service line is found to contain lead, the city will replace the line at no cost to the homeowner.

Customers at these locations will receive advance notifications about what to expect during the process. This graphic shows how the age of the house can affect the possibility that a lead service line exists on that particular property.

Age of Greeley Homes Determines Potential for Lead Service Lines

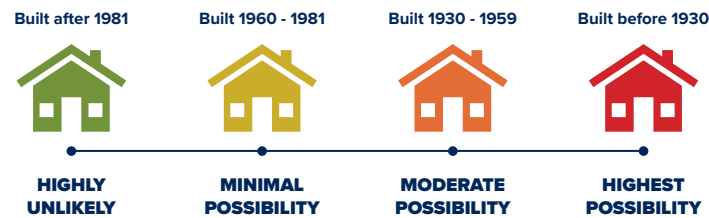

**This graphic refers to customer-owned service lines only*

- After 1981 = **Highly Unlikely**: Homes built after 1981 should not have lead service lines. In 1981, Greeley adopted the International Plumbing Code banning the use of lead in water service lines.
- 1960-1981 = **Minimal possibility**: Based on available data, homes built between 1960-1980 have minimal possibility of lead service lines and will be inspected in future phases.
- 1930-1960 = **Moderate possibility and pre-1930 = Highest possibility**: In the past, the City of Greeley has found lead service lines primarily in homes built prior to 1960 with homes constructed before 1930 having the highest possibility of service lines containing lead. These homes will be prioritized for the initial phase of inspections.
- Pre-1987 plumbing**: Plumbing installed prior to 1987 could also contain lead or lead solder. Customers should inspect and replace older plumbing with certified lead-free fixtures, and consult with a licensed plumber for assistance.

Steps customers should take

1. Help Greeley Water determine if you have a lead service line.


- If your home was built before 1981, complete the Service Line Questionnaire at greeleygov.com/leadprotection.
- If your house was built **AFTER 1981**, you do not need to complete the questionnaire.
- The questionnaire asks customers to provide information and photos of where the service line enters the house.
- Contact Greeley Water if you need assistance at leadprotection@greeleygov.com or 970-336-4273.

If the results indicate a potential lead service line, the city will follow up to coordinate the next steps. Having a lead service line does not necessarily mean you have lead in your water.

2. Work with our team if notified about an inspection



- Watch for notification letters and door hangers about water sampling or inspection work.
- Prior to inspections, Greeley needs your assistance in completing the online questionnaire to determine the makeup of the water service line entering your home or building.
- After you complete the questionnaire, the Water Department may complete an in-person inspection of the service line - entering your home or building. We may also complete a water quality sampling.
- Inspections may involve digging small holes (called potholing) so workers can visually inspect underground pipes.
- If inspection shows the service line contains lead, the city will schedule replacement at no cost to the homeowner.

Service Line Inspection Process

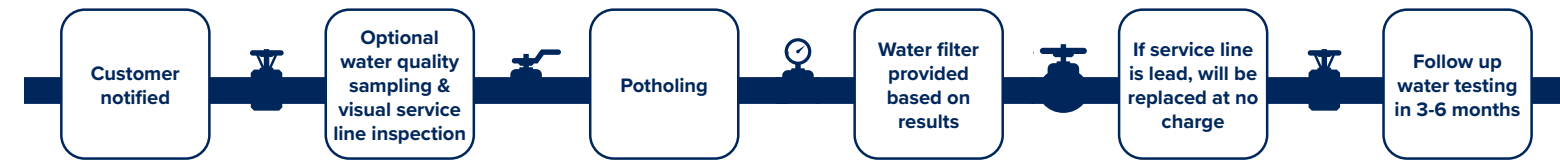

Note: City employees will always drive a City of Greeley vehicle and have identification. The city uses letters and door hangers to notify residents of the work in advance. Any contractors working for the City of Greeley to assist in potholing lines or other work will have a letter from the city authorizing them to complete specific tasks for this project.

General location of initial inspections

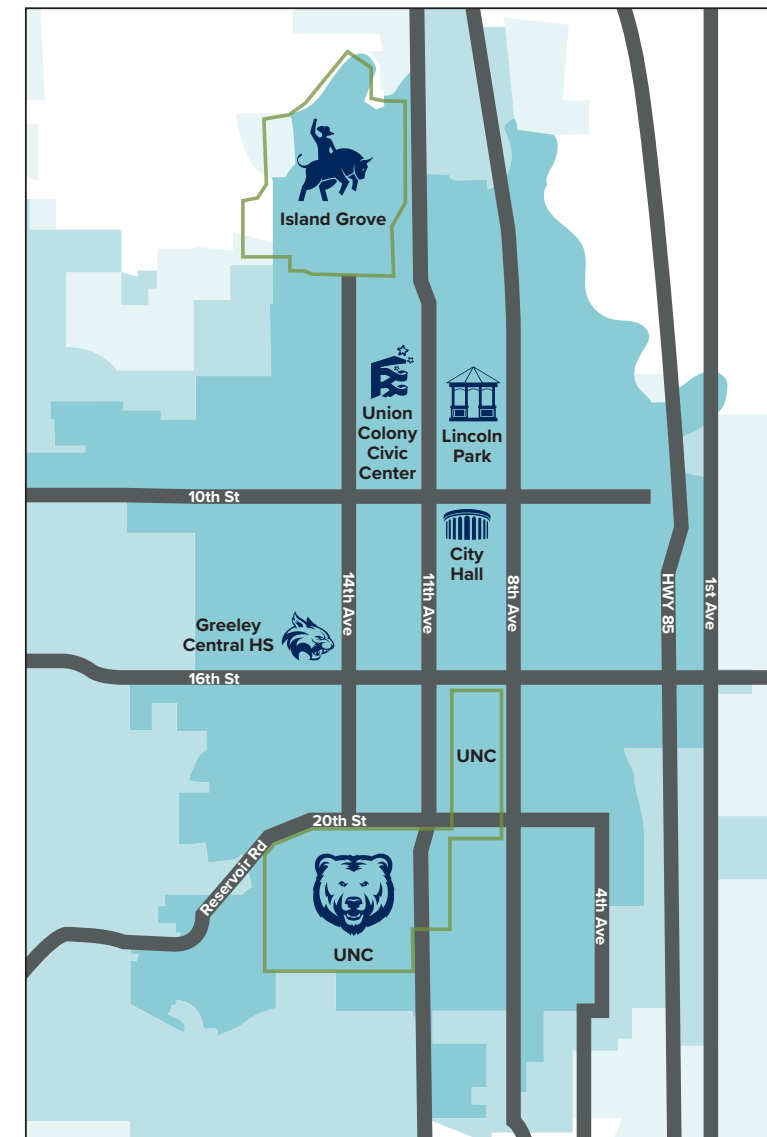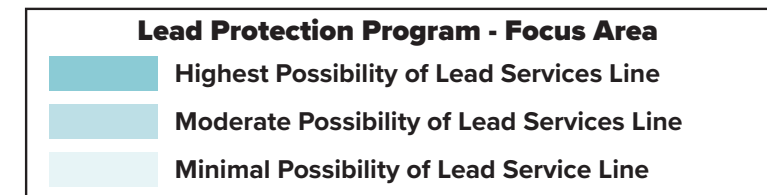

It's important to note:

- Greeley will start inspecting service lines at homes built before 1960 that have a higher possibility of lead.
- A lead service line does not necessarily mean there is lead in your water.
- Greeley Water uses treatment processes to prevent corrosion of water lines.
- We will offer lead testing at potholing sites and follow-up testing to ensure the removal of the lead source.

Submit an Online Questionnaire

If you want to participate in the lead testing, please complete the questionnaire at greeleygov.com/leadprotection or scan the QR code with your phone's camera. You will be contacted by Greeley Water staff when the free lead testing is available if your home meets the criteria for a potential lead line.



New EPA Regulations

New Environmental Protection Agency revisions to the regulation known as the Lead and Copper Rule require all water utilities to create a mapped inventory of water service line materials throughout the city and make it publicly available by October 2024. This comprehensive inventory will guide Greeley's program to replace any remaining lead service lines at no cost to the homeowner.



Water & Sewer Agenda Summary

Date: May 17, 2023

Key Staff Contact: Cadee Oakleaf, Civil Engineer III for WTRF

Title: Wastewater Treatment Nitrification Project Update

Summary:

This presentation will be an update to the board on the progress and status of the WTRF's Nitrification Phase 2 project.

Recommended Action: None

Attachments:



Nitrification Phase 2: Construction Update


May 17, 2023

Agenda



- Project Overview
- Current Status
- Work Completed
- Remaining Work
- Fun Facts and Photos

Project Overview

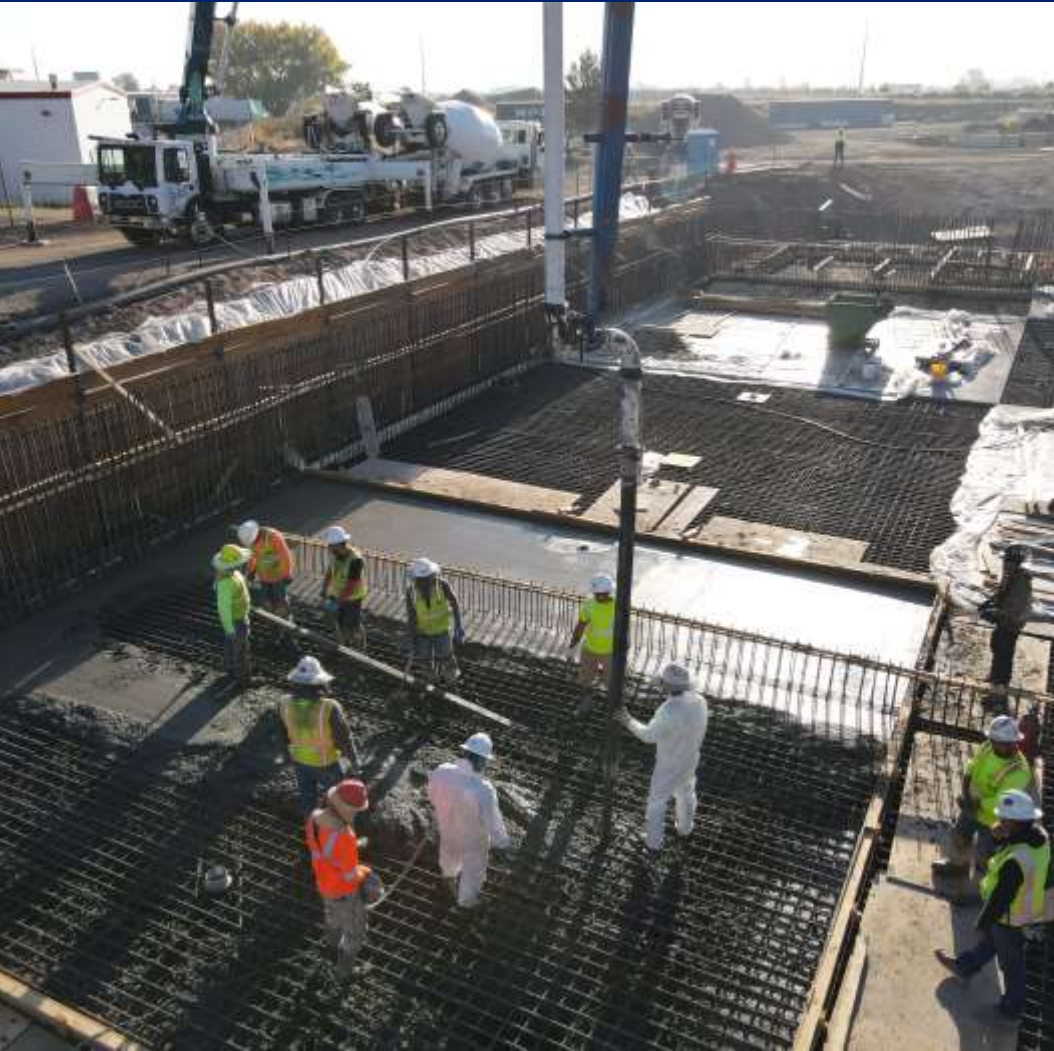

- Meets Reg 85 Limits and increased organic capacity
- Switch from MLE to A2O configuration
- Major Components
 - New Selector Basin (Anaerobic/Anoxic Zones)
 - Additional Aeration Basin/CaRRB
 - Rehab of existing Aeration Basins (1-4)
 - New secondary electrical building
 - RAS pumping upgrades
 - Ferric addition
 - New MLR pump station



Current Status



- Contract Value: \$30,164,082
- Change Order Percentage: 0%
- Total Work Completed and Stored to Date: \$25,213,377.04
- Total Contract Time: 915 days
- Current Time Used: 772 Days
- Potential schedule extension: 30 days
- 84% Complete




Work Completed



- Selector Basin
- Aeration Basin 0 / MLR Wet Well
- Secondary Electrical Building
- RAS Building Upgrades
- Aeration Basin 1 Rehabilitation

Resulting Data after New Basin Start-Up

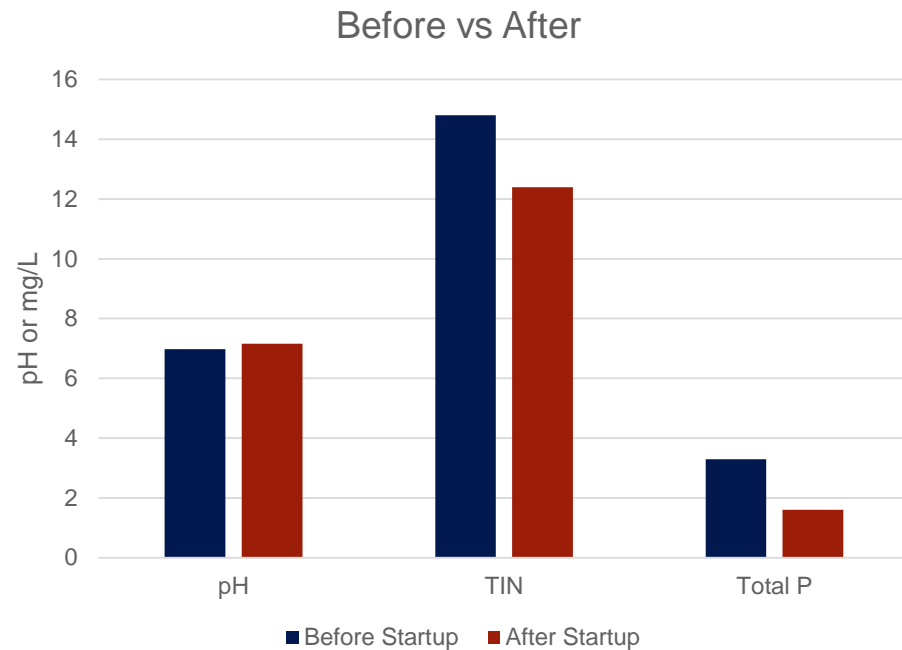

Date	pH	TIN (mg/L)	Total P (mg/L)
Reg. 85	N/A	13 ¹ 15 ²	1.0 ²
Feb '22 – Jan '23	6.98	14.80	3.30
Feb '23 – April '23	7.16	12.39	1.60
March and April '23 Only	7.18	11.32	1.55

- 1) Daily Max limit received during Site Application process
- 2) Regulation 85 running annual median limit



Work Remaining



- Rehabilitation of existing Aeration Basins 2, 3, and 4
- Ferric Addition
- Alkalinity Addition
- Site Restoration
- Anticipated Final Completion October 27, 2023



Fun Facts and Project Photos



- Total Concrete: 6000 CY (~600 full truck loads)
- Total Rebar: 925 tons
- Linear feet of yard pipe > 6": 3290ft
- Total electrical wire: ~68 miles
- Total Air Diffusers: 9347





Aerial - March 2023

Thank you





Water & Sewer Agenda Summary

Date: May 17, 2023

Key Staff Contact: Erik Dial, Deputy Director of Utility Finance and Customer Service

Title: 2024 Budget Overview and CIP Priorities

Summary: Staff will provide the Water and Sewer Board an overview of the 2024 budget preparation process and the department's priorities.

Recommended Action: No action needed. Informational only.

Attachments: PowerPoint

Water and Sewer 2024 Budget Overview



May 2023

Budget Story

- Largest municipal water utility in Weld County and growing
 - 2024 Budget is being developed with four focus areas:
 - Daily operations and protection of existing infrastructure
 - Customer service
 - Regulatory compliance and public health
 - Capital investments to refurbish existing facilities and extend infrastructure

Budget Story - Operations

- Large system footprint and complexity for a city the size of Greeley
 - Staffing investments
 - Operational staff for system growth
 - Some teams have not grown in 20+ years
 - Better system maintenance
 - Expand in-house construction ability
 - Automation
- System protection – infrastructure and water rights
- Optimize system for operational effectiveness



Budget Story – Customer Service

- Utility Billing and metering investments
 - Staffing
 - New Utility Billing Customer Information System (CIS)
 - Current system is 30 years old
 - AMI – Metering accuracy and transparency
- Communication
 - Key account program
 - Coordination with Communication and Engagement Dept
- Customer ability to pay issues
 - Assistance program
 - Conservation
 - Rates




Budget Story – Regulatory Compliance

- Wastewater treatment investments
- Water quality
 - Lead and Copper Rule Revision
 - Cross connection control
 - Industrial pretreatment
 - Source water
- Water rights defense



Budget Story – Capital


- Replacement/Rehabilitation needs
 - Asset management
- Strategic expansion
- Water rights
- Planning

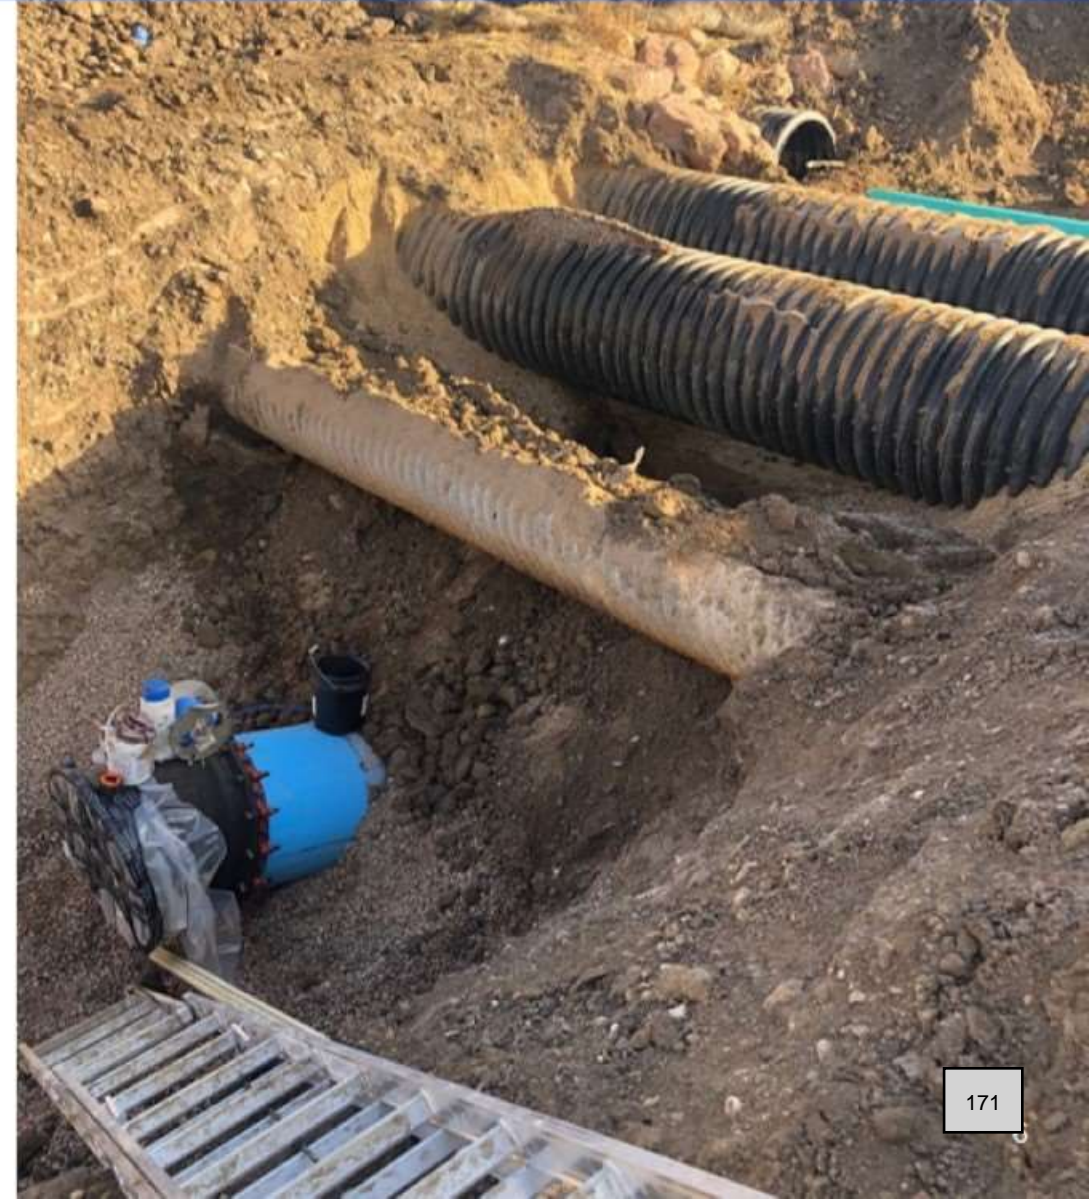

Budget Development Background




Annual Treated Water Production

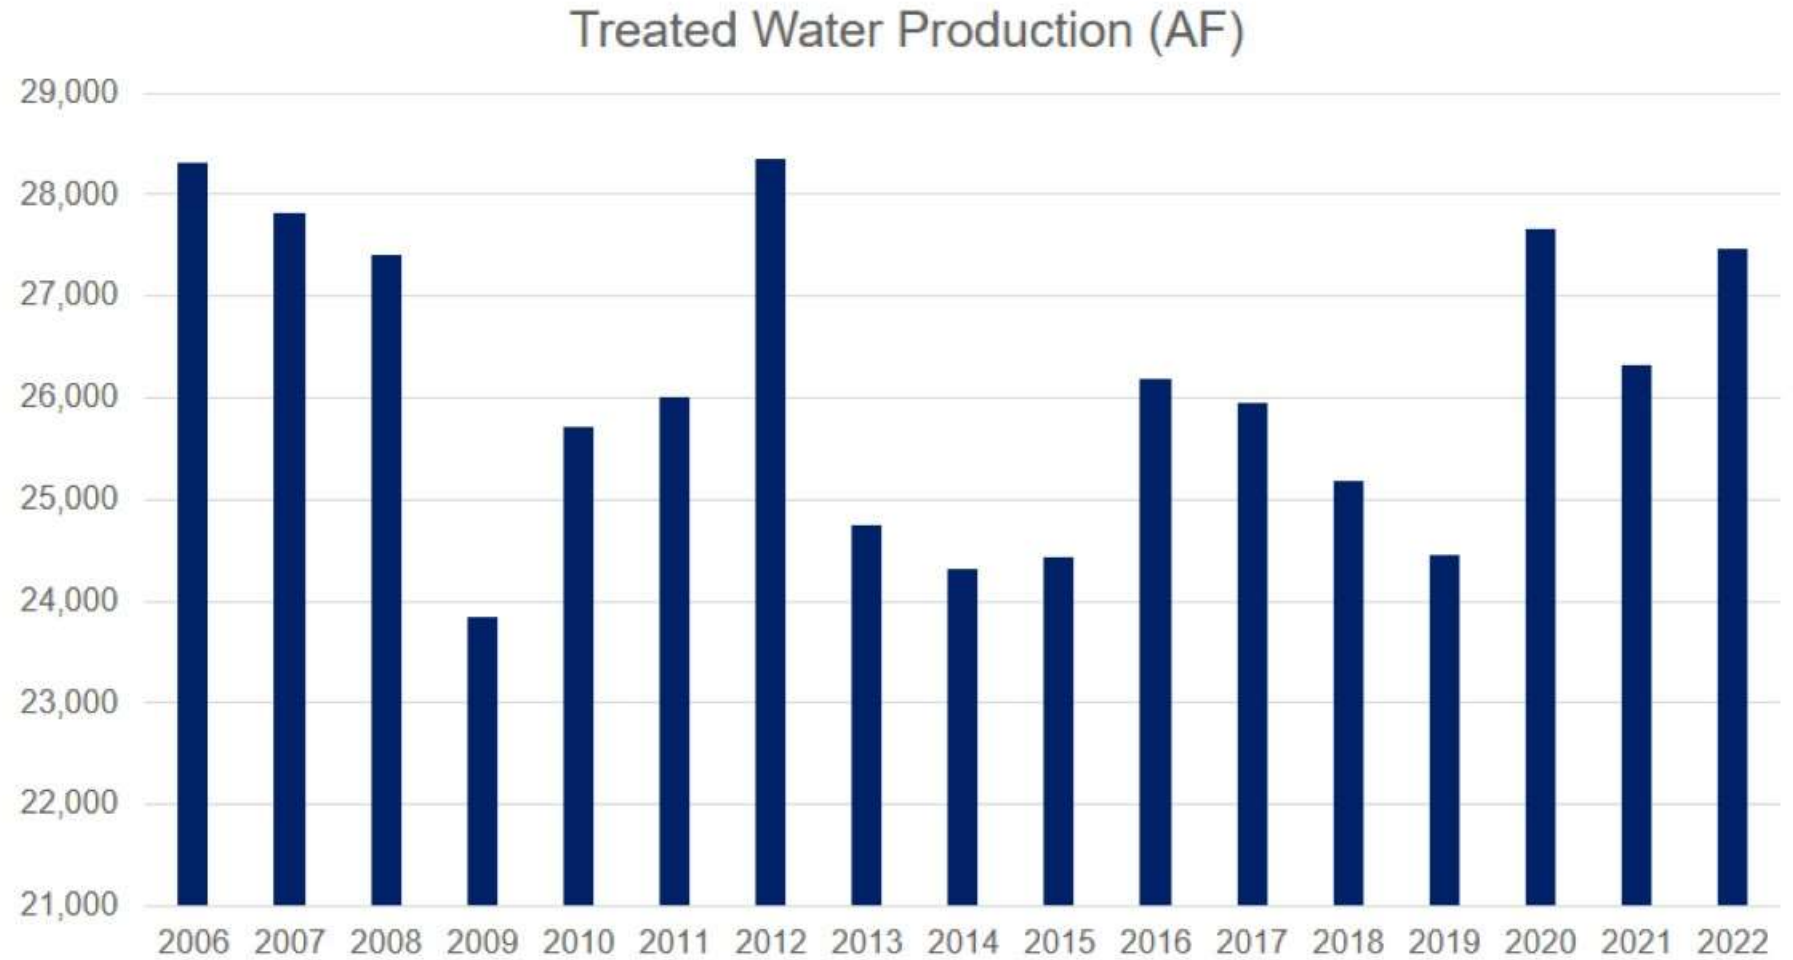

Water Operations Financial Overview


	Operating Revenue	Operations, Depreciation & Debt Svc
2013	38,238,419	31,613,280
2014	39,889,553	34,041,080
2015	36,052,172	35,033,241
2016	39,948,336	34,590,830
2017	39,634,117	35,966,615
2018	40,863,941	36,723,277
2019	42,086,422	37,719,770
2020	52,502,894	41,016,366
2021	48,720,440	40,304,429
2022	60,318,677	46,979,438
2023	51,620,334	49,997,457
2024	54,003,974	52,785,610
2025	57,427,902	54,061,839
2026	61,432,527	58,124,256

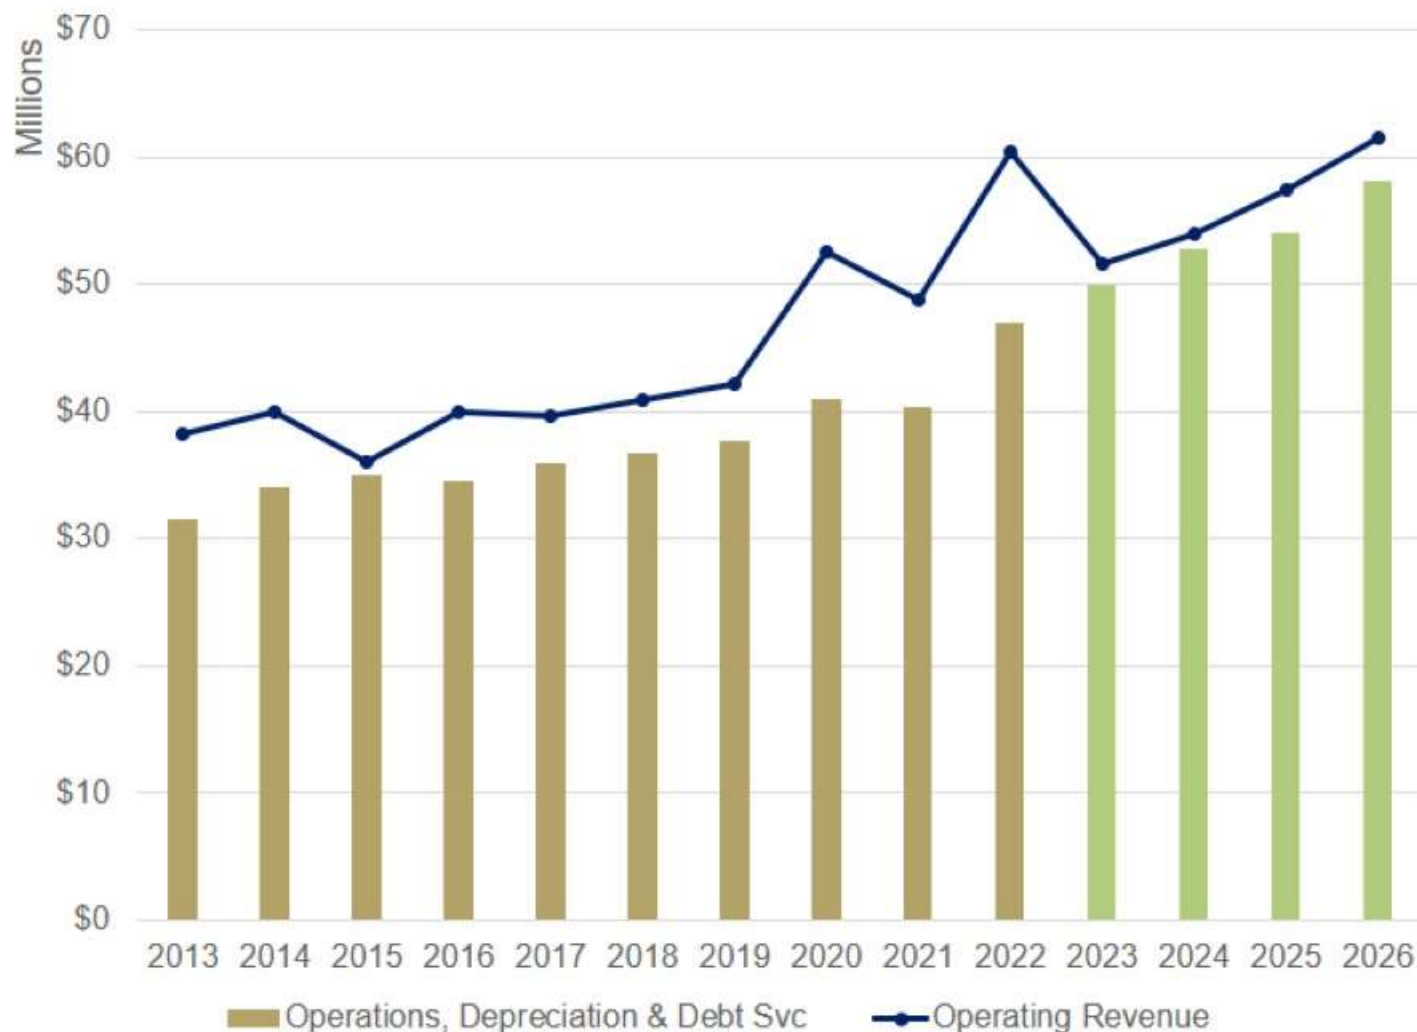

Water Capital Financial Overview


	Capital Expenditure
2017	21,762,543
2018	28,517,444
2019	28,569,394
2020	14,058,871
2021	100,516,476
2022	24,877,835
2023	50,232,327
2024	48,603,695
2025	47,309,137
2026	46,351,765

2021: \$60.5M reflects Greeley's contribution to Chimney Hollow Reservoir

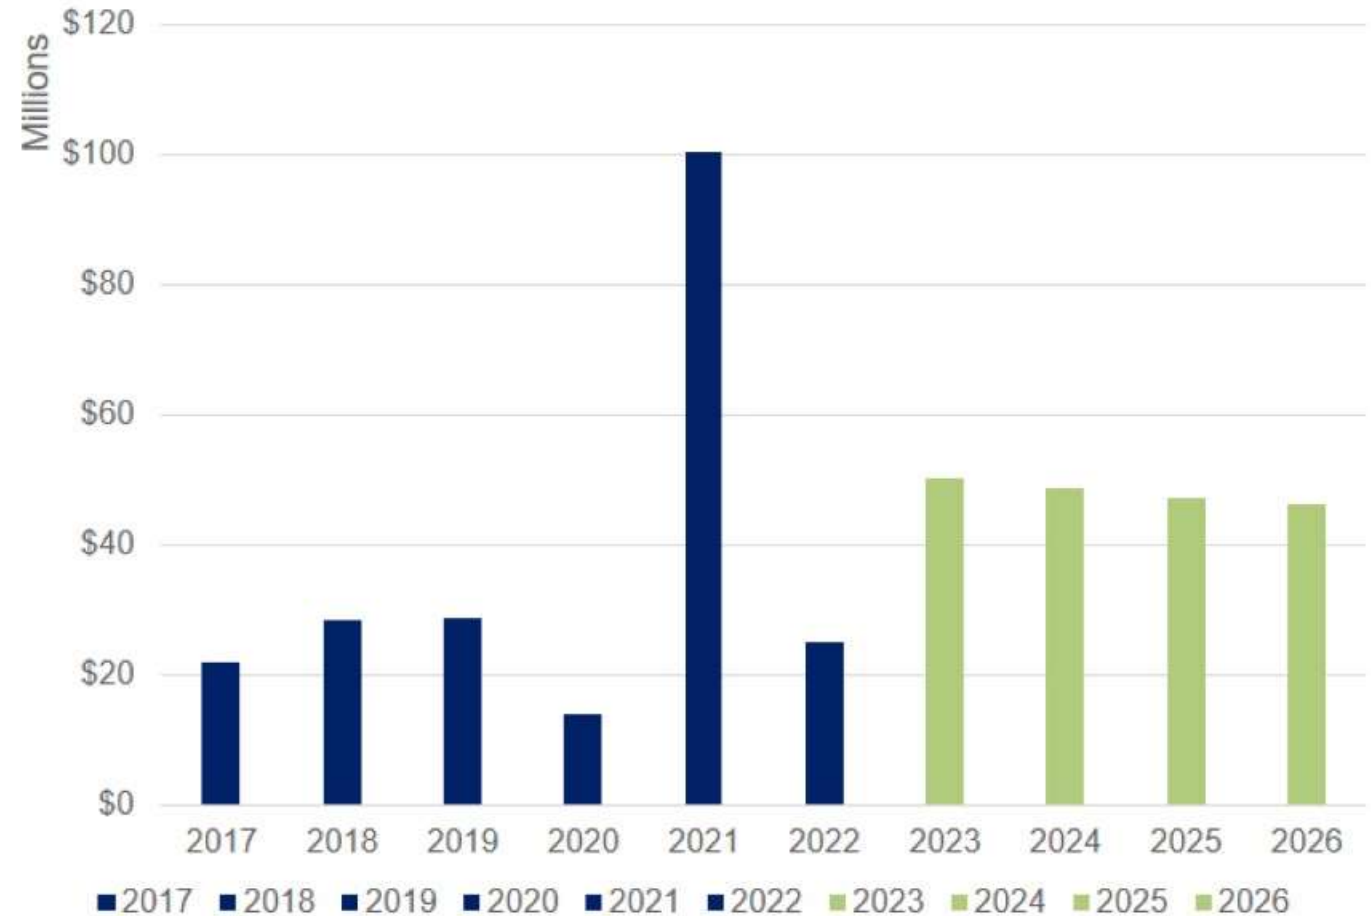


Sewer Operations Financial Background

	Operating Revenue	Operations, Depreciation & Debt Svc
2013	8,965,518	8,594,554
2014	9,169,231	9,812,879
2015	9,324,992	8,278,979
2016	9,272,219	9,206,602
2017	9,468,679	9,368,715
2018	10,011,565	10,473,874
2019	10,394,878	13,415,558
2020	11,084,681	11,781,154
2021	11,863,448	12,179,794
2022	15,920,304	12,454,581
2023	17,254,058	14,663,722
2024	18,758,651	17,364,300
2025	20,104,894	20,071,730
2026	23,304,317	21,316,691

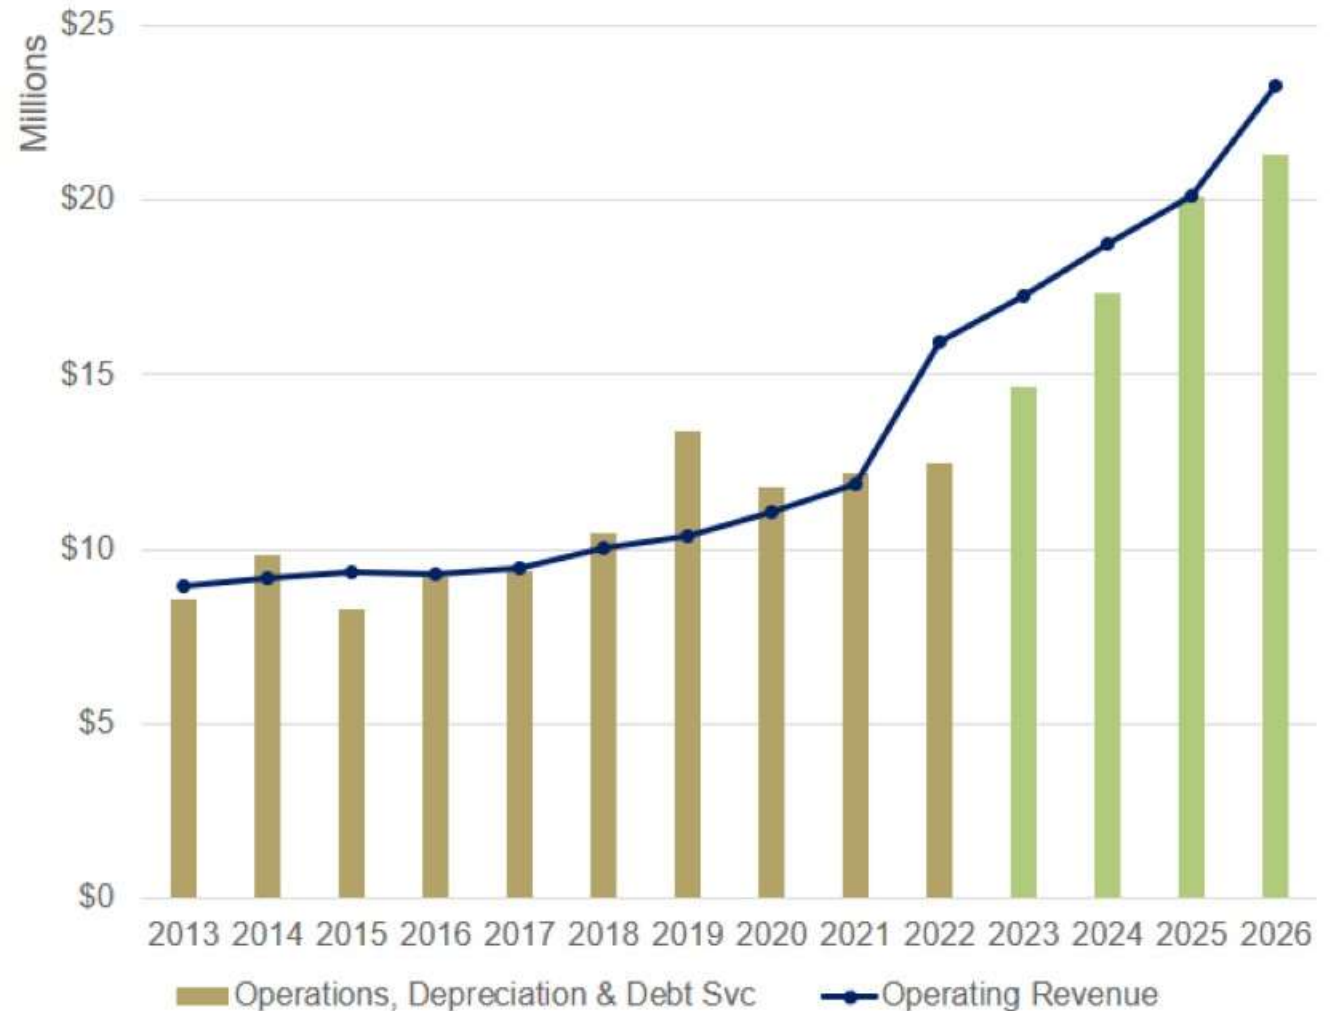

Sewer Capital Financial Background

	Capital Expenditure
2017	10,444,348
2018	4,890,330
2019	6,600,249
2020	6,277,483
2021	13,710,561
2022	17,814,343
2023	17,101,424
2024	57,285,841
2025	9,779,400
2026	7,975,447

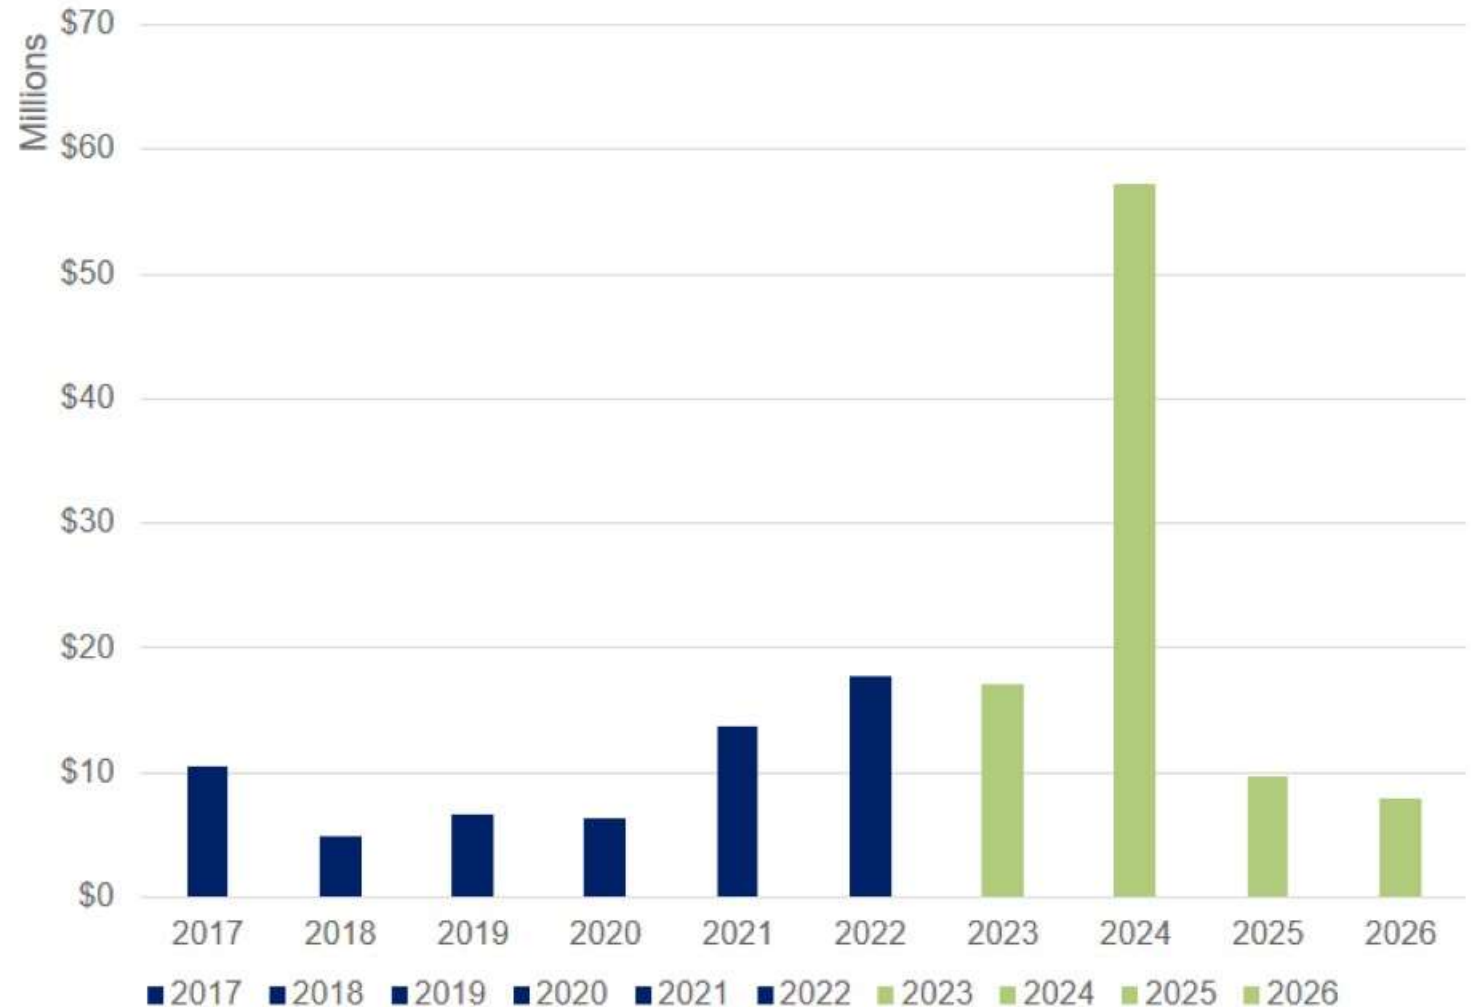

2024 Water Operating Requests

- Reflects all staff requests
 - Department recommended budget will be less

Request	Type	Amount	Annual/One-Time
WR Modeler	FTE	\$110,762	Annual
WQ Technician	FTE	\$80,283	Annual (w/vehicle)
WC Specialist 1	FTE	\$70,272	Annual
Utility Locator - Lead	FTE	\$96,884	Annual (w/vehicle)
Dist Construction Crew	FTE-7	\$631,405	Annual (equipment)
Backflow Technician	FTE-2	\$193,244	Annual (w/vehicles)
Operations Admin Ass't	FTE	\$67,414	Annual
Meter Technician	FTE	\$80,883	Annual (w/vehicle)
Water Instrumentation Tech	FTE	\$124,338	Annual (w/vehicle)
Asset Management Tech	FTE	\$92,717	Annual (w/vehicle)
Budget Analyst 1	FTE	\$93,204	Annual
Meter Data Analyst	FTE	\$107,737	Annual

2024 Water Operating Requests

- Reflects all staff requests
 - Department recommended budget will be less

Request	Type	Amount	Annual/One-Time
Water Dept Assessment	Operations	\$60,000	One-Time
Financial Consulting	Operations	\$50,000	Annual
Sponsorships	Operations	\$10,000	Annual
Meter Connection Charge	Operations	\$290,000	Annual
Bellvue Chemicals	Operations	\$500,000	Annual
WR Administrator Vehicle	Operations	\$49,000	One-Time
WR Training	Operations	\$3,500	Annual
WR Planning Consulting	Operations	\$55,000	Annual
WR Planning	Operations	\$12,723	Annual
WR Planning Interns	Operations	\$46,760	Annual
WQ Interns	Operations	\$20,450	Annual
Equipment-Const Crew	Operations	\$1,341,975	One-Time
High Mtn Res-Operations	Operations	\$16,800	Annual/One-Time
Overland Pond Maint	Operations	\$20,500	Annual
Customer Affordability	Operations	\$150,000	Annual
Engineering Training	Operations	\$10,000	Annual
Non-Pot Vehicle	Operations	\$50,000	One-Time
NISP/Halligan Monitoring	Operations	\$25,000	Annual
Non-Pot Electricity	Operations	\$44,000	Annual
Meter Test Bench Maint	Operations	\$33,907	Annual

2024 Sewer Operating Requests

- Reflects all staff requests
 - Department recommended budget will be less

Request	Type	Amount	Annual/One-Time
WWC Crew Supervisor	FTE	\$115,729	Annual (w/vehicle)
WTRF Operator	FTE	\$109,396	Annual
Source Control Specialist	FTE	\$104,027	Annual (w/vehicle)
WW Instrumentation Tech	FTE	\$124,338	Annual (w/vehicle)
Sewer Dept Assessment	Operations	\$30,000	One-Time
WTRF Chemical	Operations	\$141,934	Annual
WTRF Biosolids Handling	Operations	\$60,830	Annual
IPP Software Maintenance	Operations	\$4,142	Annual
WWC General Operating	Operations	\$20,500	Annual

2024 Capital Focus

- Rehabilitation
- Terry Ranch/Gold Hill Pipelines
- Non-Potable
- North Greeley Sewer
- WTRF Phase 2





Questions?



Water & Sewer Agenda Summary

Date: May 17, 2023

Key Staff Contact: Leah Hubbard, Water Resources Operations Manager

Title: Water Court Update

Summary: The City of Greeley Water and Sewer Department is active in numerous Water Court matters to develop additional water supply and to protect existing water rights. In the first trimester, Greeley filed 7 statements of opposition and stipulated out of 4 cases. So far in 2023, water court legal costs equaled \$133,066 and engineering costs equaled \$46,203 for a total annual cost of \$179,269.

Attachments: Water Court Update Memo


1st Trimester Water Court Update

Leah Hubbard, Water Resources Operations Manager

May 17th, 2023

Statements of Opposition

- T1 2023: 7 statements of opposition filed and 4 stipulations reached
- Number of cases Greeley is *currently* an opposer: **36**
- Total number of active cases in 2023: **39**

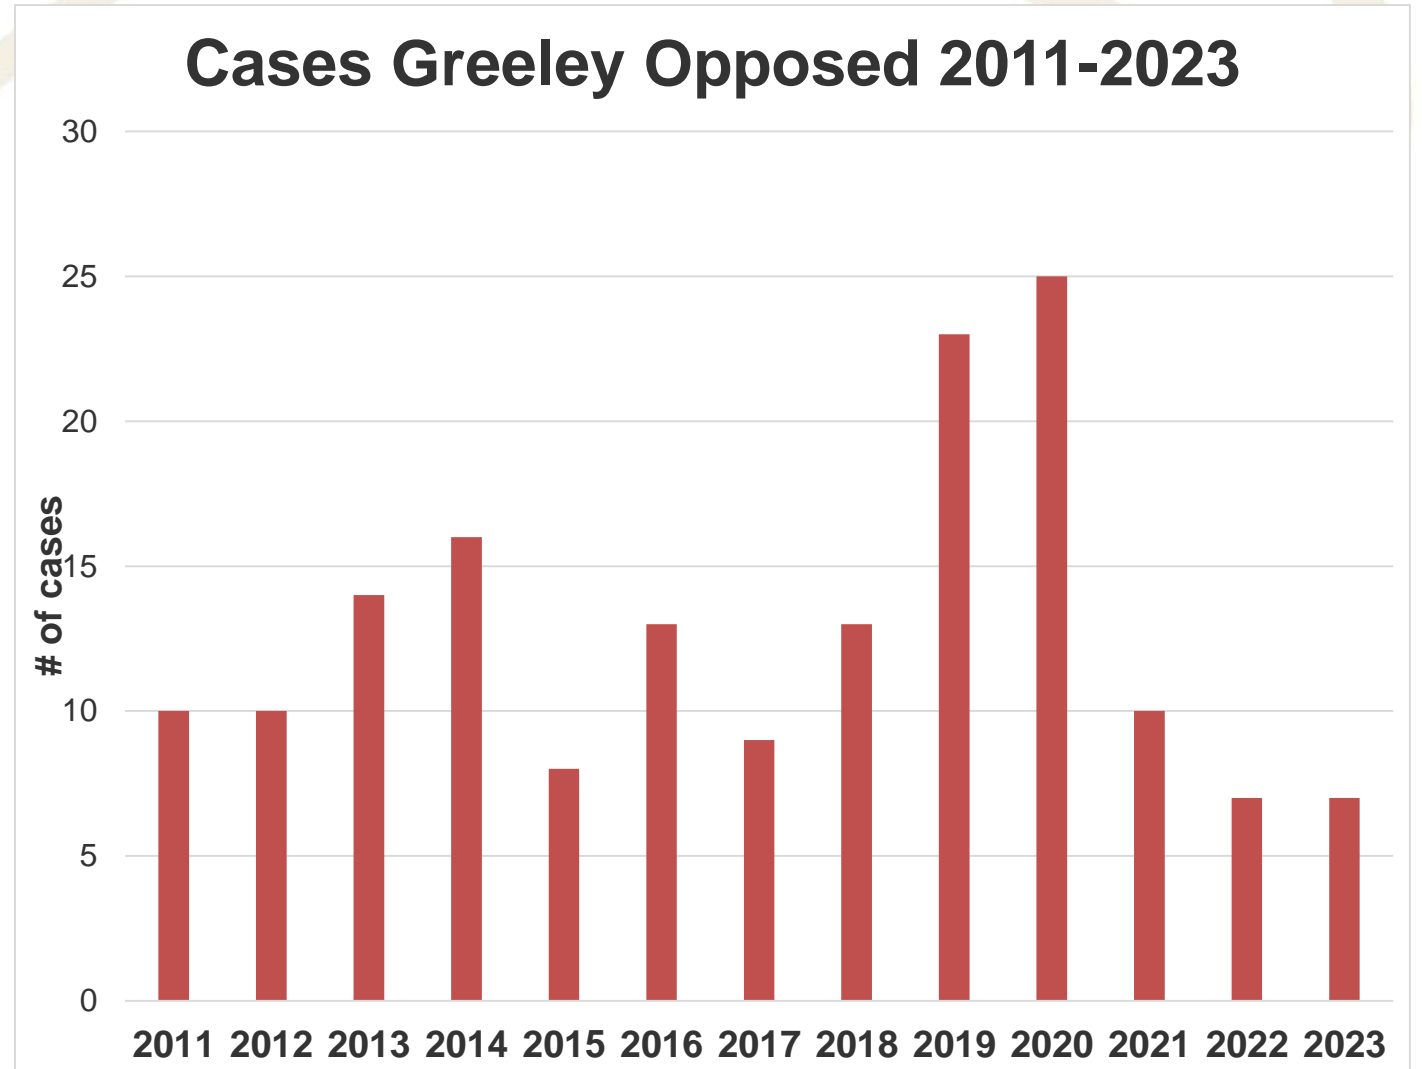

Greeley as Applicant

Poudre Instream Flows Aug. Plan 21CW3056



- Preserve and improve Poudre River instream flows
- Co-Applicants with CWCB, Fort Collins, and Thornton
- Greeley using GIC rights
- 20 statements of opposition filed
- Case to be rereferred soon
- No current deadlines set

Greeley as Applicant

Greeley Change of WSSC (22CW3042)

- Changing 23.917 shares
- Municipal, augmentation, and other uses
- Includes plan for augmentation for return flows
- Conditional direct flow water right for return flows
- 24 statements of opposition were filed
- Greeley responded to comments April 21st.



Greeley as Applicant

Greeley Lower Poudre Diligence (22CW3220)



- Filed application on December 31st, 2022
- Greeley claiming additional amount of junior storage right as absolute for a total of 1,458.6AF
- Greeley also seeking to increase rate of exchange from 6.14 cfs to 9.04 cfs from WWTP to Boyd and Freeman Headgate

Legal & Engineering Expenses

2023 Costs

Legal	\$ 133,066
Engineering	\$ 46,203
Total	\$ 179,269

This is 36% of the \$498,272 spent in 2022

Notable Case

ACWWA, ECCV & United (20CW3117)



- Applicant seeks to change 196.5 shares of the Fort Morgan Res. and Irr. Co. and 2 Jackson Lake rights
- Heading to trial June 5th.
- Greeley has not stipulated out of the case and will participate in trial.



Questions?





Water & Sewer Department

MEMORANDUM

TO: Greeley Water & Sewer Board

FROM: Leah Hubbard, Water Resources Operations Manager

DATE: May 17th, 2023

RE: 2023 1st Trimester Water Court Cases Update

This memorandum is a review of the Water and Sewer Department’s legal activities from January 2023 through April 2023. The review includes an update on Greeley’s current Water Court cases and a summary of the Water Resources Division’s legal expenses.

STATEMENTS OF OPPOSITION

Since the last update in January, Greeley has filed seven statements of opposition and stipulated in four cases. Therefore, the current number of pending Water Court cases in which Greeley is an opposer is 36.

Statements of Opposition filed:

Case	Applicant
22CW3206	Town of Berthoud
22CW3207	City of Dacono
22CW3218	Loveland Ready-Mix Concrete, Inc.
22CW3223	Ogilvy Irrigating and Land Company
22CW3224	GMS of Central
22CW3228	Handy Ditch
23CW3012	ACWWA, FIDCO

Stipulations filed:

Case	Applicant
20CW3096	ECCV & United-Fulton Ditch
20CW3113	Lazy D Ranch
21CW3125	Parker Diligence
20CW3142	ACWWA-Whitney Ditch

SERVING OUR COMMUNITY • IT'S A TRADITION

We promise to preserve and improve the quality of life for Greeley through timely, courteous and cost-effective service.

GREELEY AS APPLICANT

A summary of pending Water Court cases in which Greeley is the applicant is as follows:

21CW3056 (City of Greeley, et al., Poudre River Instream Flows Augmentation Plan)

On April 29, 2021, the City of Greeley filed a joint application with the Colorado Water Conservation Board, Colorado Water Trust, City of Fort Collins, City of Thornton, Northern Water, and the Cache la Poudre Water Users Association for approval of a plan of augmentation for instream flows in the Cache la Poudre River. The purpose of the augmentation plan is to preserve and improve the natural environment to a reasonable degree at various locations in the Poudre River from the Cache la Poudre at Canyon Mouth near Fort Collins gage to the confluence of the South Platte River. Greeley has proposed to include certain of its changed Greeley Irrigation Company shares in the plan. Twenty statements of opposition have been filed. The applicants are finalizing responses to a third round of opposers' comments. The case will likely be rereferred to the water judge soon, and there are no current deadlines.

22CW3042 (City of Greeley Change of WSSC)

On March 31, 2022, the City of Greeley filed its application for the change of 23.917 shares in the Water Supply and Storage Company ("WSSC"). Greeley is changing the shares from irrigation to municipal, augmentation, and other uses. Greeley also seeks a plan for augmentation and water exchange project for the replacement of return flows from the native portion of the Subject Shares and an appropriation of such return flows. Greeley also seeks a conditional direct flow water right for replacement of return flows. Twenty-four statements of opposition have been filed. Greeley replied to the first round of comments on April 21st, and opposers' comments are due June 23rd, 2023.

22CW3220 (City of Greeley Lower Poudre Diligence)

On December 31, 2022, the City of Greeley filed its application for diligence and to make an additional portion absolute for partially conditional water rights originally decreed in Case No. 99CW234. This application concerns the partially conditional water storage rights for Flatirons Reservoirs 1-5 (a.k.a. Poudre Ponds) and the partially conditional rights of substitution and exchange. Greeley is seeking to increase the absolute storage amount in Poudre Ponds from 1,304 acre-feet to 1,458.6 acre-feet. Greeley is also seeking to increase the absolute rate of exchange from 6.14 c.f.s. to 9.04 c.f.s. from the Wastewater Treatment Plant to the Boyd and Freeman Headgate. Greeley will circulate the proposed decree to opposers by June 2nd.

LEGAL & ENGINEERING EXPENSES:

The Water Resource Division’s outside legal and engineering expenses from January through April 2023 totaled \$179,269.14, which is 35.98% of the total \$498,272 spent in 2022.

2023 Water Resources Legal and Engineering Costs

<u>1st trimester</u>	
Legal	\$133,066
Engineering	\$46,203
<i>Total</i>	\$179,269
<u>2nd trimester</u>	
Legal	
Engineering	
<i>Total</i>	
<u>3rd trimester</u>	
Legal	
Engineering	
<i>Total</i>	
<u>Annual Totals</u>	
Legal	\$133,066
Engineering	\$46,203
Total	\$179,269



Water & Sewer Agenda Summary

Date: May 17, 2023

Key Staff Contact: Leah Hubbard, Water Resources Operations Manager

Title: Outside Counsel Legal Report

Summary: This report has been provided by James Noble, outside counsel for the Greeley Water & Sewer Board.

Based on our review of the March, 2023 Water Division 1 Resume, staff and water counsel do not recommend that the Water and Sewer Board file statements of opposition to any water court matters that would be due at the end of May, 2023.

Attachments: None.



Water & Sewer Agenda Summary

Date: May 17, 2023

Key Staff Contact: Sean Chambers, Water & Sewer Director

Title: Director's Report

Summary:

The Director will provide the Water & Sewer Board with a brief update on the following items of interest

1. City of Greeley and Water Industry Events
 - a. CWCB Drought Summit - 5/31 & 6/1 (currently a wait list)
 - b. Summer Board & Council Tour – July 28, 2023
 - i. Tentative: Chimney Hollow Res. Construction, Boyd Lake WTP, Terry Ranch Pipeline Construction, 23rd Ave. Reservoirs and Wastewater Treatment Facility
 - c. Tour of Greeley's Bob Creek Diversion from Upper Laramie into Poudre - TBD
 - d. Colorado Water Congress Conference – August 2023 dates TBD
2. Greeley Water Treatment Source Water Quality Disruptions Update
 - a. Periodic wildfire sediment and debris in the Poudre River; While infrequent, events have caused shut down of the Poudre River diversion intake
 - i. NPIC / NCWCD trade in place, but exchange must be in priority
 - b. Recent mud/soil slide into Charles Hanson Canal between Horsetooth North Outlet and Bellvue WTP caused a lot of high turbidity muddy water to enter the Bellvue settling ponds
 - c. The water system and the operations team continue to show resiliency, and customer should not expect any change to their treated water quality.
 - d. Boyd Lake WTP seasonal treatment plant start up and demand management
3. 2023 Legislative Session at a Glance – Colorado Water Congress State Affairs Report
4. Data and Analytics Charts for Water & Sewer Utilities
 - a. Water Treatment Data
 - b. Wastewater Treatment Data
 - c. Water Distribution and Meters Data
 - d. Wastewater Collection Data
 - e. Water Resources Data
 - f. Treated Water & Weather Data
5. Appreciate staff and Board effort to make the live stream *YouTube* meetings a success
 - a. Timely starting of meetings, microphones usage, and meeting management

Recommended Action:

No Action – Information Only

Attachments:

Colorado Water Congress State Affairs

2023 Legislative Session at a Glance

Status as of May 9, 2023

The legislative session adjourned *sine die* late in the evening on May 8. Several bills were rewritten (multiple times) in the final weeks of the session and differ from the introduced versions. Some did not clear Appropriations committees – were not killed in Appropriations, but were not scheduled because of prioritization of other measures. This is not intended to be exhaustive, but is meant to simply state the purpose of each bill tracked on the State Affairs Status sheet and provide clarifying comments when warranted.

Bill Number and SA position	Short title/Topic	Purpose at final disposition	Status	Comment
HB 1005 Support	New energy improvement districts	Adds water and resiliency to the purposes for which a new energy improvement district may provide financing	Signed	These special districts were first est. in 2010 to finance renewable and efficient energy for voluntary assessments
HB 1010 No position	High alt. water storage study	The bill would have created a task force to study opportunities for water storage in snowpack	Killed (Pi'd)	Originally requested by late Rep. McKean
HB 1018 Support	Timber industry incentives	Would have provided an income tax credit for purchase of machinery used by timber industry	Killed on calendar	Failed to get past appropriations committee
HB 1023 Support	Special district construction contracts	Doubles amount of public exp. Before required publication of contract to \$120,000 and adds inflation starting in 2028	Signed	
HB 1065 Monitor	Local Govt Ind. Ethics Comm.	Would have added special district officials and school district officials under jurisdiction of Indep. Ethics Comm.	Killed on calendar	Controversial; failed to clear debate in Senate final days
HB 1125 Support	Water Well Info. procedures	Updates type of notification re ownership of water well and who files info	Signed	Simple, procedural bill
HB 1152 Monitor	Prohibit foreign ownership natural resources	Would have prohibited persons from certain foreign countries from acquiring ownership in ag or natural resources property including water rights	Killed (Pi'd)	This issue is more prevalent regarding ag lands in Midwest

HB 1220 Support	Study economic impact of non-compliance Republican River compact	Directs Center for Water Studies at CSU to study economic consequences of potential non-compliance with Republican River Compact	Passed both chambers	Second to last bill passed in Senate 5/8/23
HB 1221 Amend	Water Quality Data Stds.	Would have required Water Quality Control Div. to use quality assured standards in setting TMDLs for state waters	Killed on calendar	Not prioritized for moving forward in final days of session
HB 1242 No position	Water use Oil/Gas operations	Requires oil/gas operators to report to OGCC on water use, VMT hauling water, and increase use of recycled/produced water; also est. a produced water consortium to study uses	House concurred Senate amendments	Bill substantially rewritten in Senate before final passage; ongoing work for consortium
HB 1255 No position	Prohibit anti-growth laws	Prohibits restrictions on growth except following disaster emergency, May allow temporary (24 months in 5 years) to amend land use or acquisition or extension of services or water	House concurred Senate amendments	This was a companion to Housing/Land Use bill that failed
HB 1257 Support	Mobile home park water quality	Directs Water Quality Control Div. to est. testing program for drinking water in mobile home parks, respond to complaints, notify multiple entities of results. Mobile home park owners required to develop and implement a remediation plan.	House concurred with Senate amendments	
HB 1274 Support	Funding for species conservation	Annual funding for species conservation projects within CWCB; appropriates \$5 million from Species Cons. Trust Fund	Sent to Gov.	
HB 1282 Oppose	Utilities under Consumer Protection Act	Would have placed utilities, including water utilities, under the Consumer Protection Act for enforcement of consumer complaints (AGs office)	Killed on calendar	House laid over to 7/1 (after end of session)
SB 005 Support	Forestry/Wildfire mitigation workforce	Provides funding to inst. Of higher ed to create and expand forestry programs; funds internships through timber business; fee for service contracts and grants to train educators in forestry and wildfire mitigation	Sent to Governor	Perceived overlap with HB 1018

SB 010 Support	Water and Ag Resources Interim	Authorized the Water and Ag resources interim to meet year round.	Signed	First meetings held March and April
SB 032 No position	Wildfire detection pilot program	Would have directed the implementation of a pilot program using remote camera and AI technologies for early detection of wildfires	Killed on calendar	Failed to advance from House appropriations in final days
SB 053 Monitor	Governmental non-disclosure agreements	Prohibits schools, educational institutions, state and state agencies, and local governments from requiring non-disclosure agreements with certain exceptions. Prohibits retaliation.	Sent to Governor	Numerous exceptions provided to protect personal info, trade secrets, security
SB 057 Amend	County Treasurer no longer Ex Officio for districts	Increases fee for county treasurer to collect assessments for irrigation and drainage districts; directs boards to appoint district treasurer; principal and interest on bonds paid at direction of boards.	Signed	
SB 059 No position	Local Access funding for State Parks	The bill CPW to charge a fee of up to \$2 on daily vehicle passes for access to state parks at the request of a local government. It also requires CPW to study local access to state parks	Passed both chambers	
SB 103 Support	Landowner liability rec use	The bill would have increased landowner protections from liability for injury when allowing recreational use on private lands	Killed (Pl'd)	Opposition from trial lawyers who won landowner liability case on AF property
SB 150 Support	Labeling of disposable wipes	The bill requires labeling of wipes that should not be flushed to avoid damage to infrastructure	Signed	
SB 177 Support	CWCB water projects	Funding authorization for annual CWCB projects bill	Sent to Governor	
SB 178 Support	HOA landscaping	Prohibits HOAs from restricting homeowners use of xeriscape and drought tolerant plantings on 80% of their property; allows vegetable gardens on front, side or back of property, limits hardscape requirements to 20% of a common interest property.	Sent to Governor	

		Requires HOAs to pre-approve three drought tolerant plant designs that may be used to meet aesthetic guidelines. Allows civil action for HOA violation.		
SB 186 No position	Methane Seepage Raton Basin	Directs the OGCC and Water Quality Control Division to study methane seepage in Raton Basin and associated water to identify best practices for capture of seepage, evaluate the quality of the water, and evaluate opportunity to preserve and make beneficial use of the water.	Senate concurred House amendments	
SB 213 Oppose	Land Use/Housing	The bill would have mandated planning, studies, and approval at multiple levels of government; pre-empted local government planning for residential housing. State Affairs opposed because of mandates to serve increased density and expanded development regardless of water and infrastructure requirements	Killed on the calendar	The bill was rewritten by amendment multiple times right up to the end of the last day. House and Senate could not agree on path forward.
SB 237 Support	Funding water plan	Transfers \$12.6 million from severance tax operational fund to water plan implementation	Signed	
SB 238	Small communities water and wastewater	Authorizes Small communities water and wastewater grant fund to be used to provide matching dollars for federal grants	Signed	
SB 262 Monitor	Water Desalinization study	Directed CWCB to study desalination in California and Mexico and report to legislature	Killed on calendar	Did not clear House appropriations
SB 267 Support	Chatfield water quality fee	Authorizes CPW to collect a \$1 fee at entrance to Chatfield state park to be used for water quality purposes	Senate concurred with House amendments	
SB 270 Support	Stream Restoration	Creates a rebuttable presumption that a minor stream restoration project does not cause material injury to a vested water right. If a water right holder believes a stream restoration project has caused material injury to their water right, they may challenge this rebuttable presumption by	Passed both chambers	Numerous meetings with DNR and sponsors about this bill






		presenting evidence of the material injury in the appropriate division water court		
SB 274 Monitor	Water permit fees	Removes water permit fees from statute and directs Water Quality Control Commission to set fees following stakeholder meetings; changes composition of Commission	Passed both chambers	Bill directs CDPHE to hold stakeholder meetings to discuss division needs, sources of funding, recommend fees to Commission for rulemaking
SB 285 No position	Energy and Carbon Management	Changes mission and name of Oil and Gas Conservation Commission to Energy and Carbon Management Commission. Establishes jurisdiction for State Engineer over shallow geothermal wells and ECMC for deeper geothermal wells.	Senate concurred House amendments	
SB 286 Amend	CORA/public records	Requires that records stored in digital format be transferred to requester in digital format; requires custodian of records to accept electronic payment; requires state agencies to submit records retention policy to Leg. Council	Senate concurred House amendments	As originally introduced require preferential rates/response for media
SB 295 Amend	Colorado River Drought Task Force	Establishes a 17-member task force to discuss potential legislative action on collaboration between CWCB, Colorado River District, districts in basins dependent on and influenced by Colorado River. Twelve meetings are authorized starting no later than July 31, report by Dec. 15.	Senate concurred House amendments	This bill sponsored by West Slope legislators replaced competing drafts developed by State and River District
HJR 1007	Project Eligibility List	Annual bill to obtain legislative approval for projects that may receive funding from Water and Power Authority	Signed	

Water Treatment

Bellvue Water Treatment Plant operates year-round with a transmission capacity of 29.1 million gallons per day (mgd) (plant capacity is 32 to 35 mgd). Water sources include Poudre River direct flows, Colorado-Big Thompson (C-BT), Windy Gap, High Mountain Reservoirs, Laramie-Poudre Tunnel, and Water Supply and Storage. Average volume is 19,000 acre-feet a year (2000-2011). The plant was built in 1907, with its last treatment upgrade in 2009. Solar panels were added in 2014.

Boyd Water Treatment Plant operates normally from April to October with a plant capacity of 38 mgd (transmission capacity is 40 mgd). Water sources include Greeley-Loveland Irrigation Company, C-BT, and Windy Gap. Average Volume is 8,200 acre-feet (2000-2011). The current plant was built in 1974, with its last treatment upgrade in 1999. Solar panels were added at Boyd in 2014. In 2016, tube settlers and platte settlers were replaced in the sedimentation basins. In 2018, all old existing chemical lines were replaced with new lines and the piping was up-sized to carry more chemical. A PLC upgrade was done on the SCADA system. Sludge pumps were replaced and hooked into the Trac Vac system that pulls sludge out of the sedimentation basins.

Combined, Bellvue and Boyd can treat a maximum of 70-73 million gallons per day.

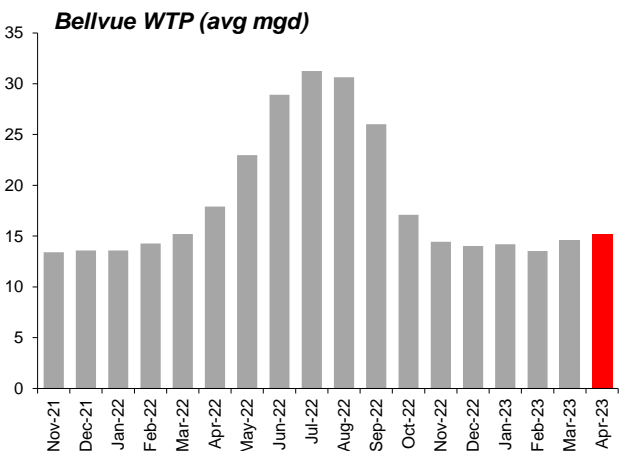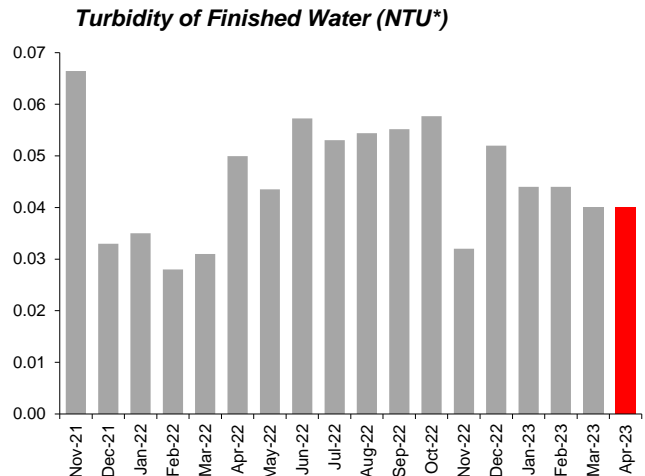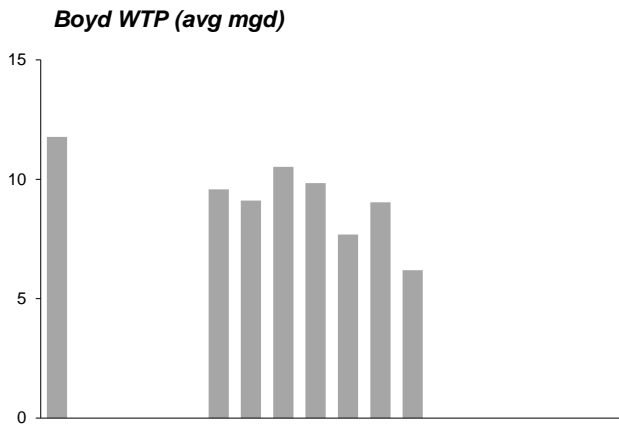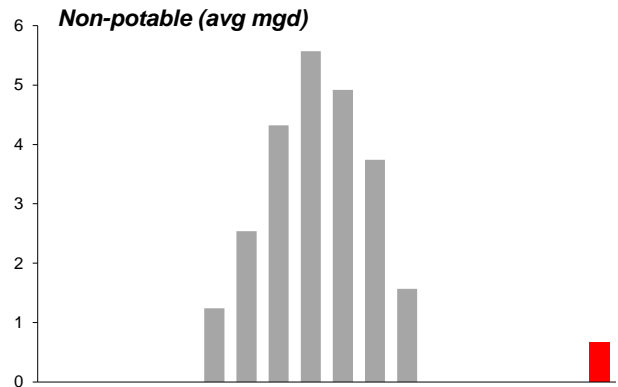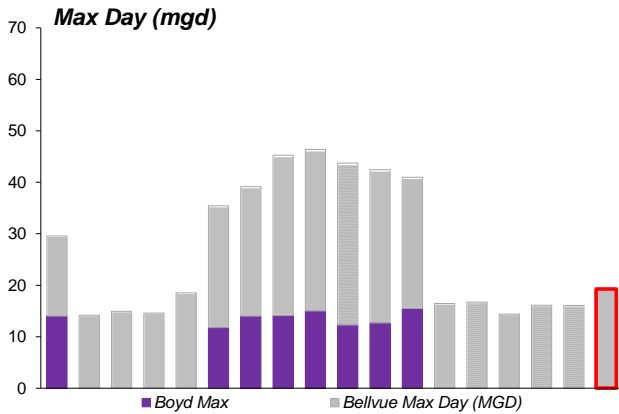

Starting May 2016 Bellvue turbidity measurements will use a new method resulting in more accurate readings.

*Turbidity limit: 95% of samples must be below 0.3 NTU.

Turbidity is the measure of relative clarity of a liquid. Clarity is important when producing drinking water for human consumption and in many manufacturing uses. Turbidity is measured in Nephelometric Turbidity Units (NTU).








Wastewater Treatment

The Water Pollution Control Facility (WPCF) staff are dedicated environmental professionals who provide quality, safe and cost-effective wastewater treatment services for the citizens of Greeley. The WPCF treats wastewater to meet or exceed Environmental Protection Agency (EPA) and Colorado Department of Public Health & Environment requirements.

In 2011, the WPCF received an Xcel Energy Custom Efficiency Achievement Award for saving 2.78 million kWh and reducing CO2 emissions by 1,584 tons. In 2012, the WPCF received the Rocky Mountain Water Environment Association's (RMWEA) Sustainability Award for Colorado demonstrating excellence in programs that enhanced the principles of sustainability. A Certificate of Achievement from the Colorado Industrial Energy Challenge program managed through the Colorado Energy Office was received in the same year. In 2013, the plant received the City of Greeley's Environmental Stewardship Award for outstanding efforts to reduce energy (watts), conserve energy and water, reduce air and water pollution, and educate and encourage others to be environmental stewards. Also, in 2013, the plant was the recipient of a Bronze Award from the Colorado Environmental Leadership Program. In 2015, after having 5 years without a plant violation, the plant received the 2015 National Association of Clean Water Agencies (NACWA) Platinum Peak Performance award for the City of Greeley Water and Sewer Department.

Note: the red column indicates the current month.

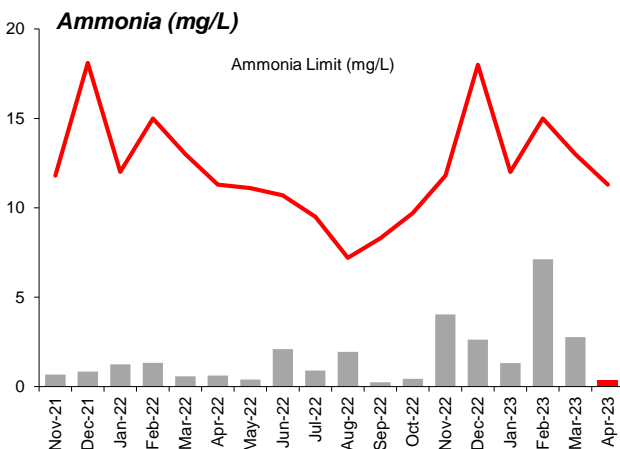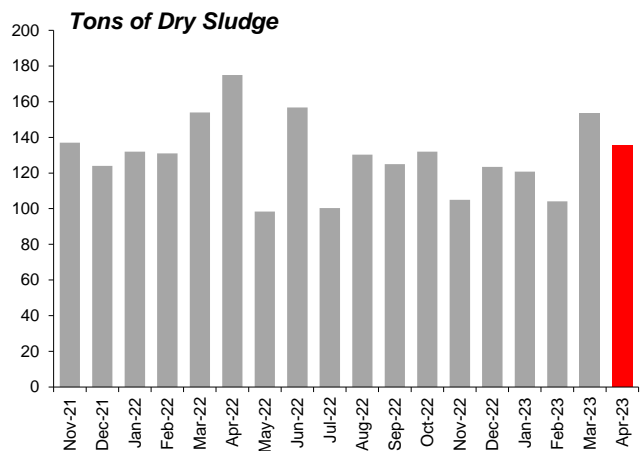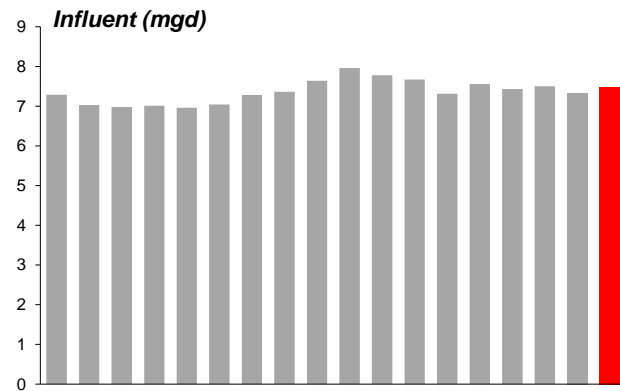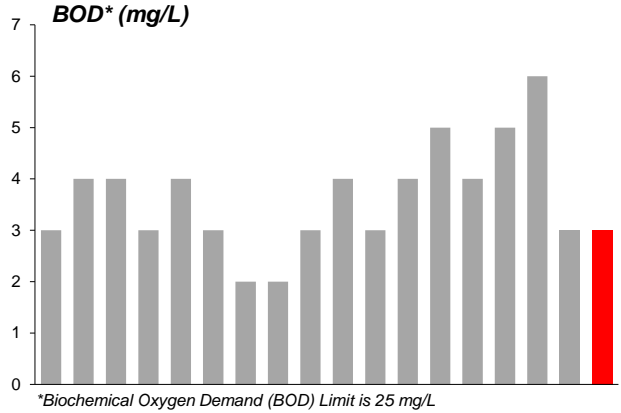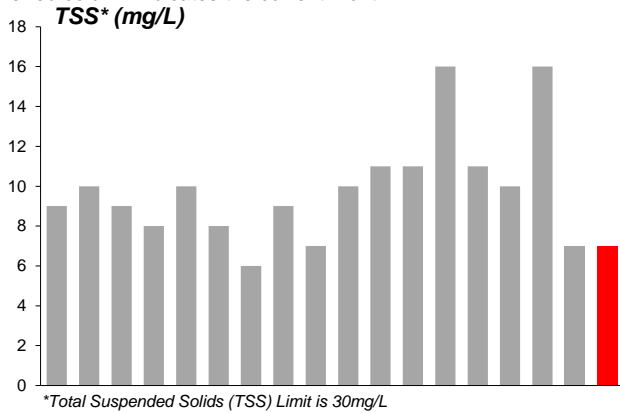






Water Distribution

The Greeley water distribution system consists of various sizes of pipes that generally follow the streets within the City. The distribution system serves residences and businesses in Greeley, Evans and Garden City, and the system is divided into four pressure zones.

There are 69.75 million gallons of potable water storage in Greeley. The water is stored within three covered reservoirs and one elevated tank; 23rd Avenue - 37.5 million gallons, Mosier Hill - 15 million gallons, and Gold Hill - 15 million gallons. The system also has 476 miles of pipeline, 24,233 water meters and 3,378 fire hydrants.

The water pipes in the distribution system vary in size from 4" to 36". Pipe material is steel, ductile iron, cast iron, or polyvinyl chloride. The age of the pipes varies from the 1890's to new installations.

Note: the red column indicates the current month.

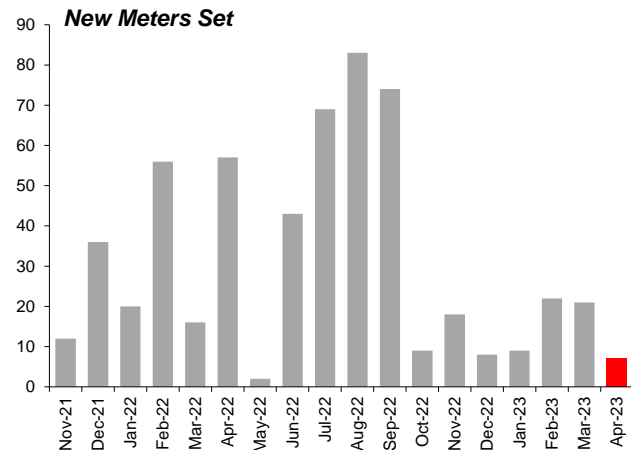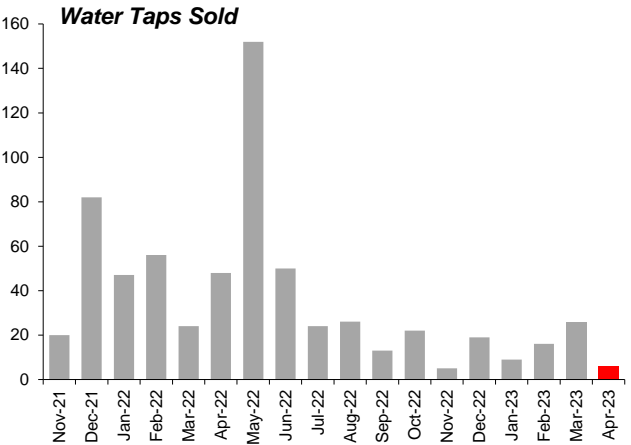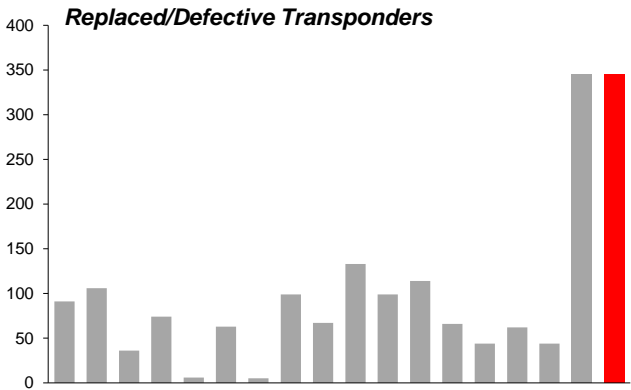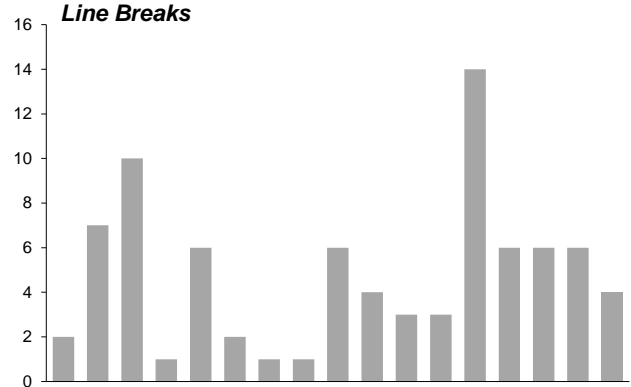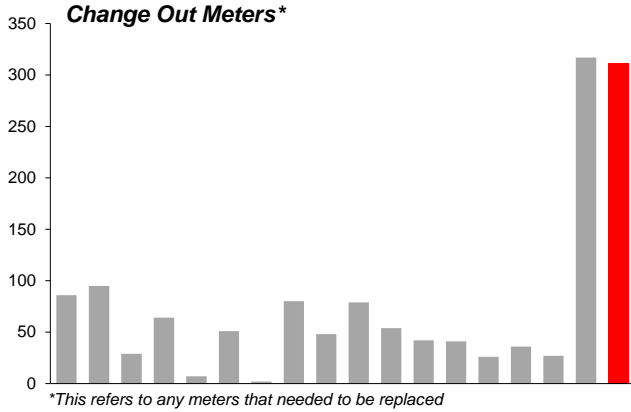





Wastewater Collection

The mission of the Wastewater Collection Division of the Water and Sewer Department is to protect community health by transporting wastewater away from homes and businesses. This includes respecting property values and public safety by reducing the frequency of blockages in the sanitary sewer lines.

A wide variety of work is performed including routine cleaning of sewer lines, inspection of sewer lines, maintenance of the sewage pumping stations, rehabilitation of the system and responding to emergencies.

The wastewater collection system dates back to 1889. At the end of 2017, the system had a total of 364.8 miles of line and 10 sewage pumping stations. The sewer service area is approximately 51 square miles. Over the last 10 years, the system has grown by 17 miles.

Note: the red column indicates the current month.



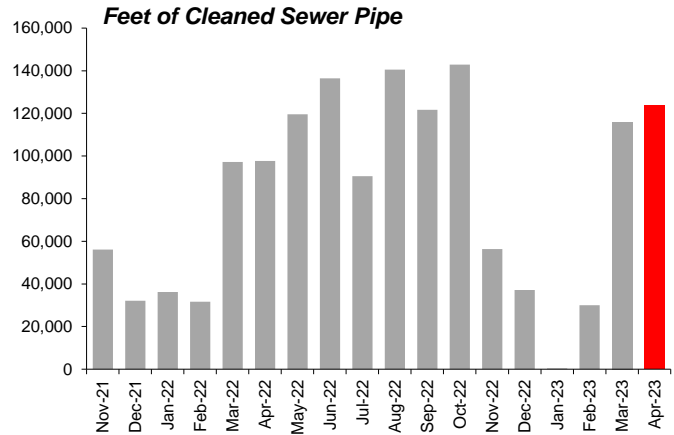
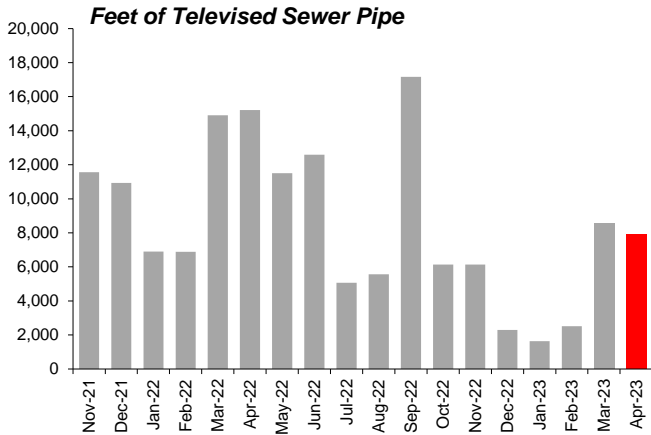
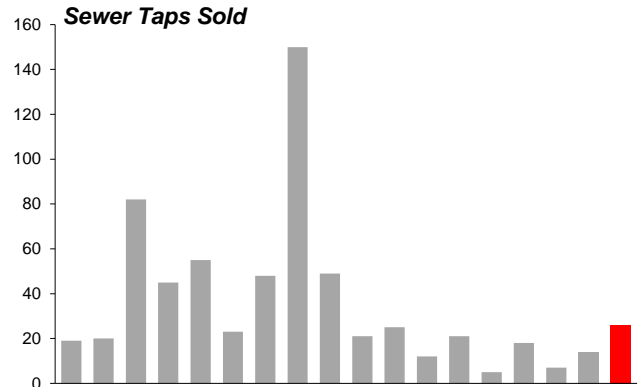
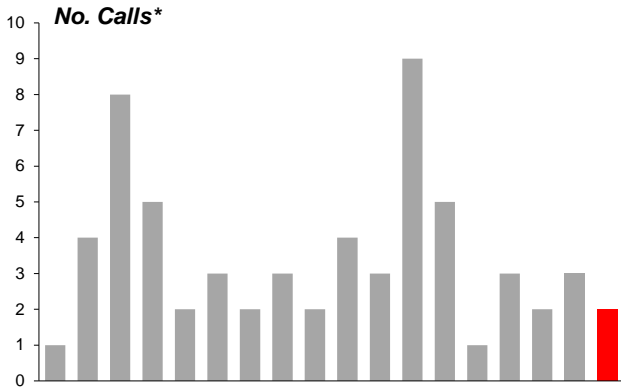


Water Resources

Greeley has numerous water rights in four river basins; the Upper Colorado River, Cache La Poudre, Big Thompson and Laramie River. The Water Resource staff must account for all of this water and comply with the rules of the Colorado Water Court and the State Engineer's Office which is in charge of allocating all of Colorado's water resources. Approximately one-third of the City's water supply comes from agricultural water rights. These water rights must be formally changed to municipal use by a special legal process through the Water Court. In this court, Water Resource staff and attorneys also defend the City's water rights against adverse claims from other parties.

Greeley's goal is to have enough water in carry-over storage to sustain Greeley through a 50-year critical drought. Water in excess of this carry-over drought supply can be leased to agriculture, both for revenue and to support our local agricultural community. Modeling has shown that, given existing population and demand factors, Greeley will have sufficient water for citizens, if at the beginning of the 6-year long, 50-year critical drought, there is 20,000 acre-feet in storage on April 1st of the following year.

Note: the red column indicates the current month.

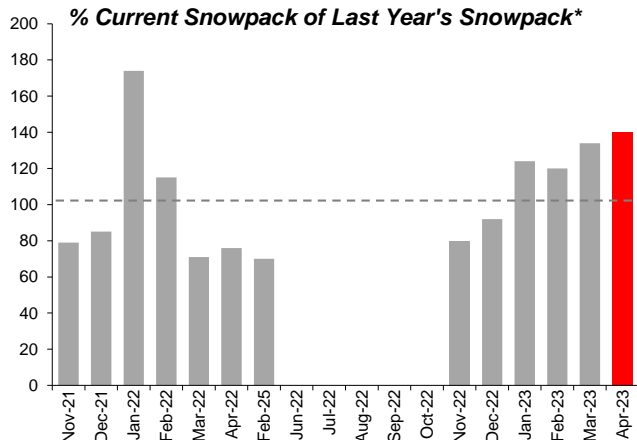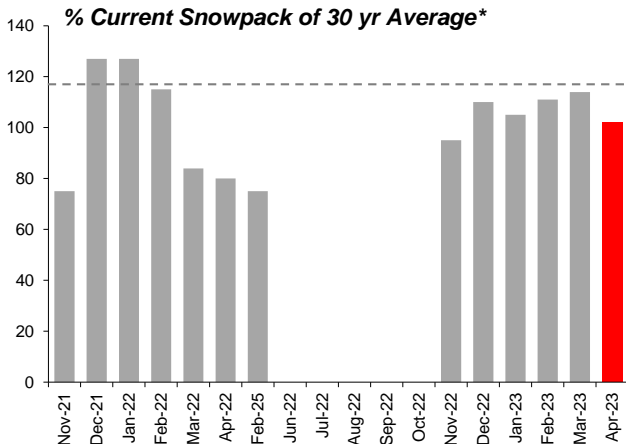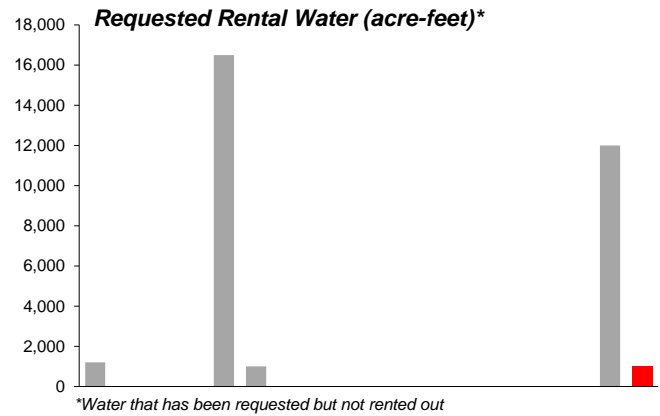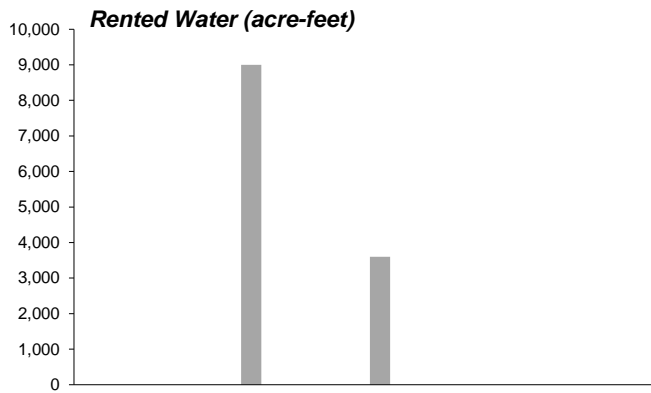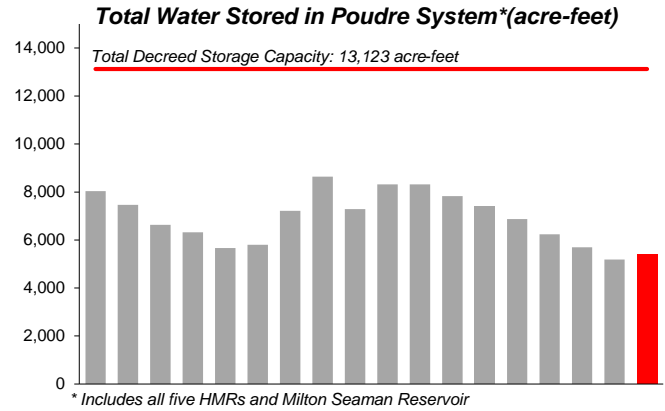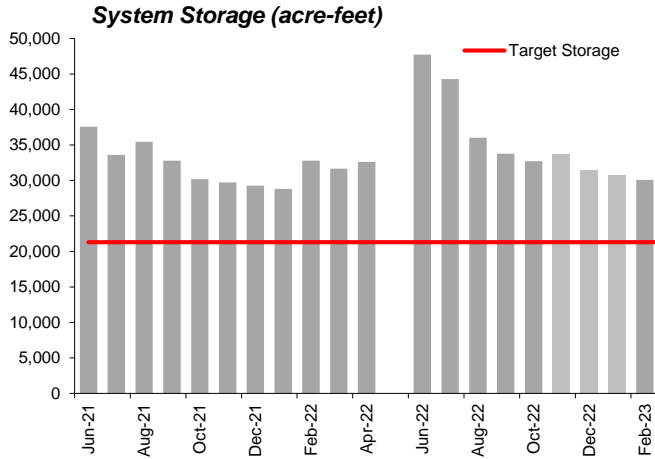







*Data is from the 1st of the month
 **Average of Deadman Hill and Joe Wright

*Data is from the 1st of the month
 **Average of Deadman Hill and Joe Wright

Treated Water and Weather Data

January was a cold month with an average temperature of 24°F. The average temperature for February was 27°, about 4° lower than the historical. It's been another cold month in March with an average temperature of 34.8°F, which is still 4° lower than the historical average. The average temperature in April was 47.33°F which is very close to the historical average.

Greeley received 1.1 inches of precipitation in January, this is more than double the historical average for this month. February brought 0.51 inches of precipitation. Total precipitation for March was 0.81 inches, bringing the total so far this year to 2.42. Greeley received 1.14 inches of precip in April, bringing the cumulative precip very close to the historical.

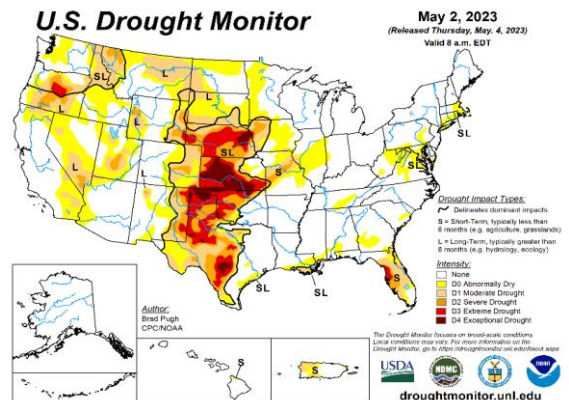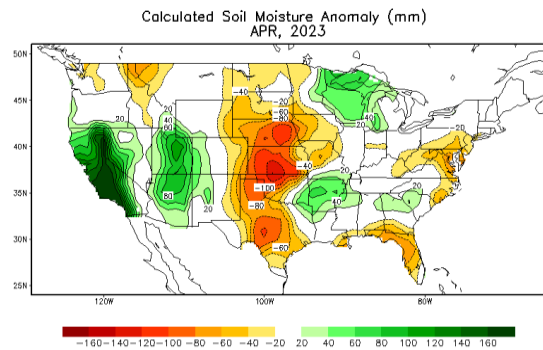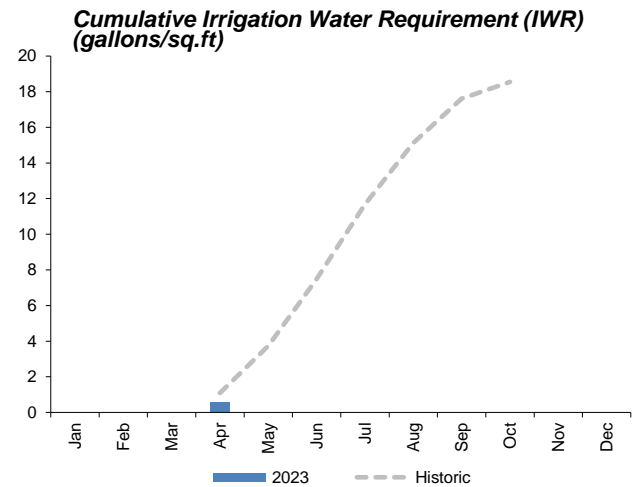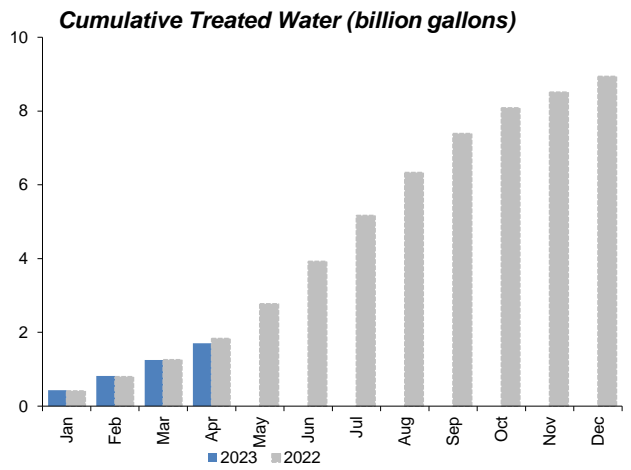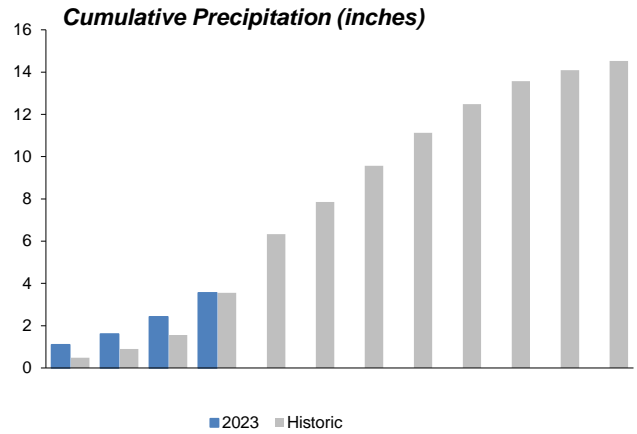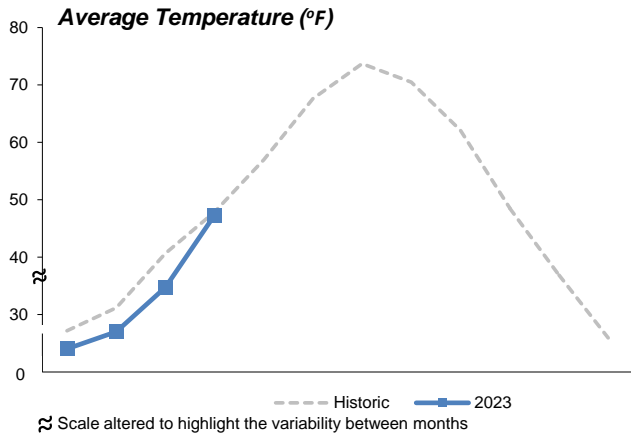



Water & Sewer Agenda Summary

Date: May 17, 2023

Key Staff Contact: Cole Gustafson, Source Water Supply Manager

Title: Executive Session – Market Update

Summary:

- Bi-Annual Water Market Update

Recommended Action: None

Attachments: None